

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906075

Luminaire Tested: DFN2DIP-PN4F0-090D090US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906075
REPORT IS A COMBINATION OF REPORTS P901230 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-090D090US835-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16560.0 lumens
Efficiency: N/A
Efficacy: 106.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 155
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906075

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US835-RLLONL

Luminous Intensity Polar Plot

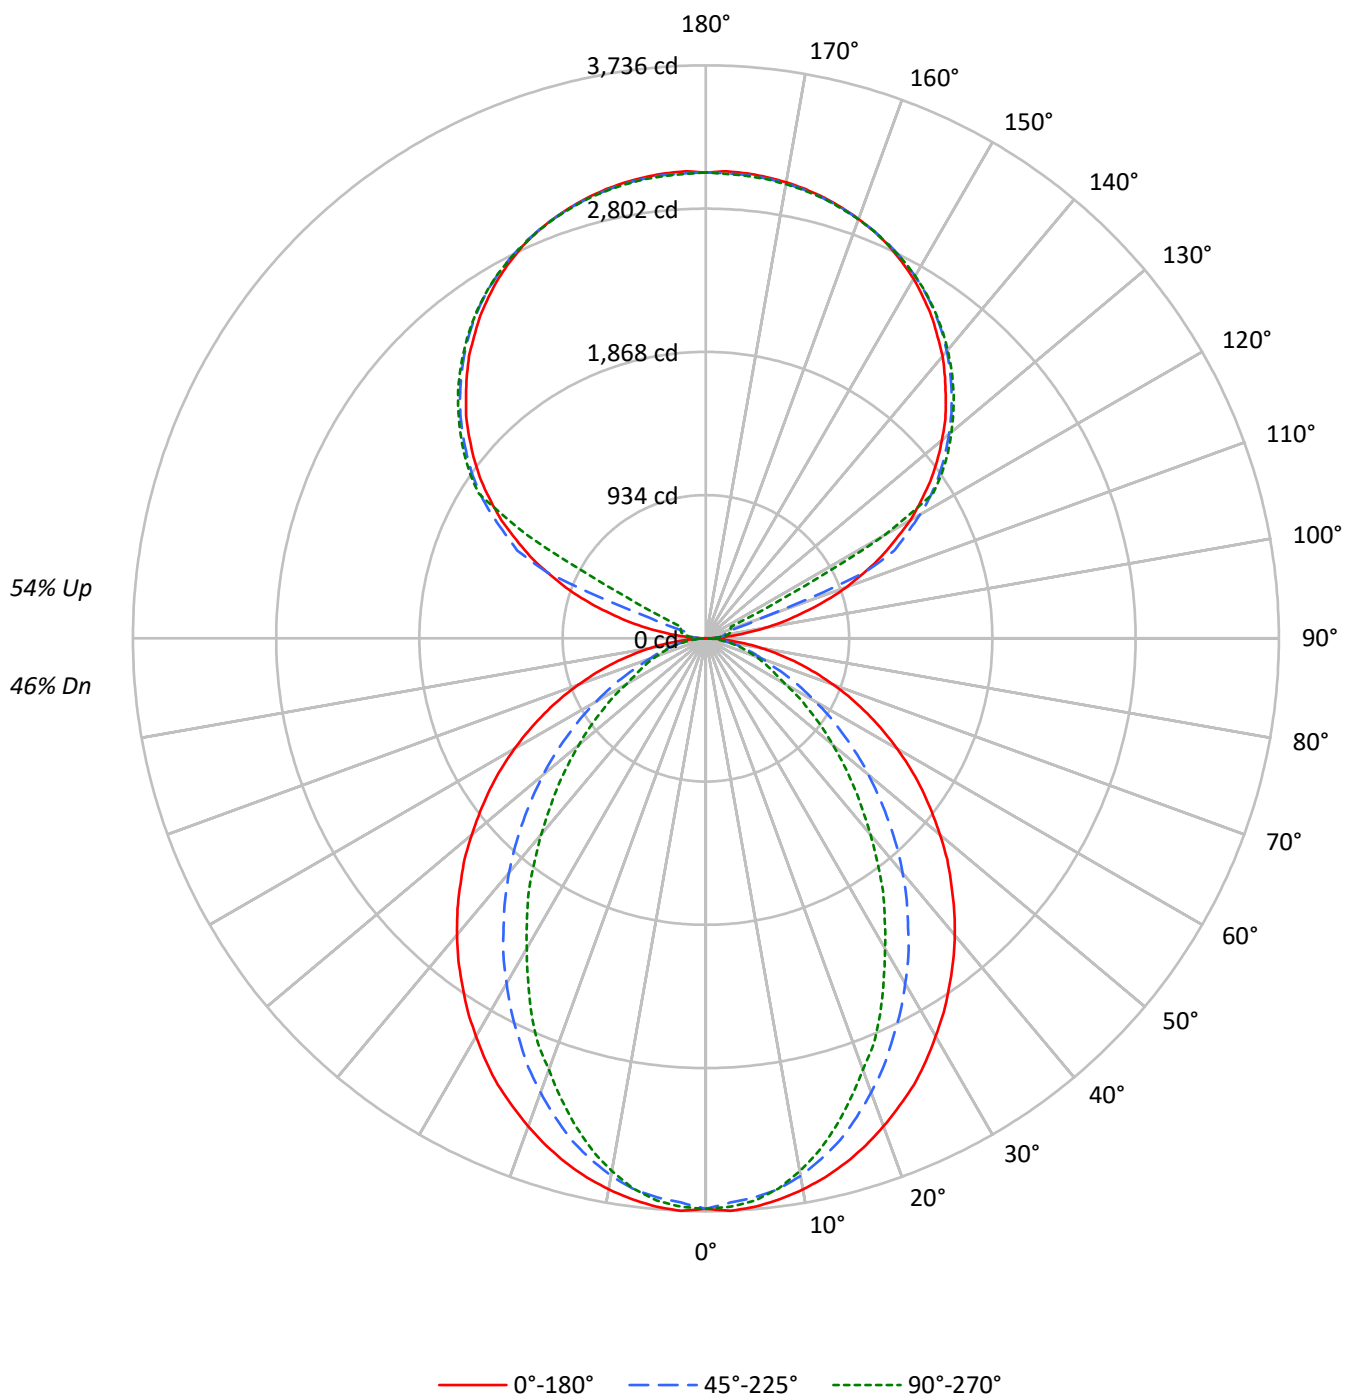

TEST NUMBER: P906075

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2715	2715	2715
5°	2720	2673	2690
10°	2693	2620	2603
15°	2656	2534	2468
20°	2607	2415	2302
25°	2556	2282	2142
30°	2489	2145	1939
35°	2423	1997	1761
40°	2356	1845	1556
45°	2277	1676	1371
50°	2197	1505	1189
55°	2112	1323	1015
60°	2015	1132	836
65°	1902	938	753
70°	1766	757	682
75°	1595	668	622
80°	1348	561	541
85°	939	377	410

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2277 cd/sqm

TEST NUMBER: P906075

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US835-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	348.6	2.1
10°-20°	957.0	5.8
20°-30°	1343.6	8.1
30°-40°	1464.6	8.8
40°-50°	1346.2	8.1
50°-60°	1057.2	6.4
60°-70°	688.1	4.2
70°-80°	354.2	2.1
80°-90°	95.8	0.6
90°-100°	100.2	0.6
100°-110°	373.4	2.3
110°-120°	990.2	6.0
120°-130°	1642.4	9.9
130°-140°	1744.6	10.5
140°-150°	1621.4	9.8
150°-160°	1303.5	7.9
160°-170°	840.0	5.1
170°-180°	289.1	1.7
0°-30°	2649.2	16.0
0°-40°	4113.9	24.8
0°-60°	6517.2	39.4
0°-90°	7655.4	46.2
90°-120°	1463.7	8.8
90°-150°	6472.0	39.1
90°-180°	8905.0	53.8
0°-180°	16560.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3720	3720	3720	3720	3720	
5°	3720	3703	3659	3689	3679	353
15°	3538	3501	3386	3322	3289	997
25°	3212	3104	2882	2744	2693	1477
35°	2767	2595	2299	2087	2013	1732
45°	2262	2036	1683	1444	1363	1747
55°	1720	1458	1094	892	828	1537
65°	1161	889	586	471	461	1151
75°	619	384	269	246	242	655
85°	145	74	64	64	64	166
90°	2	26	44	55	59	16
95°	143	70	86	97	94	169
105°	668	734	134	158	167	714
115°	1264	1301	1356	338	180	1244
125°	1787	1815	1857	1873	1879	1594
135°	2211	2246	2266	2288	2284	1708
145°	2565	2563	2600	2615	2604	1604
155°	2824	2805	2831	2844	2826	1301
165°	2976	2963	2969	2985	2969	841
175°	3044	3028	3033	3048	3026	290
180°	3037	3037	3037	3037	3037	

TEST NUMBER: P906075

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3719.7	3719.7	3719.7	3719.7	3719.7
2.5°	3736.5	3719.7	3682.5	3716.5	3709.7
5°	3719.7	3702.9	3659.0	3689.3	3679.3
7.5°	3689.3	3669.3	3622.2	3635.4	3618.6
10°	3649.0	3625.4	3558.3	3547.9	3527.9
12.5°	3598.6	3568.3	3477.2	3457.2	3420.0
15°	3537.9	3500.8	3386.5	3322.5	3289.0
17.5°	3467.2	3413.3	3271.8	3197.9	3144.0
20°	3386.5	3319.0	3150.7	3066.8	2992.5
22.5°	3299.0	3221.5	3026.1	2911.8	2861.5
25°	3211.5	3103.6	2881.5	2743.6	2692.9
27.5°	3107.2	2992.5	2746.8	2588.6	2511.1
30°	2996.1	2867.9	2598.6	2427.2	2336.1
32.5°	2888.2	2733.2	2457.5	2255.4	2171.1
35°	2767.2	2595.4	2299.3	2087.2	2012.9
37.5°	2649.3	2464.0	2151.1	1918.6	1834.7
40°	2524.7	2322.9	1996.1	1757.2	1669.7
42.5°	2396.8	2181.5	1841.4	1592.2	1508.2
45°	2262.2	2036.5	1683.2	1443.9	1363.2
47.5°	2134.3	1895.4	1531.8	1292.5	1218.6
50°	1992.9	1753.9	1383.6	1151.1	1080.7
52.5°	1854.7	1602.2	1242.2	1020.0	956.1
55°	1720.0	1457.5	1093.9	892.2	828.2
57.5°	1582.2	1312.9	962.9	774.3	720.4
60°	1440.7	1171.4	824.7	653.2	599.3
62.5°	1302.9	1033.6	706.8	545.4	518.6
65°	1161.4	888.6	585.7	471.4	461.1
67.5°	1026.8	753.9	471.4	413.9	403.9
70°	885.4	622.9	390.4	356.8	343.2
72.5°	750.7	501.4	326.4	299.6	292.9
75°	619.3	383.6	269.3	245.7	242.5
77.5°	488.2	272.5	212.1	198.6	191.8
80°	366.8	195.4	161.4	148.2	148.2
82.5°	255.7	131.4	111.1	104.3	104.3
85°	144.6	73.9	63.9	63.9	63.9
87.5°	53.9	26.8	26.8	23.6	23.6
90°	2.1	26.4	43.8	55.1	59.2
92.5°	55.1	46.2	52.7	57.2	59.2
95°	142.8	70.2	85.6	96.8	94.5
97.5°	257.1	77.0	112.0	118.7	120.8
100°	389.1	88.0	125.3	142.8	147.2
102.5°	534.0	529.8	129.7	153.7	160.5
105°	668.1	734.2	134.1	158.2	167.0
107.5°	824.2	879.0	138.6	162.6	171.5
110°	973.7	1019.7	384.7	164.9	173.6

TEST NUMBER: P906075

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1114.4	1153.8	1116.5	169.1	175.9
115°	1263.7	1301.0	1356.1	338.5	180.3
117.5°	1393.4	1437.3	1474.8	1160.4	584.6
120°	1538.5	1571.4	1611.1	1637.4	1340.7
122.5°	1661.5	1696.7	1740.8	1753.8	1756.2
125°	1786.7	1815.4	1857.2	1872.6	1879.1
127.5°	1901.0	1931.8	1965.0	1986.9	1989.0
130°	2008.8	2044.1	2068.1	2092.3	2090.3
132.5°	2118.7	2147.4	2171.4	2191.3	2189.2
135°	2211.1	2246.3	2265.9	2288.1	2283.7
137.5°	2307.7	2334.0	2356.2	2378.1	2371.6
140°	2402.1	2419.9	2443.9	2463.7	2452.8
142.5°	2481.5	2496.9	2525.3	2542.8	2531.9
145°	2565.0	2562.6	2600.0	2615.4	2604.4
147.5°	2637.3	2630.8	2668.1	2679.1	2670.4
150°	2707.8	2692.4	2727.6	2740.6	2729.7
152.5°	2767.0	2749.5	2782.4	2795.7	2780.3
155°	2824.2	2804.6	2830.9	2844.0	2826.5
157.5°	2870.4	2852.9	2872.7	2888.1	2870.4
160°	2910.0	2896.7	2910.0	2923.1	2907.7
162.5°	2945.0	2931.9	2942.9	2958.3	2938.5
165°	2975.8	2962.7	2969.3	2984.7	2969.3
167.5°	3000.1	2986.8	2993.5	3008.9	2989.1
170°	3019.9	3006.6	3011.0	3026.4	3006.6
172.5°	3033.0	3019.9	3024.3	3039.7	3019.9
175°	3043.9	3028.5	3033.0	3048.3	3026.4
177.5°	3048.3	3033.0	3035.3	3050.7	3030.9
180°	3037.4	3037.4	3037.4	3037.4	3037.4

TEST NUMBER: P906075

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.26	11.06	11.26	12.06	13.39	6.23	7.03	7.22	8.03	9.36
	3H	11.94	12.66	12.95	13.67	15.01	7.41	8.13	8.42	9.14	10.49
	4H	12.55	13.23	13.57	14.24	15.60	7.86	8.54	8.88	9.55	10.91
	6H	12.97	13.59	14.00	14.61	15.98	8.18	8.81	9.21	9.83	11.19
	8H	13.10	13.69	14.13	14.73	16.09	8.27	8.87	9.31	9.90	11.26
	12H	13.16	13.72	14.20	14.75	16.14	8.32	8.88	9.36	9.91	11.30
4H	2H	10.28	10.95	11.30	11.97	13.32	6.82	7.50	7.84	8.51	9.87
	3H	12.11	12.67	13.14	13.71	15.08	8.17	8.73	9.20	9.77	11.14
	4H	12.80	13.31	13.84	14.35	15.74	8.72	9.23	9.76	10.27	11.66
	6H	13.32	13.76	14.37	14.82	16.20	9.13	9.58	10.18	10.63	12.02
	8H	13.49	13.90	14.54	14.95	16.36	9.26	9.68	10.31	10.73	12.13
	12H	13.59	13.96	14.66	15.02	16.43	9.33	9.70	10.40	10.77	12.17
8H	4H	12.76	13.18	13.82	14.23	15.63	9.00	9.41	10.05	10.46	11.86
	6H	13.33	13.67	14.41	14.77	16.17	9.51	9.85	10.59	10.95	12.35
	8H	13.55	13.85	14.63	14.93	16.35	9.71	10.00	10.79	11.08	12.50
	12H	13.69	13.95	14.78	15.03	16.49	9.82	10.09	10.91	11.16	12.62
12H	4H	12.72	13.09	13.78	14.15	15.56	9.00	9.37	10.07	10.44	11.84
	6H	13.31	13.61	14.39	14.68	16.10	9.56	9.86	10.65	10.94	12.36
	8H	13.53	13.79	14.61	14.86	16.32	9.77	10.04	10.86	11.11	12.57

END OF REPORT