

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908602

Luminaire Tested: DFN2DIP-PN4F0-040D040US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908602
REPORT IS A COMBINATION OF REPORTS P899610 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-040D040US840-RLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7008.5 lumens
Efficiency: N/A
Efficacy: 110.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 63.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908602

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US840-RLLFLL

Luminous Intensity Polar Plot

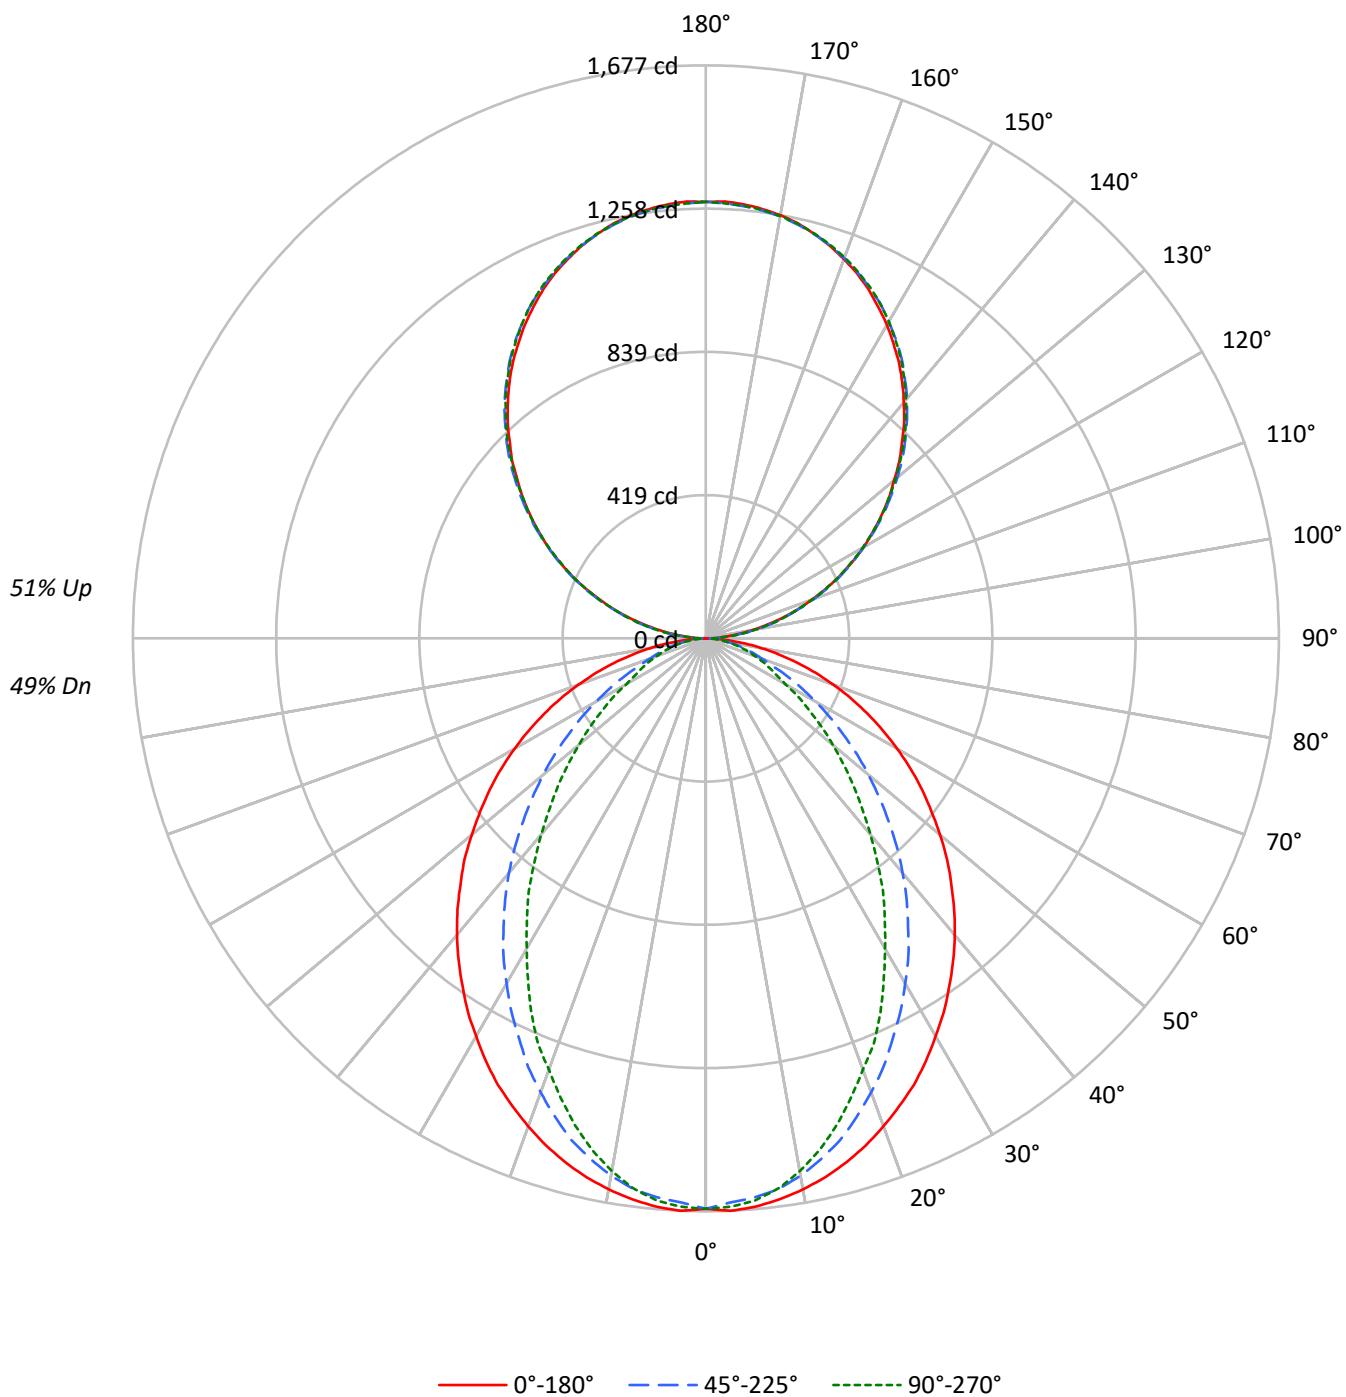

TEST NUMBER: P908602

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1219	1219	1219
5°	1221	1199	1207
10°	1209	1176	1168
15°	1192	1137	1108
20°	1170	1084	1033
25°	1147	1024	961
30°	1117	963	870
35°	1087	897	790
40°	1057	828	698
45°	1022	752	615
50°	986	676	534
55°	948	594	456
60°	904	508	375
65°	854	421	338
70°	793	340	306
75°	716	300	279
80°	605	252	243
85°	421	169	184

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1022 cd/sqm

TEST NUMBER: P908602

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US840-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	156.5	2.2
10°-20°	429.5	6.1
20°-30°	603.0	8.6
30°-40°	657.4	9.4
40°-50°	604.2	8.6
50°-60°	474.5	6.8
60°-70°	308.9	4.4
70°-80°	159.0	2.3
80°-90°	44.2	0.6
90°-100°	79.1	1.1
100°-110°	251.2	3.6
110°-120°	429.8	6.1
120°-130°	565.3	8.1
130°-140°	634.5	9.1
140°-150°	622.2	8.9
150°-160°	522.0	7.4
160°-170°	346.2	4.9
170°-180°	121.0	1.7
0°-30°	1189.0	17.0
0°-40°	1846.4	26.3
0°-60°	2925.1	41.7
0°-90°	3437.2	49.0
90°-120°	760.1	10.8
90°-150°	2582.2	36.8
90°-180°	3571.0	51.0
0°-180°	7008.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1670	1670	1670	1670	1670	
5°	1670	1662	1642	1656	1651	158
15°	1588	1571	1520	1491	1476	447
25°	1441	1393	1293	1231	1209	663
35°	1242	1165	1032	937	903	777
45°	1015	914	756	648	612	784
55°	772	654	491	400	372	690
65°	521	399	263	212	207	517
75°	278	172	121	110	109	294
85°	65	33	29	29	29	75
90°	1	14	38	35	37	7
95°	56	67	69	69	67	63
105°	232	235	237	239	239	245
115°	431	438	436	434	431	427
125°	627	637	634	630	629	561
135°	812	823	826	825	822	627
145°	985	993	999	1000	996	616
155°	1126	1130	1133	1138	1135	519
165°	1226	1224	1224	1232	1227	346
175°	1275	1272	1270	1278	1271	121
180°	1278	1278	1278	1278	1278	

TEST NUMBER: P908602

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1669.5	1669.5	1669.5	1669.5	1669.5
2.5°	1677.1	1669.5	1652.8	1668.1	1665.0
5°	1669.5	1661.9	1642.2	1655.9	1651.4
7.5°	1655.9	1646.9	1625.8	1631.6	1624.2
10°	1637.8	1627.2	1597.0	1592.4	1583.5
12.5°	1615.2	1601.5	1560.6	1551.7	1535.0
15°	1587.9	1571.2	1519.9	1491.3	1476.2
17.5°	1556.2	1532.0	1468.4	1435.3	1411.1
20°	1519.9	1489.7	1414.1	1376.4	1343.1
22.5°	1480.7	1445.9	1358.2	1306.9	1284.3
25°	1441.4	1393.0	1293.2	1231.4	1208.6
27.5°	1394.6	1343.1	1232.8	1161.9	1127.0
30°	1344.7	1287.2	1166.3	1089.3	1048.5
32.5°	1296.4	1226.8	1103.0	1012.3	974.4
35°	1242.0	1164.9	1032.0	936.8	903.4
37.5°	1189.1	1105.9	965.4	861.1	823.4
40°	1133.2	1042.6	896.0	788.7	749.4
42.5°	1075.7	979.1	826.5	714.6	676.9
45°	1015.3	914.0	755.5	648.1	611.9
47.5°	958.0	850.7	687.5	580.2	546.9
50°	894.4	787.2	621.0	516.6	485.0
52.5°	832.4	719.1	557.5	457.8	429.1
55°	772.0	654.2	491.0	400.4	371.7
57.5°	710.1	589.3	432.1	347.5	323.4
60°	646.6	525.7	370.1	293.2	269.0
62.5°	584.8	463.9	317.2	244.8	232.8
65°	521.3	398.8	262.9	211.6	206.9
67.5°	460.9	338.4	211.6	185.8	181.3
70°	397.4	279.5	175.2	160.2	154.0
72.5°	337.0	225.1	146.5	134.5	131.5
75°	277.9	172.2	120.9	110.3	108.9
77.5°	219.1	122.3	95.2	89.2	86.0
80°	164.6	87.7	72.4	66.6	66.6
82.5°	114.8	59.0	49.9	46.8	46.8
85°	64.9	33.2	28.7	28.7	28.7
87.5°	24.2	12.0	12.0	10.6	10.6
90°	1.1	13.8	37.8	35.4	36.6
92.5°	23.8	32.3	33.5	34.6	34.6
95°	56.2	67.1	69.0	69.0	67.1
97.5°	93.6	103.6	107.9	107.9	107.9
100°	136.7	145.6	148.7	148.7	147.5
102.5°	182.2	188.7	193.0	194.1	193.0
105°	231.9	234.9	237.2	239.1	239.1
107.5°	281.1	285.8	285.8	286.5	281.1
110°	328.9	335.1	335.1	335.1	332.0

TEST NUMBER: P908602

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US840-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	380.5	387.1	385.9	382.8	380.5
115°	431.3	437.6	435.6	434.4	431.3
117.5°	481.8	490.3	484.9	481.8	478.8
120°	532.7	541.1	532.7	532.7	529.2
122.5°	578.9	589.7	584.3	581.2	578.9
125°	627.4	637.0	634.0	630.5	629.3
127.5°	674.8	686.7	682.5	677.8	674.8
130°	719.0	733.0	731.0	728.7	724.5
132.5°	768.7	779.5	780.3	774.9	771.8
135°	811.5	823.4	825.8	824.6	821.5
137.5°	859.3	868.9	870.8	870.0	865.5
140°	901.2	910.9	916.3	916.3	912.0
142.5°	944.4	954.0	957.0	958.3	954.0
145°	985.2	992.9	999.1	1000.3	996.0
147.5°	1021.8	1031.4	1036.0	1037.9	1033.7
150°	1059.6	1066.1	1070.4	1073.8	1070.4
152.5°	1093.1	1099.5	1105.0	1109.2	1105.0
155°	1126.5	1129.6	1133.1	1138.5	1135.0
157.5°	1155.5	1157.7	1159.6	1167.4	1162.0
160°	1181.2	1183.6	1184.7	1191.2	1186.6
162.5°	1205.1	1205.1	1206.3	1213.6	1208.2
165°	1225.6	1224.4	1224.4	1232.0	1226.7
167.5°	1244.1	1240.5	1240.5	1248.3	1242.8
170°	1257.9	1254.8	1253.6	1261.3	1254.8
172.5°	1267.5	1264.5	1263.2	1271.0	1264.5
175°	1275.3	1272.1	1269.8	1277.5	1271.0
177.5°	1279.5	1276.4	1274.0	1280.6	1274.0
180°	1277.5	1277.5	1277.5	1277.5	1277.5

TEST NUMBER: P908602

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US840-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.75	8.57	8.72	9.55	10.84	3.71	4.54	4.69	5.52	6.81
	3H	9.43	10.16	10.41	11.16	12.46	4.90	5.64	5.89	6.63	7.94
	4H	10.04	10.73	11.04	11.73	13.05	5.35	6.05	6.35	7.04	8.36
	6H	10.46	11.10	11.47	12.10	13.43	5.68	6.32	6.68	7.31	8.64
	8H	10.59	11.20	11.60	12.21	13.54	5.77	6.37	6.78	7.39	8.72
	12H	10.65	11.23	11.67	12.24	13.59	5.81	6.39	6.83	7.40	8.75
4H	2H	7.77	8.46	8.77	9.46	10.77	4.31	5.01	5.31	6.00	7.32
	3H	9.60	10.18	10.61	11.20	12.53	5.66	6.24	6.67	7.26	8.59
	4H	10.29	10.82	11.31	11.84	13.19	6.21	6.74	7.23	7.75	9.11
	6H	10.81	11.26	11.84	12.30	13.65	6.63	7.08	7.66	8.12	9.47
	8H	10.99	11.41	12.02	12.44	13.81	6.76	7.18	7.79	8.21	9.58
	12H	11.08	11.47	12.13	12.51	13.88	6.82	7.21	7.87	8.25	9.62
8H	4H	10.26	10.68	11.29	11.72	13.08	6.49	6.91	7.52	7.95	9.31
	6H	10.83	11.18	11.88	12.25	13.62	7.01	7.36	8.06	8.43	9.80
	8H	11.05	11.35	12.11	12.41	13.80	7.20	7.51	8.26	8.57	9.95
	12H	11.19	11.46	12.25	12.51	13.94	7.32	7.59	8.39	8.65	10.07
12H	4H	10.21	10.59	11.26	11.64	13.01	6.50	6.88	7.54	7.93	9.30
	6H	10.80	11.11	11.87	12.17	13.55	7.06	7.37	8.12	8.43	9.81
	8H	11.03	11.30	12.09	12.35	13.78	7.27	7.54	8.34	8.60	10.02

END OF REPORT