

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908612

Luminaire Tested: DFN2DIP-PN4F0-040D070US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908612
REPORT IS A COMBINATION OF REPORTS P899663 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-040D070US840-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10255.2 lumens
Efficiency: N/A
Efficacy: 119.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 85.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908612

CATALOG NUMBER: DFN2DIP-PN4F0-040D070US840-FLLFLL

Luminous Intensity Polar Plot

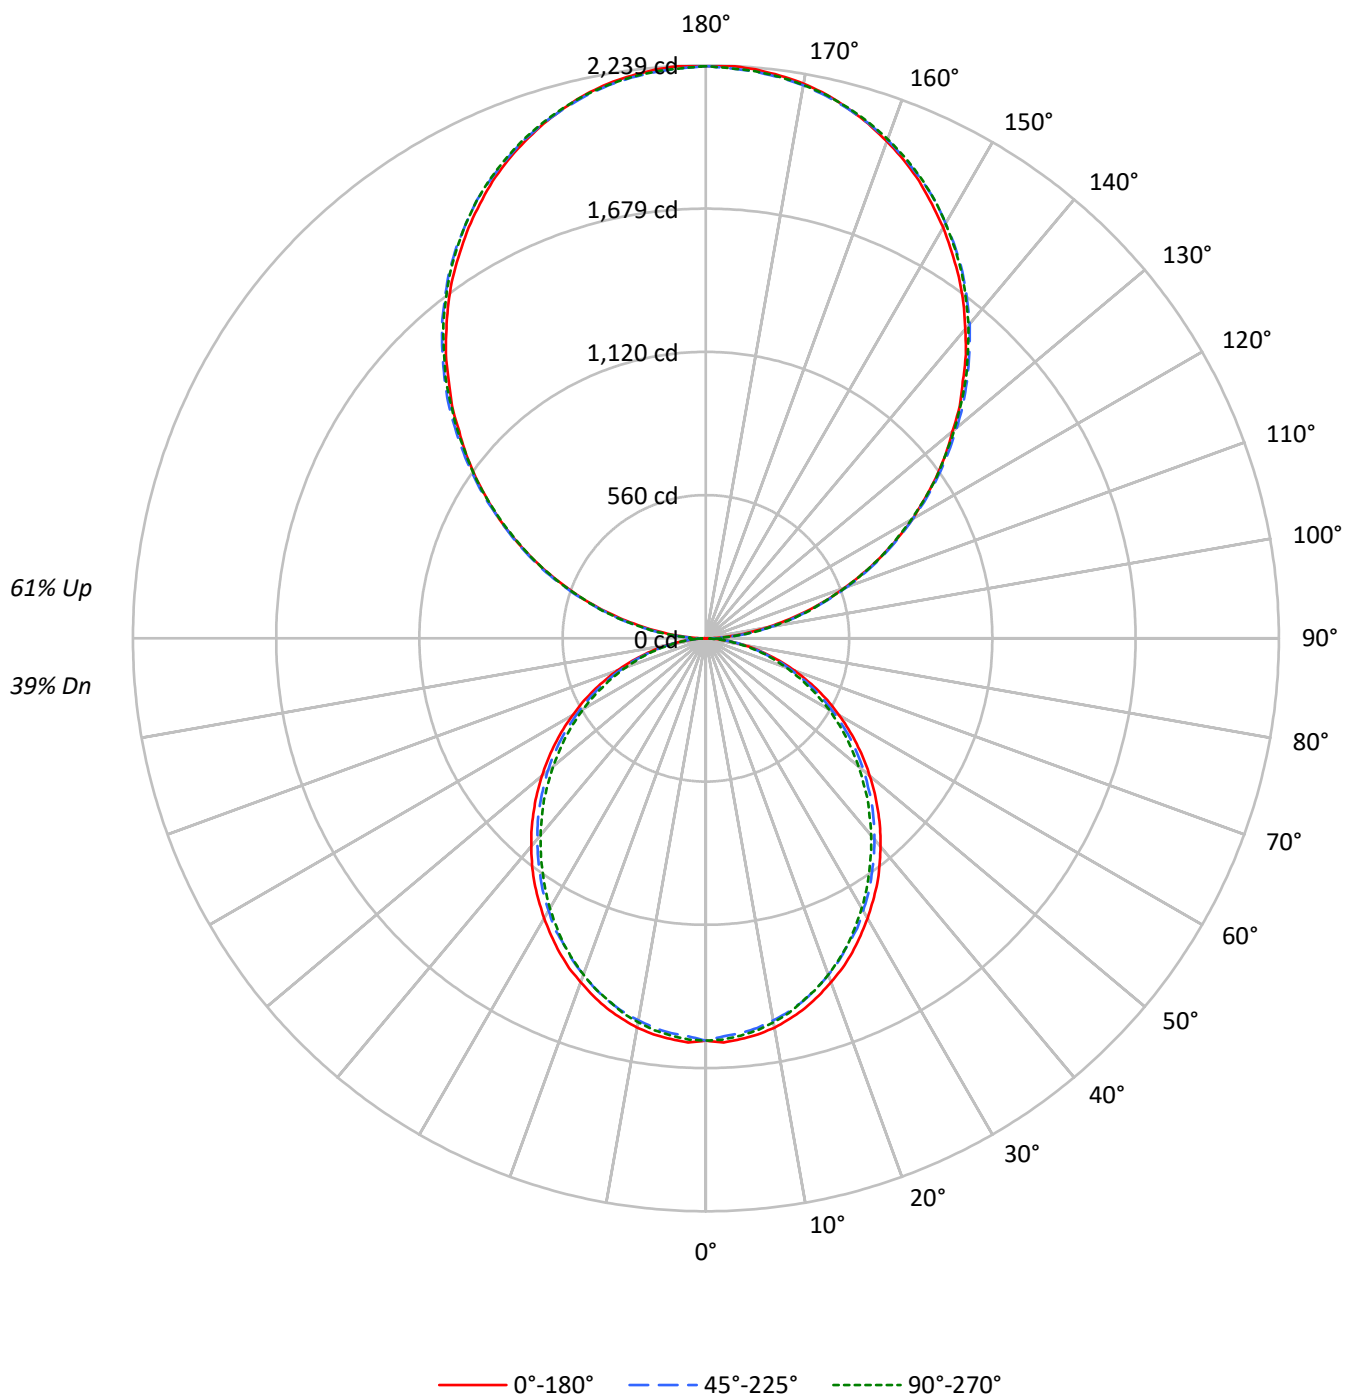

TEST NUMBER: P908612

CATALOG NUMBER: DFN2DIP-PN4F0-040D070US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	95	91	87	84	86	83	80	77	68	65	63	54	52	51	41	40	39
2	87	79	73	68	79	72	67	63	59	56	52	47	45	42	36	34	33
3	79	70	63	57	72	64	58	53	52	48	44	42	38	36	32	30	28
4	72	62	54	48	65	56	50	44	46	41	37	37	33	31	28	26	24
5	66	55	47	41	60	50	43	38	41	36	32	33	29	27	26	23	21
6	61	49	41	36	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	37	31	51	41	34	29	34	28	25	27	23	20	21	18	16
8	52	40	33	27	47	37	30	26	31	26	22	25	21	18	19	17	15
9	49	37	29	24	44	34	27	23	28	23	19	23	19	16	18	15	13
10	45	34	26	22	41	31	25	20	26	21	18	21	17	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1147	1147	1147
5°	1149	1131	1139
10°	1140	1116	1124
15°	1123	1098	1100
20°	1100	1073	1076
25°	1078	1042	1047
30°	1050	1014	1011
35°	1023	981	973
40°	990	947	937
45°	957	913	900
50°	921	878	857
55°	884	837	817
60°	841	788	772
65°	795	738	719
70°	736	677	661
75°	654	603	609
80°	556	509	508
85°	402	348	339

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1750 cd/sqm

TEST NUMBER: P908612

CATALOG NUMBER: DFN2DIP-PN4F0-040D070US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	1.4
10°-20°	416.2	4.1
20°-30°	611.7	6.0
30°-40°	710.5	6.9
40°-50°	709.6	6.9
50°-60°	618.7	6.0
60°-70°	457.4	4.5
70°-80°	258.8	2.5
80°-90°	74.6	0.7
90°-100°	138.3	1.3
100°-110°	439.6	4.3
110°-120°	752.2	7.3
120°-130°	989.3	9.6
130°-140°	1110.5	10.8
140°-150°	1088.9	10.6
150°-160°	913.5	8.9
160°-170°	605.8	5.9
170°-180°	211.7	2.1
0°-30°	1175.9	11.5
0°-40°	1886.3	18.4
0°-60°	3214.6	31.3
0°-90°	4005.4	39.1
90°-120°	1330.1	13.0
90°-150°	4518.8	44.1
90°-180°	6250.0	60.9
0°-180°	10255.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	2	24	66	62	64	10
95°	98	117	121	121	117	109
105°	406	411	415	419	419	428
115°	755	766	762	760	755	747
125°	1098	1115	1109	1103	1101	981
135°	1420	1441	1445	1443	1438	1098
145°	1724	1738	1748	1750	1743	1077
155°	1972	1977	1983	1992	1986	907
165°	2145	2143	2143	2156	2147	605
175°	2232	2226	2222	2236	2224	212
180°	2236	2236	2236	2236	2236	

TEST NUMBER: P908612

CATALOG NUMBER: DFN2DIP-PN4F0-040D070US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	2.0	24.2	66.0	62.0	64.0
92.5°	41.8	56.7	58.7	60.7	60.7
95°	98.4	117.2	120.7	120.7	117.2
97.5°	163.8	181.3	188.7	188.7	188.7
100°	239.2	254.8	260.1	260.1	258.1
102.5°	318.8	330.2	337.7	339.7	337.7
105°	405.8	411.1	415.2	418.6	418.6
107.5°	492.0	500.1	500.1	501.5	492.0
110°	575.6	586.4	586.4	586.4	581.0

TEST NUMBER: P908612

CATALOG NUMBER: DFN2DIP-PN4F0-040D070US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	665.9	677.4	675.4	669.9	665.9
115°	754.9	765.7	762.3	760.3	754.9
117.5°	843.1	858.0	848.6	843.1	837.8
120°	932.1	947.0	932.1	932.1	926.0
122.5°	1013.0	1031.9	1022.5	1017.0	1013.0
125°	1097.9	1114.8	1109.4	1103.4	1101.4
127.5°	1180.8	1201.7	1194.4	1186.3	1180.8
130°	1258.4	1282.6	1279.3	1275.3	1267.8
132.5°	1345.3	1364.2	1365.5	1356.1	1350.7
135°	1420.2	1441.0	1445.1	1443.0	1437.6
137.5°	1503.7	1520.6	1523.9	1522.6	1514.5
140°	1577.2	1594.1	1603.5	1603.5	1596.1
142.5°	1652.6	1669.5	1674.9	1676.9	1669.5
145°	1724.1	1737.6	1748.4	1750.4	1743.0
147.5°	1788.2	1805.0	1813.1	1816.4	1809.1
150°	1854.2	1865.6	1873.1	1879.2	1873.1
152.5°	1912.8	1924.3	1933.7	1941.2	1933.7
155°	1971.5	1976.8	1983.0	1992.4	1986.3
157.5°	2022.1	2026.1	2029.4	2043.0	2033.5
160°	2067.2	2071.2	2073.3	2084.7	2076.6
162.5°	2109.0	2109.0	2111.0	2123.7	2114.4
165°	2144.7	2142.6	2142.6	2156.2	2146.7
167.5°	2177.1	2171.0	2171.0	2184.4	2175.0
170°	2201.3	2196.0	2193.9	2207.4	2196.0
172.5°	2218.2	2212.7	2210.7	2224.2	2212.7
175°	2231.6	2226.2	2222.2	2235.6	2224.2
177.5°	2239.1	2233.6	2229.6	2241.1	2229.6
180°	2235.6	2235.6	2235.6	2235.6	2235.6

TEST NUMBER: P908612

CATALOG NUMBER: DFN2DIP-PN4F0-040D070US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.65	7.42	7.70	8.47	9.89	6.21	6.98	7.25	8.03	9.45
	3H	8.31	9.00	9.36	10.06	11.49	7.82	8.51	8.88	9.57	11.01
	4H	8.89	9.55	9.96	10.61	12.05	8.40	9.06	9.47	10.12	11.57
	6H	9.29	9.89	10.37	10.96	12.41	8.80	9.40	9.87	10.47	11.92
	8H	9.39	9.97	10.47	11.05	12.50	8.90	9.47	9.98	10.55	12.01
	12H	9.44	9.98	10.52	11.06	12.53	8.94	9.48	10.02	10.56	12.03
4H	2H	7.10	7.76	8.17	8.82	10.26	6.75	7.40	7.82	8.47	9.91
	3H	8.96	9.51	10.04	10.60	12.05	8.56	9.10	9.64	10.19	11.65
	4H	9.67	10.18	10.76	11.25	12.73	9.26	9.76	10.34	10.84	12.32
	6H	10.19	10.62	11.28	11.72	13.19	9.76	10.19	10.86	11.30	12.77
	8H	10.34	10.74	11.43	11.83	13.32	9.91	10.31	11.00	11.40	12.89
	12H	10.41	10.77	11.52	11.88	13.37	9.97	10.33	11.08	11.44	12.93
8H	4H	9.86	10.27	10.96	11.36	12.85	9.49	9.89	10.59	10.99	12.48
	6H	10.49	10.83	11.61	11.96	13.45	10.12	10.45	11.23	11.59	13.07
	8H	10.72	11.01	11.84	12.13	13.63	10.33	10.62	11.45	11.74	13.25
	12H	10.85	11.10	11.97	12.22	13.76	10.44	10.70	11.57	11.81	13.36
12H	4H	9.84	10.21	10.96	11.32	12.81	9.48	9.85	10.59	10.95	12.45
	6H	10.52	10.81	11.65	11.93	13.44	10.16	10.45	11.28	11.57	13.07
	8H	10.76	11.02	11.89	12.13	13.68	10.39	10.65	11.52	11.76	13.30

END OF REPORT