

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908701

Luminaire Tested: DFN2DIP-PN4F0-060D110US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908701
REPORT IS A COMBINATION OF REPORTS P901259 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D110US840-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16996.0 lumens
Efficiency: N/A
Efficacy: 116.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 146.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908701

CATALOG NUMBER: DFN2DIP-PN4F0-060D110US840-FLLONL

Luminous Intensity Polar Plot

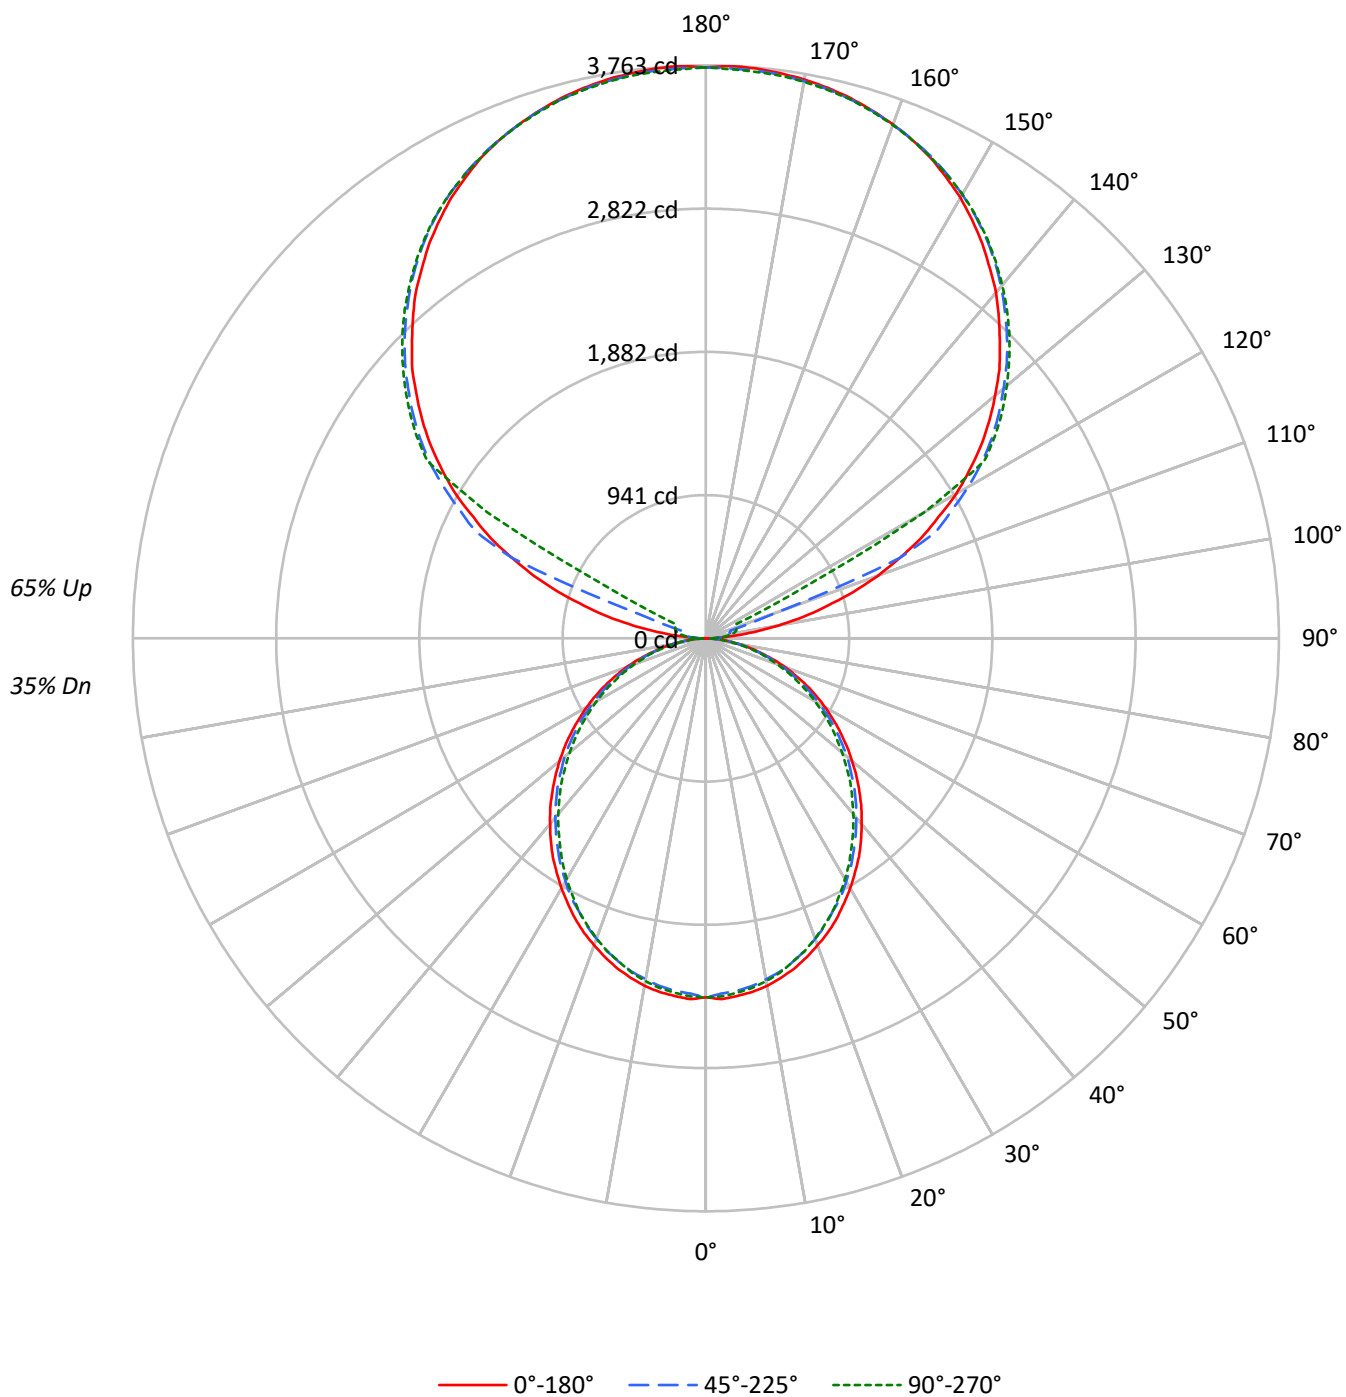

TEST NUMBER: P908701

CATALOG NUMBER: DFN2DIP-PN4F0-060D110US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	75	75	75	58	58	58	43	43	43
1	95	90	86	83	85	82	79	76	66	64	62	51	50	48	38	37	36
2	86	79	73	68	78	71	66	62	58	54	51	45	43	40	33	32	30
3	78	69	62	56	71	63	57	52	51	46	43	40	37	34	29	27	26
4	72	61	53	48	65	56	49	44	45	40	36	35	32	29	26	24	22
5	66	54	46	41	59	50	43	38	40	35	31	32	28	25	24	21	19
6	60	49	41	35	54	44	37	32	36	31	27	29	25	22	21	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	19	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	15	13
9	48	36	29	24	43	33	27	22	27	22	19	22	18	15	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	16	14	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1721	1721	1721
5°	1724	1697	1709
10°	1710	1675	1686
15°	1685	1647	1650
20°	1651	1609	1613
25°	1617	1564	1571
30°	1575	1521	1517
35°	1534	1471	1460
40°	1485	1421	1405
45°	1436	1370	1349
50°	1382	1317	1285
55°	1325	1255	1226
60°	1262	1182	1158
65°	1192	1107	1078
70°	1104	1015	992
75°	981	905	913
80°	833	764	761
85°	602	522	509

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1998 cd/sqm

TEST NUMBER: P908701

CATALOG NUMBER: DFN2DIP-PN4F0-060D110US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.3
10°-20°	624.4	3.7
20°-30°	917.5	5.4
30°-40°	1065.7	6.3
40°-50°	1064.4	6.3
50°-60°	928.1	5.5
60°-70°	686.1	4.0
70°-80°	388.2	2.3
80°-90°	109.0	0.6
90°-100°	123.6	0.7
100°-110°	460.8	2.7
110°-120°	1222.2	7.2
120°-130°	2027.1	11.9
130°-140°	2153.3	12.7
140°-150°	2001.2	11.8
150°-160°	1608.9	9.5
160°-170°	1036.7	6.1
170°-180°	356.8	2.1
0°-30°	1763.8	10.4
0°-40°	2829.5	16.6
0°-60°	4821.9	28.4
0°-90°	6005.2	35.3
90°-120°	1806.7	10.6
90°-150°	7988.3	47.0
90°-180°	10991.0	64.7
0°-180°	16996.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	3	32	54	68	73	16
95°	176	87	106	120	117	209
105°	825	906	166	195	206	881
115°	1560	1606	1674	418	223	1536
125°	2205	2241	2292	2311	2319	1967
135°	2729	2773	2797	2824	2819	2108
145°	3166	3163	3209	3228	3215	1980
155°	3486	3462	3494	3510	3489	1606
165°	3673	3657	3665	3684	3665	1038
175°	3757	3738	3744	3763	3736	358
180°	3749	3749	3749	3749	3749	

TEST NUMBER: P908701

CATALOG NUMBER: DFN2DIP-PN4F0-060D110US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	2.6	32.5	54.1	68.0	73.1
92.5°	68.0	57.1	65.0	70.6	73.1
95°	176.2	86.6	105.6	119.5	116.6
97.5°	317.3	95.0	138.1	146.5	149.2
100°	480.3	108.6	154.6	176.2	181.7
102.5°	659.0	653.9	160.1	189.8	198.1
105°	824.7	906.2	165.6	195.2	206.2
107.5°	1017.3	1084.9	171.1	200.7	211.7
110°	1201.8	1258.6	474.8	203.6	214.2



TEST NUMBER: P908701

CATALOG NUMBER: DFN2DIP-PN4F0-060D110US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1375.5	1424.1	1378.1	208.7	217.1
115°	1559.7	1605.8	1673.9	417.8	222.6
117.5°	1719.9	1774.0	1820.4	1432.2	721.5
120°	1899.0	1939.5	1988.5	2021.0	1654.8
122.5°	2050.7	2094.2	2148.6	2164.7	2167.7
125°	2205.3	2240.8	2292.3	2311.3	2319.4
127.5°	2346.4	2384.4	2425.3	2452.4	2455.0
130°	2479.4	2522.9	2552.5	2582.5	2580.0
132.5°	2615.0	2650.5	2680.2	2704.6	2702.1
135°	2729.2	2772.6	2796.7	2824.2	2818.6
137.5°	2848.3	2880.8	2908.2	2935.3	2927.2
140°	2965.0	2986.8	3016.5	3040.9	3027.4
142.5°	3062.8	3081.8	3116.9	3138.6	3125.0
145°	3165.9	3163.0	3209.0	3228.1	3214.6
147.5°	3255.2	3247.1	3293.2	3306.7	3296.1
150°	3342.2	3323.2	3366.6	3382.7	3369.2
152.5°	3415.3	3393.7	3434.2	3450.7	3431.7
155°	3485.9	3461.6	3494.1	3510.3	3488.7
157.5°	3542.8	3521.2	3545.7	3564.7	3542.8
160°	3591.8	3575.3	3591.8	3607.8	3588.9
162.5°	3634.9	3618.9	3632.4	3651.4	3626.9
165°	3673.0	3656.8	3664.9	3683.9	3664.9
167.5°	3702.9	3686.5	3694.9	3713.9	3689.4
170°	3727.4	3711.0	3716.4	3735.5	3711.0
172.5°	3743.5	3727.4	3732.9	3751.9	3727.4
175°	3757.0	3738.0	3743.5	3762.6	3735.5
177.5°	3762.6	3743.5	3746.4	3765.4	3740.9
180°	3749.0	3749.0	3749.0	3749.0	3749.0

TEST NUMBER: P908701

CATALOG NUMBER: DFN2DIP-PN4F0-060D110US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.63	8.38	8.71	9.45	10.92	7.19	7.94	8.27	9.01	10.48
	3H	9.29	9.95	10.37	11.04	12.52	8.80	9.47	9.88	10.55	12.04
	4H	9.87	10.50	10.96	11.59	13.08	9.38	10.02	10.48	11.10	12.59
	6H	10.27	10.85	11.37	11.94	13.44	9.77	10.36	10.88	11.44	12.95
	8H	10.37	10.92	11.48	12.03	13.52	9.88	10.43	10.98	11.53	13.03
	12H	10.41	10.94	11.53	12.04	13.56	9.91	10.44	11.03	11.54	13.06
4H	2H	8.08	8.71	9.18	9.80	11.29	7.73	8.36	8.83	9.44	10.94
	3H	9.94	10.46	11.05	11.58	13.08	9.54	10.06	10.64	11.17	12.68
	4H	10.65	11.13	11.76	12.24	13.76	10.23	10.72	11.34	11.82	13.34
	6H	11.16	11.58	12.28	12.70	14.22	10.74	11.15	11.86	12.28	13.79
	8H	11.31	11.70	12.43	12.81	14.35	10.88	11.27	12.00	12.38	13.92
	12H	11.38	11.73	12.51	12.86	14.40	10.94	11.29	12.07	12.42	13.96
8H	4H	10.84	11.22	11.96	12.34	13.87	10.47	10.85	11.58	11.97	13.50
	6H	11.47	11.79	12.61	12.95	14.47	11.09	11.41	12.23	12.57	14.10
	8H	11.69	11.97	12.83	13.11	14.66	11.30	11.58	12.45	12.72	14.27
	12H	11.82	12.06	12.97	13.20	14.78	11.41	11.66	12.56	12.80	14.38
12H	4H	10.82	11.17	11.95	12.30	13.83	10.45	10.81	11.59	11.93	13.47
	6H	11.50	11.78	12.64	12.91	14.46	11.13	11.41	12.28	12.55	14.10
	8H	11.73	11.98	12.88	13.12	14.70	11.36	11.61	12.51	12.74	14.33

END OF REPORT