

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908715

Luminaire Tested: DFN2DIP-PN4F0-070D050US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908715
REPORT IS A COMBINATION OF REPORTS P901154 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-070D050US840-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11007.5 lumens
Efficiency: N/A
Efficacy: 105.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 104.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908715

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US840-RLLONL

Luminous Intensity Polar Plot

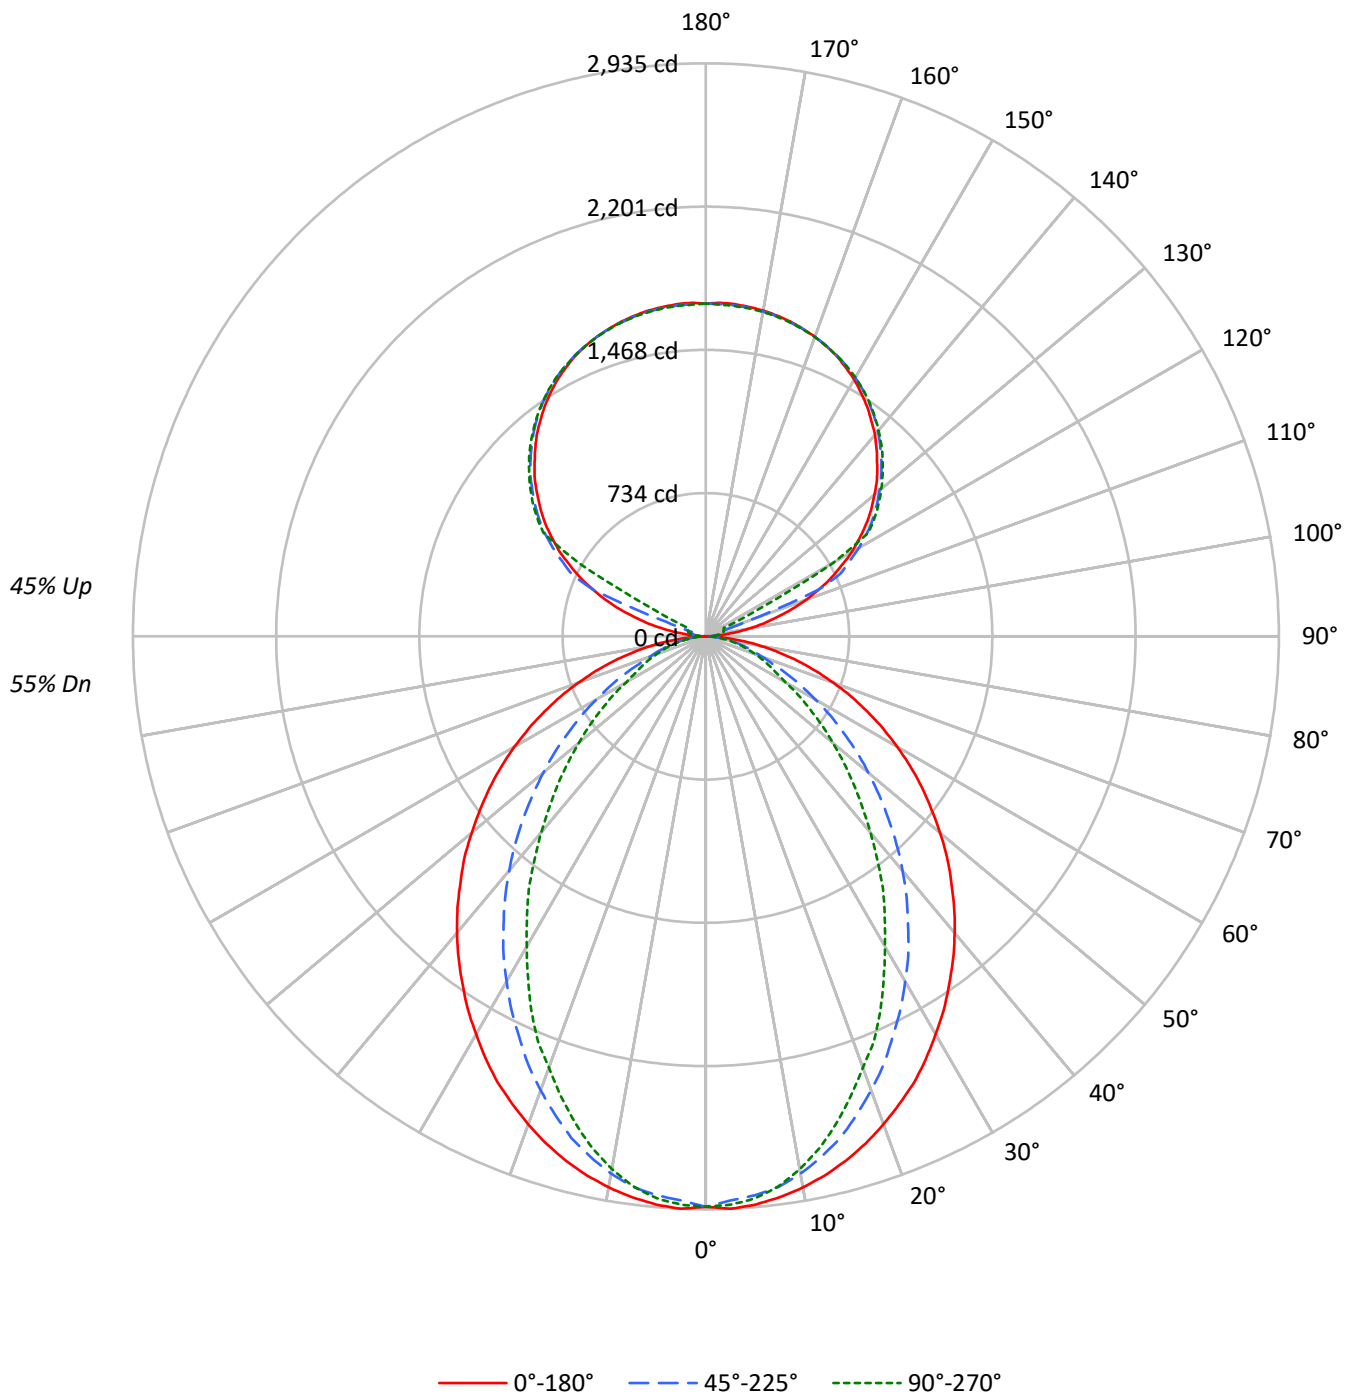

TEST NUMBER: P908715

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	95	91	88	92	89	85	82	76	74	72	65	63	62	54	53	52
2	91	84	78	73	84	78	73	69	67	63	60	57	55	52	48	46	45
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	43	41	39
4	76	66	58	52	71	62	55	50	54	48	44	46	42	39	39	36	34
5	70	59	51	45	65	55	48	43	48	43	38	42	37	34	35	32	30
6	65	53	45	40	60	50	43	38	44	38	34	38	33	30	32	29	26
7	60	48	40	35	56	45	38	33	40	34	30	35	30	27	30	26	24
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21
9	52	40	33	28	49	38	31	27	34	28	24	29	25	22	25	22	19
10	49	37	30	25	46	35	28	24	31	26	22	27	23	20	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2133	2133	2133
5°	2136	2099	2113
10°	2115	2058	2044
15°	2086	1990	1938
20°	2047	1897	1808
25°	2008	1792	1683
30°	1955	1684	1523
35°	1903	1569	1383
40°	1850	1449	1222
45°	1789	1316	1077
50°	1725	1182	934
55°	1659	1039	798
60°	1583	889	657
65°	1494	737	592
70°	1387	594	536
75°	1253	524	489
80°	1059	441	425
85°	737	296	322

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1789 cd/sqm

TEST NUMBER: P908715

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	273.8	2.5
10°-20°	751.7	6.8
20°-30°	1055.3	9.6
30°-40°	1150.4	10.5
40°-50°	1057.3	9.6
50°-60°	830.4	7.5
60°-70°	540.5	4.9
70°-80°	278.2	2.5
80°-90°	74.0	0.7
90°-100°	56.2	0.5
100°-110°	209.5	1.9
110°-120°	555.6	5.0
120°-130°	921.4	8.4
130°-140°	978.8	8.9
140°-150°	909.7	8.3
150°-160°	731.3	6.6
160°-170°	471.2	4.3
170°-180°	162.2	1.5
0°-30°	2080.9	18.9
0°-40°	3231.2	29.4
0°-60°	5118.9	46.5
0°-90°	6011.6	54.6
90°-120°	821.2	7.5
90°-150°	3631.1	33.0
90°-180°	4996.0	45.4
0°-180°	11007.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2922	2922	2922	2922	2922	
5°	2922	2908	2874	2898	2890	277
15°	2779	2750	2660	2610	2583	783
25°	2522	2438	2263	2155	2115	1160
35°	2173	2038	1806	1639	1581	1360
45°	1777	1600	1322	1134	1071	1372
55°	1351	1145	859	701	651	1207
65°	912	698	460	370	362	904
75°	486	301	212	193	190	515
85°	114	58	50	50	50	130
90°	1	15	25	31	33	10
95°	80	39	48	54	53	95
105°	375	412	75	89	94	401
115°	709	730	761	190	101	698
125°	1002	1019	1042	1051	1054	894
135°	1240	1260	1271	1284	1281	958
145°	1439	1438	1459	1467	1461	900
155°	1584	1574	1588	1596	1586	730
165°	1670	1662	1666	1674	1666	472
175°	1708	1699	1702	1710	1698	163
180°	1704	1704	1704	1704	1704	

TEST NUMBER: P908715

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2921.6	2921.6	2921.6	2921.6	2921.6
2.5°	2934.8	2921.6	2892.5	2919.1	2913.8
5°	2921.6	2908.4	2874.0	2897.8	2889.9
7.5°	2897.8	2882.1	2845.1	2855.4	2842.3
10°	2866.1	2847.6	2794.8	2786.7	2771.0
12.5°	2826.5	2802.7	2731.2	2715.4	2686.2
15°	2778.8	2749.7	2659.9	2609.7	2583.3
17.5°	2723.3	2681.0	2569.9	2511.7	2469.4
20°	2659.9	2606.9	2474.8	2408.8	2350.5
22.5°	2591.2	2530.3	2376.8	2287.0	2247.6
25°	2522.4	2437.7	2263.2	2155.0	2115.2
27.5°	2440.5	2350.5	2157.5	2033.3	1972.4
30°	2353.3	2252.6	2041.0	1906.4	1834.9
32.5°	2268.6	2146.9	1930.3	1771.5	1705.3
35°	2173.4	2038.5	1806.0	1639.4	1581.0
37.5°	2080.9	1935.3	1689.6	1506.9	1441.1
40°	1983.0	1824.5	1567.8	1380.2	1311.4
42.5°	1882.6	1713.4	1446.3	1250.5	1184.7
45°	1776.9	1599.5	1322.1	1134.2	1070.8
47.5°	1676.4	1488.7	1203.2	1015.2	957.2
50°	1565.3	1377.7	1086.7	904.1	848.9
52.5°	1456.7	1258.4	975.6	801.1	750.9
55°	1351.0	1144.8	859.2	700.7	650.6
57.5°	1242.7	1031.2	756.3	608.1	565.8
60°	1131.7	920.1	647.7	513.1	470.7
62.5°	1023.3	811.8	555.1	428.4	407.3
65°	912.2	697.9	460.1	370.3	362.1
67.5°	806.5	592.2	370.3	325.1	317.3
70°	695.4	489.2	306.6	280.2	269.5
72.5°	589.7	393.8	256.4	235.4	230.0
75°	486.5	301.2	211.5	193.0	190.5
77.5°	383.4	214.0	166.6	155.9	150.7
80°	288.1	153.4	126.8	116.4	116.4
82.5°	200.9	103.2	87.3	81.9	81.9
85°	113.6	58.1	50.2	50.2	50.2
87.5°	42.3	21.0	21.0	18.5	18.5
90°	1.2	14.7	24.6	30.9	33.2
92.5°	30.9	26.0	29.6	32.1	33.2
95°	80.1	39.4	48.1	54.3	53.0
97.5°	144.2	43.2	62.8	66.7	67.8
100°	218.3	49.4	70.3	80.1	82.6
102.5°	299.6	297.2	72.8	86.2	90.1
105°	374.9	411.9	75.2	88.8	93.7
107.5°	462.4	493.1	77.8	91.2	96.2
110°	546.3	572.1	215.8	92.5	97.4



TEST NUMBER: P908715

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	625.2	647.3	626.4	94.9	98.7
115°	709.0	729.9	760.8	190.0	101.2
117.5°	781.7	806.4	827.5	651.0	328.0
120°	863.1	881.6	903.8	918.7	752.1
122.5°	932.1	951.9	976.6	984.0	985.3
125°	1002.4	1018.6	1042.0	1050.6	1054.3
127.5°	1066.5	1083.8	1102.5	1114.7	1115.9
130°	1127.0	1146.8	1160.2	1173.9	1172.8
132.5°	1188.7	1204.8	1218.2	1229.4	1228.2
135°	1240.5	1260.3	1271.2	1283.7	1281.2
137.5°	1294.6	1309.5	1321.9	1334.2	1330.6
140°	1347.7	1357.7	1371.1	1382.2	1376.1
142.5°	1392.2	1400.9	1416.8	1426.6	1420.5
145°	1439.1	1437.7	1458.6	1467.3	1461.2
147.5°	1479.7	1475.9	1496.9	1503.1	1498.2
150°	1519.1	1510.6	1530.2	1537.6	1531.5
152.5°	1552.4	1542.6	1561.1	1568.5	1559.8
155°	1584.5	1573.5	1588.2	1595.6	1585.8
157.5°	1610.3	1600.5	1611.6	1620.3	1610.3
160°	1632.6	1625.2	1632.6	1639.9	1631.3
162.5°	1652.2	1645.0	1651.0	1659.7	1648.6
165°	1669.5	1662.2	1665.9	1674.5	1665.9
167.5°	1683.1	1675.7	1679.5	1688.1	1677.0
170°	1694.3	1686.8	1689.3	1697.9	1686.8
172.5°	1701.6	1694.3	1696.8	1705.4	1694.3
175°	1707.8	1699.1	1701.6	1710.2	1697.9
177.5°	1710.2	1701.6	1702.9	1711.5	1700.4
180°	1704.0	1704.0	1704.0	1704.0	1704.0

TEST NUMBER: P908715

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.21	11.08	11.13	12.01	13.22	6.17	7.04	7.09	7.98	9.18
	3H	11.89	12.67	12.83	13.61	14.84	7.36	8.14	8.30	9.09	10.32
	4H	12.50	13.24	13.45	14.19	15.43	7.82	8.55	8.77	9.50	10.74
	6H	12.93	13.60	13.89	14.56	15.81	8.14	8.82	9.10	9.77	11.02
	8H	13.06	13.70	14.02	14.67	15.92	8.23	8.87	9.20	9.85	11.10
	12H	13.12	13.73	14.09	14.70	15.97	8.28	8.89	9.25	9.86	11.13
4H	2H	10.23	10.96	11.19	11.91	13.15	6.77	7.51	7.73	8.46	9.70
	3H	12.07	12.68	13.03	13.66	14.91	8.13	8.74	9.09	9.72	10.97
	4H	12.76	13.32	13.74	14.29	15.57	8.68	9.23	9.65	10.21	11.49
	6H	13.28	13.76	14.27	14.76	16.04	9.10	9.58	10.09	10.58	11.85
	8H	13.46	13.91	14.45	14.90	16.19	9.23	9.68	10.22	10.67	11.96
	12H	13.56	13.96	14.56	14.97	16.26	9.30	9.70	10.30	10.71	12.00
8H	4H	12.73	13.18	13.72	14.17	15.46	8.96	9.41	9.95	10.40	11.69
	6H	13.30	13.67	14.32	14.71	15.99	9.48	9.85	10.50	10.89	12.18
	8H	13.52	13.85	14.54	14.87	16.18	9.68	10.00	10.70	11.02	12.33
	12H	13.66	13.95	14.69	14.96	16.32	9.80	10.08	10.82	11.10	12.45
12H	4H	12.69	13.09	13.69	14.10	15.39	8.97	9.37	9.98	10.38	11.68
	6H	13.28	13.60	14.30	14.62	15.93	9.53	9.86	10.55	10.88	12.19
	8H	13.50	13.79	14.53	14.80	16.16	9.75	10.03	10.77	11.05	12.40

END OF REPORT