

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908805

Luminaire Tested: DFN2DIP-PN4F0-090D100US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908805
REPORT IS A COMBINATION OF REPORTS P901247 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-090D100US840-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18995.6 lumens
Efficiency: N/A
Efficacy: 116.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 163.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908805

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US840-FLLONL

Luminous Intensity Polar Plot

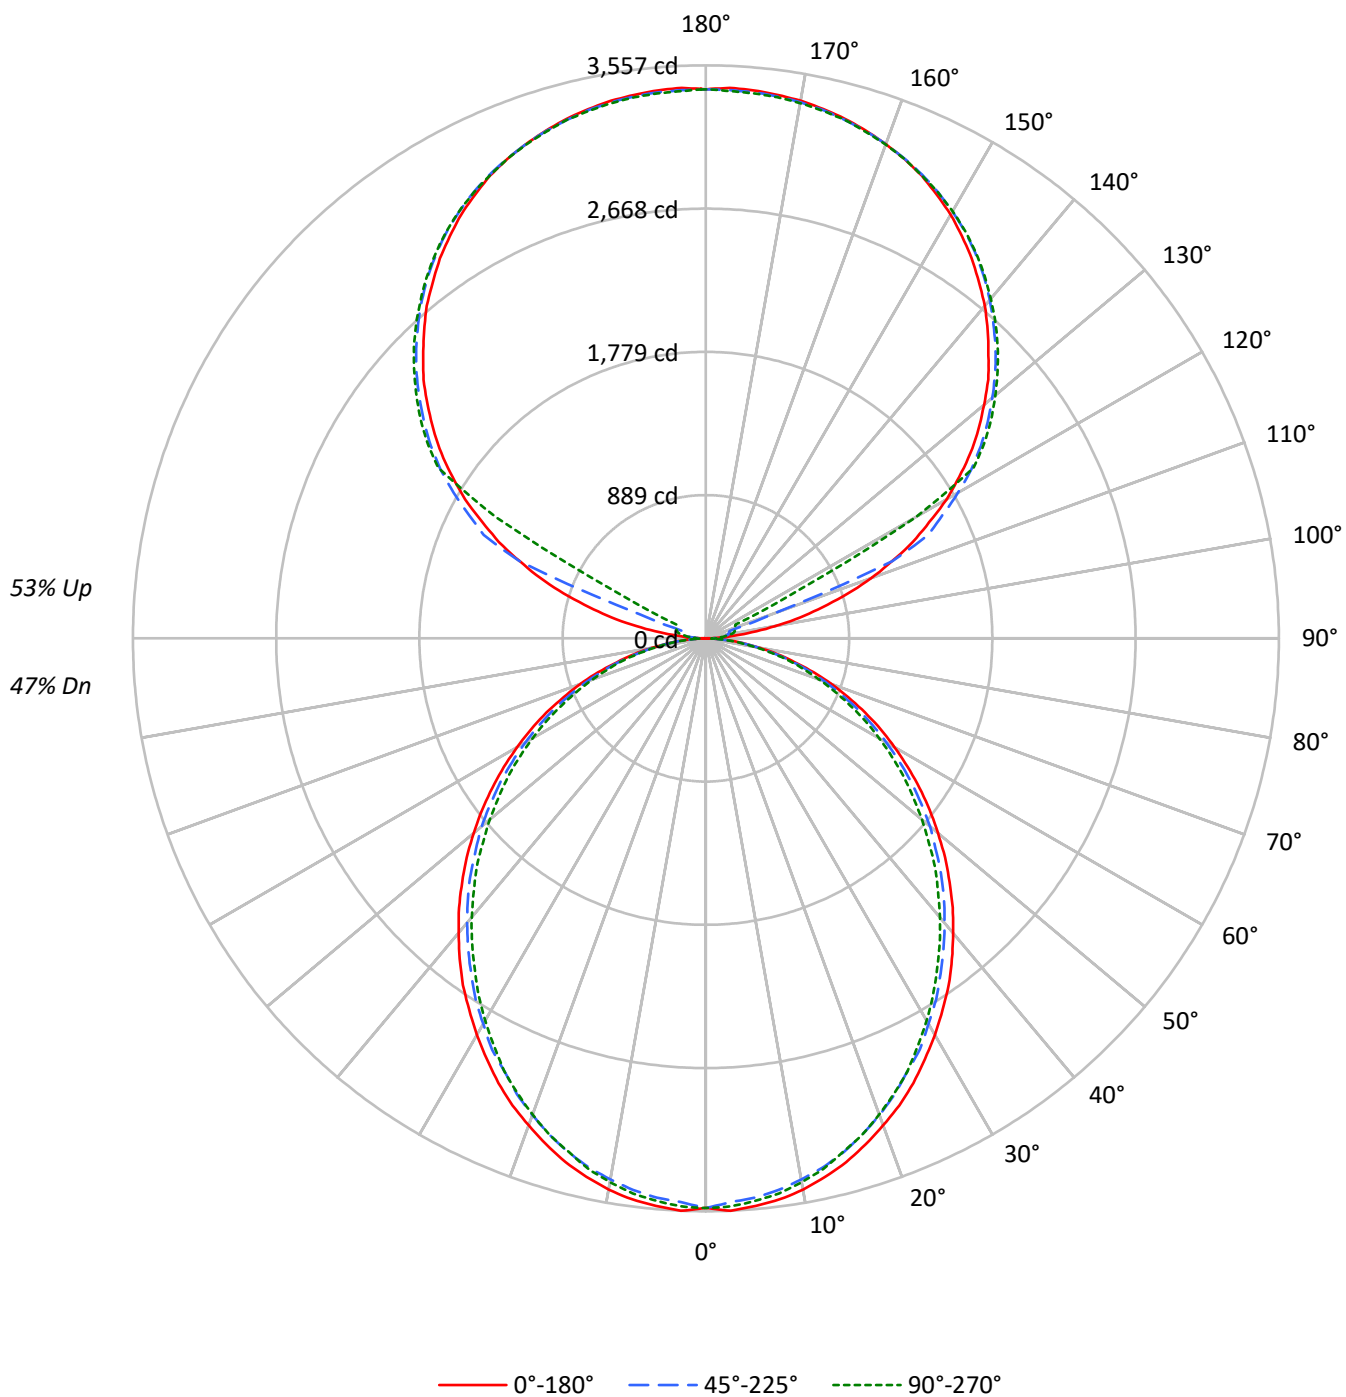

TEST NUMBER: P908805

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	67	67	67	54	54	54
1	97	93	89	86	89	86	82	79	72	69	67	59	57	56	47	46	45
2	89	81	75	70	81	75	70	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	59	54	55	51	47	46	42	40	37	35	33
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	40	44	39	34	37	33	29	30	27	24
6	62	50	42	37	57	47	40	34	40	34	30	33	29	26	27	24	22
7	58	45	38	32	53	42	35	30	36	30	26	30	26	23	25	22	19
8	54	41	34	28	49	38	31	27	33	27	23	28	23	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	15
10	47	35	27	23	43	32	26	21	28	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2581	2581	2581
5°	2586	2546	2563
10°	2565	2512	2529
15°	2527	2471	2475
20°	2476	2414	2420
25°	2425	2345	2356
30°	2362	2282	2275
35°	2302	2207	2189
40°	2227	2131	2108
45°	2154	2055	2024
50°	2073	1975	1927
55°	1988	1883	1839
60°	1892	1773	1737
65°	1788	1660	1617
70°	1655	1522	1488
75°	1472	1357	1370
80°	1250	1146	1142
85°	904	783	764

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2154 cd/sqm

TEST NUMBER: P908805

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	332.9	1.8
10°-20°	936.5	4.9
20°-30°	1376.3	7.2
30°-40°	1598.5	8.4
40°-50°	1596.5	8.4
50°-60°	1392.1	7.3
60°-70°	1029.1	5.4
70°-80°	582.2	3.1
80°-90°	159.7	0.8
90°-100°	112.4	0.6
100°-110°	418.9	2.2
110°-120°	1111.1	5.8
120°-130°	1842.9	9.7
130°-140°	1957.5	10.3
140°-150°	1819.3	9.6
150°-160°	1462.7	7.7
160°-170°	942.5	5.0
170°-180°	324.4	1.7
0°-30°	2645.7	13.9
0°-40°	4244.2	22.3
0°-60°	7232.9	38.1
0°-90°	9003.9	47.4
90°-120°	1642.4	8.6
90°-150°	7262.1	38.2
90°-180°	9992.0	52.6
0°-180°	18995.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3536	3536	3536	3536	3536	
5°	3536	3523	3486	3513	3506	336
15°	3367	3346	3302	3316	3299	948
25°	3047	3020	2962	2969	2962	1402
35°	2629	2595	2540	2520	2503	1642
45°	2139	2115	2064	2027	2013	1651
55°	1619	1598	1558	1517	1500	1447
65°	1092	1071	1037	1007	990	1079
75°	571	565	547	527	534	610
85°	139	136	133	122	119	155
90°	2	30	49	62	66	17
95°	160	79	96	109	106	190
105°	750	824	151	177	187	801
115°	1418	1460	1522	380	202	1396
125°	2005	2037	2084	2101	2108	1788
135°	2481	2520	2542	2567	2562	1916
145°	2878	2876	2917	2935	2922	1800
155°	3169	3147	3176	3191	3172	1460
165°	3339	3324	3332	3349	3332	943
175°	3416	3398	3403	3420	3396	325
180°	3408	3408	3408	3408	3408	

TEST NUMBER: P908805

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3536.4	3536.4	3536.4	3536.4	3536.4
2.5°	3557.0	3540.1	3502.6	3536.4	3530.0
5°	3536.4	3523.1	3485.7	3512.7	3506.2
7.5°	3512.7	3492.5	3455.0	3482.4	3475.6
10°	3475.6	3451.7	3410.9	3438.0	3427.9
12.5°	3424.3	3404.1	3363.4	3380.2	3373.5
15°	3366.6	3346.4	3302.0	3315.7	3298.7
17.5°	3295.1	3274.9	3230.6	3247.5	3230.6
20°	3216.8	3196.6	3149.0	3159.1	3145.7
22.5°	3138.9	3108.3	3063.8	3063.8	3057.0
25°	3046.9	3019.8	2962.1	2968.6	2962.1
27.5°	2944.8	2920.9	2877.0	2866.9	2849.9
30°	2843.1	2815.6	2764.7	2754.6	2741.0
32.5°	2734.1	2713.9	2659.4	2638.9	2625.1
35°	2628.8	2594.8	2540.3	2519.8	2502.9
37.5°	2509.7	2479.0	2424.5	2400.8	2383.8
40°	2387.3	2360.0	2305.4	2275.1	2261.5
42.5°	2268.3	2240.9	2186.8	2152.5	2132.3
45°	2139.1	2115.4	2064.1	2026.9	2013.3
47.5°	2013.3	1989.4	1934.9	1897.4	1877.2
50°	1880.5	1863.5	1815.8	1768.3	1751.3
52.5°	1751.3	1727.5	1683.4	1646.0	1622.1
55°	1618.9	1598.3	1557.5	1516.8	1499.9
57.5°	1486.1	1469.2	1424.8	1384.0	1370.3
60°	1353.3	1340.0	1292.3	1254.9	1244.8
62.5°	1224.2	1200.3	1166.4	1132.6	1118.8
65°	1091.8	1071.2	1037.2	1006.6	989.7
67.5°	955.7	938.5	908.1	884.3	870.6
70°	829.8	816.1	785.5	761.6	748.3
72.5°	700.6	686.9	669.9	646.2	636.1
75°	571.2	564.6	547.3	527.1	534.0
77.5°	455.7	442.0	435.2	425.1	415.0
80°	340.2	336.6	329.7	319.6	312.9
82.5°	231.3	231.3	228.0	214.3	214.3
85°	139.3	136.0	132.8	122.3	119.1
87.5°	61.3	54.4	47.7	37.6	33.9
90°	2.3	29.6	49.2	61.8	66.4
92.5°	61.8	51.8	59.2	64.1	66.4
95°	160.2	78.8	96.0	108.7	106.0
97.5°	288.4	86.3	125.6	133.2	135.6
100°	436.7	98.7	140.6	160.2	165.2
102.5°	599.2	594.5	145.5	172.5	180.1
105°	749.7	823.7	150.6	177.4	187.4
107.5°	924.8	986.3	155.5	182.5	192.4
110°	1092.6	1144.2	431.6	185.1	194.7



TEST NUMBER: P908805

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1250.4	1294.6	1252.8	189.8	197.4
115°	1418.0	1459.9	1521.7	379.8	202.4
117.5°	1563.5	1612.8	1654.9	1302.0	656.0
120°	1726.4	1763.2	1807.8	1837.3	1504.4
122.5°	1864.3	1903.8	1953.3	1967.9	1970.6
125°	2004.9	2037.1	2084.0	2101.2	2108.5
127.5°	2133.1	2167.7	2204.8	2229.5	2231.8
130°	2254.0	2293.6	2320.6	2347.7	2345.4
132.5°	2377.3	2409.5	2436.5	2458.7	2456.4
135°	2481.0	2520.5	2542.5	2567.4	2562.4
137.5°	2589.4	2619.0	2643.8	2668.5	2661.1
140°	2695.3	2715.3	2742.2	2764.5	2752.2
142.5°	2784.4	2801.7	2833.6	2853.2	2841.0
145°	2878.1	2875.5	2917.4	2934.7	2922.3
147.5°	2959.2	2951.9	2993.7	3006.1	2996.5
150°	3038.3	3021.0	3060.6	3075.2	3062.9
152.5°	3104.7	3085.1	3122.1	3136.9	3119.7
155°	3169.0	3146.9	3176.5	3191.2	3171.6
157.5°	3220.8	3201.2	3223.4	3240.7	3220.8
160°	3265.3	3250.4	3265.3	3279.9	3262.7
162.5°	3304.5	3289.8	3302.2	3319.4	3297.2
165°	3339.0	3324.4	3331.7	3349.0	3331.7
167.5°	3366.3	3351.3	3359.0	3376.3	3354.0
170°	3388.5	3373.7	3378.6	3395.9	3373.7
172.5°	3403.1	3388.5	3393.6	3410.8	3388.5
175°	3415.5	3398.2	3403.1	3420.5	3395.9
177.5°	3420.5	3403.1	3405.9	3423.1	3400.8
180°	3408.2	3408.2	3408.2	3408.2	3408.2

TEST NUMBER: P908805

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.33	11.17	11.31	12.16	13.47	9.89	10.73	10.87	11.72	13.03
	3H	11.99	12.74	12.98	13.74	15.07	11.51	12.26	12.50	13.26	14.59
	4H	12.58	13.29	13.58	14.30	15.63	12.09	12.80	13.09	13.81	15.15
	6H	12.98	13.64	13.99	14.64	15.99	12.49	13.14	13.50	14.15	15.50
	8H	13.08	13.71	14.10	14.74	16.08	12.59	13.22	13.61	14.24	15.59
	12H	13.13	13.73	14.16	14.75	16.12	12.63	13.23	13.66	14.25	15.62
4H	2H	10.79	11.50	11.80	12.50	13.84	10.44	11.15	11.45	12.15	13.49
	3H	12.65	13.25	13.67	14.28	15.63	12.25	12.85	13.27	13.88	15.23
	4H	13.37	13.91	14.40	14.94	16.31	12.95	13.50	13.98	14.52	15.90
	6H	13.89	14.35	14.92	15.40	16.77	13.46	13.93	14.50	14.98	16.35
	8H	14.04	14.47	15.07	15.52	16.90	13.61	14.05	14.65	15.09	16.47
	12H	14.11	14.51	15.17	15.56	16.95	13.67	14.07	14.73	15.12	16.51
8H	4H	13.56	14.00	14.60	15.04	16.43	13.19	13.63	14.23	14.67	16.06
	6H	14.20	14.56	15.26	15.64	17.03	13.82	14.18	14.88	15.27	16.65
	8H	14.42	14.74	15.49	15.81	17.21	14.04	14.35	15.11	15.42	16.82
	12H	14.55	14.83	15.63	15.90	17.34	14.15	14.43	15.22	15.49	16.94
12H	4H	13.55	13.94	14.61	15.00	16.39	13.19	13.58	14.24	14.64	16.03
	6H	14.23	14.55	15.30	15.61	17.02	13.86	14.18	14.93	15.25	16.65
	8H	14.47	14.75	15.54	15.81	17.26	14.10	14.38	15.17	15.44	16.89

END OF REPORT