

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908824

Luminaire Tested: DFN2DIP-PN4F0-100D060US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908824
REPORT IS A COMBINATION OF REPORTS P899657 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-100D060US840-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15360.1 lumens
Efficiency: N/A
Efficacy: 105.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 146.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908824

CATALOG NUMBER: DFN2DIP-PN4F0-100D060US840-FLLFLL

Luminous Intensity Polar Plot

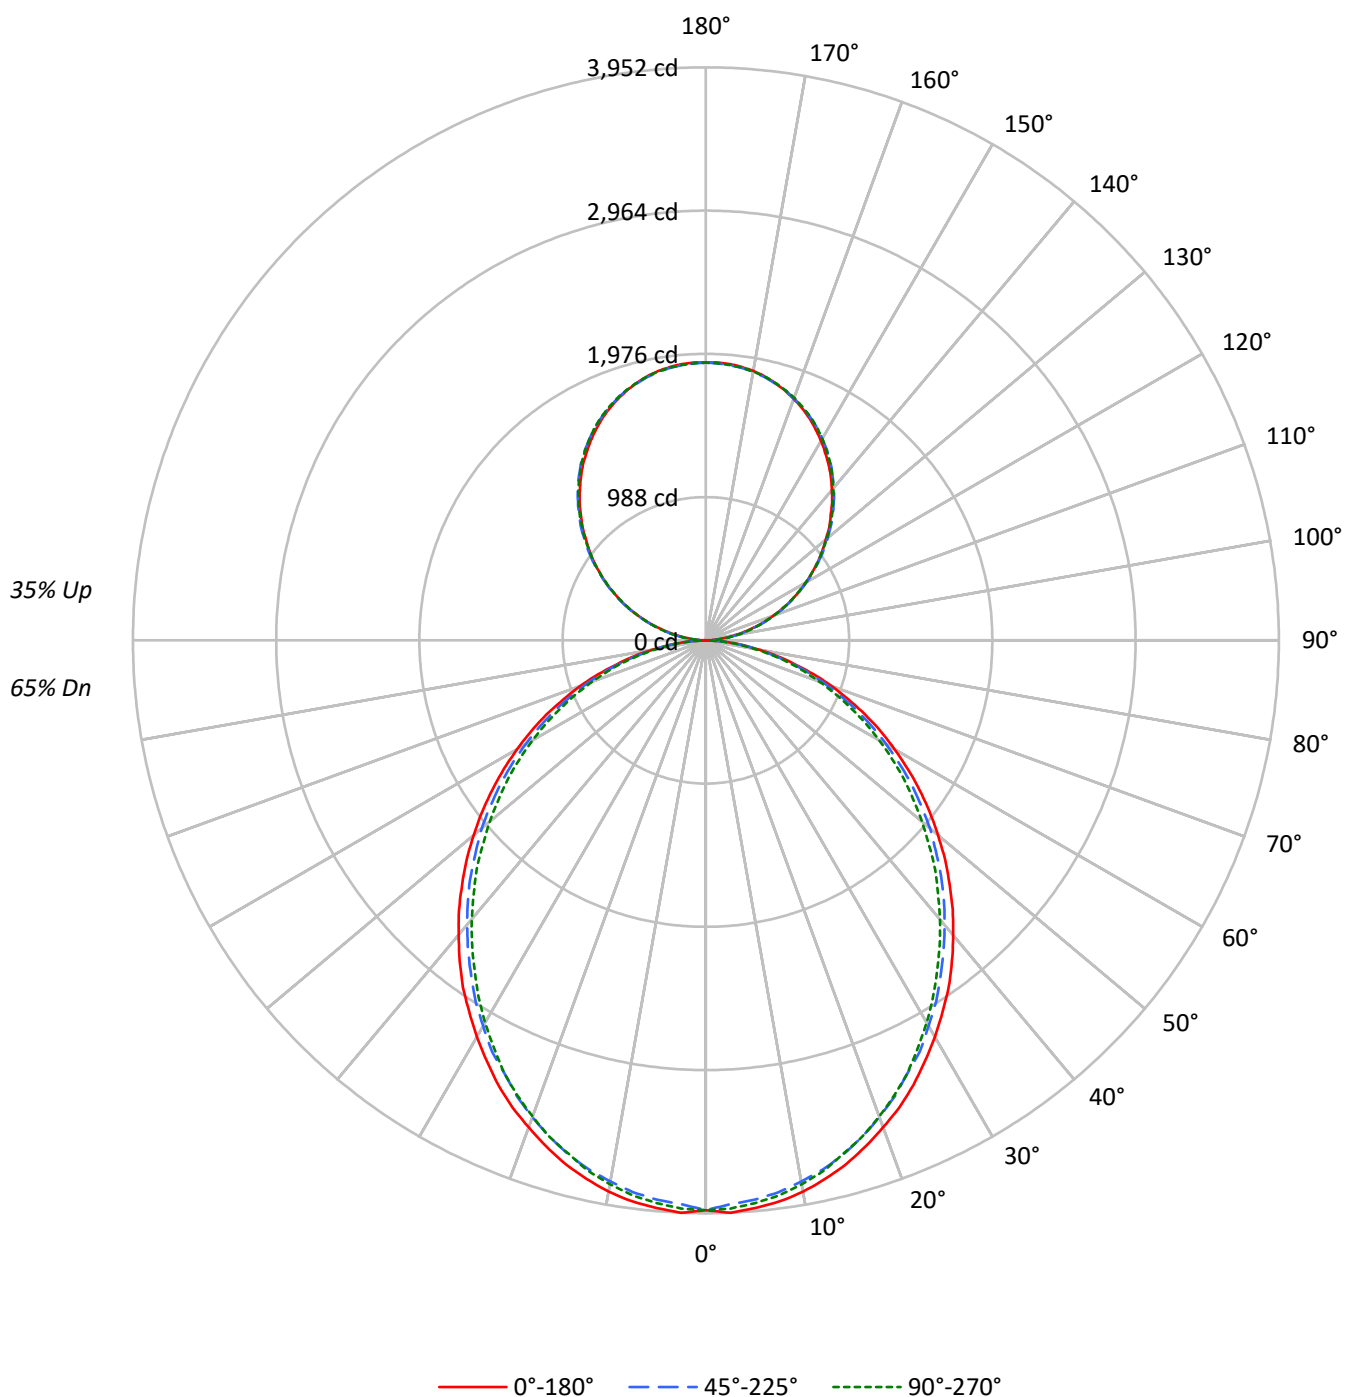

TEST NUMBER: P908824

CATALOG NUMBER: DFN2DIP-PN4F0-100D060US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	80	80	80	70	70	70
1	101	97	93	89	95	91	88	84	81	78	75	71	69	67	62	60	59
2	92	85	78	73	86	80	74	69	71	66	63	62	59	56	55	52	50
3	84	74	67	61	79	70	63	58	62	57	53	55	51	47	48	45	42
4	77	66	58	52	72	62	55	49	55	50	45	49	44	41	43	40	37
5	71	59	50	44	66	56	48	42	50	44	39	44	39	35	39	35	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	35	31	28
7	60	48	40	34	57	45	38	33	41	35	30	36	31	28	32	28	25
8	56	44	36	30	53	41	34	29	37	31	27	33	28	25	30	26	22
9	52	40	32	27	49	38	31	26	34	28	24	31	26	22	27	23	20
10	49	37	29	24	46	35	28	23	32	26	22	28	24	20	25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2868	2868	2868
5°	2873	2829	2848
10°	2850	2791	2810
15°	2808	2745	2750
20°	2751	2682	2689
25°	2695	2606	2618
30°	2624	2535	2528
35°	2557	2452	2433
40°	2475	2368	2342
45°	2393	2283	2249
50°	2303	2195	2142
55°	2209	2092	2043
60°	2103	1971	1930
65°	1987	1845	1796
70°	1839	1691	1653
75°	1635	1508	1522
80°	1389	1274	1269
85°	1004	869	849

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2393 cd/sqm

TEST NUMBER: P908824

CATALOG NUMBER: DFN2DIP-PN4F0-100D060US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	369.8	2.4
10°-20°	1040.6	6.8
20°-30°	1529.3	10.0
30°-40°	1776.1	11.6
40°-50°	1773.9	11.5
50°-60°	1546.8	10.1
60°-70°	1143.4	7.4
70°-80°	646.9	4.2
80°-90°	176.2	1.1
90°-100°	118.6	0.8
100°-110°	376.8	2.5
110°-120°	644.8	4.2
120°-130°	848.0	5.5
130°-140°	951.8	6.2
140°-150°	933.4	6.1
150°-160°	783.0	5.1
160°-170°	519.2	3.4
170°-180°	181.5	1.2
0°-30°	2939.7	19.1
0°-40°	4715.8	30.7
0°-60°	8036.5	52.3
0°-90°	10003.1	65.1
90°-120°	1140.1	7.4
90°-150°	3873.3	25.2
90°-180°	5357.0	34.9
0°-180°	15360.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3930	3930	3930	3930	3930	
5°	3930	3915	3873	3903	3896	373
15°	3741	3718	3669	3684	3665	1054
25°	3386	3355	3291	3298	3291	1558
35°	2921	2883	2823	2800	2781	1824
45°	2377	2350	2293	2252	2237	1834
55°	1799	1776	1731	1685	1666	1608
65°	1213	1190	1153	1118	1100	1199
75°	635	627	608	586	593	677
85°	155	151	148	136	132	173
90°	2	21	57	53	55	15
95°	84	100	103	103	100	94
105°	348	352	356	359	359	367
115°	647	656	653	652	647	640
125°	941	956	951	946	944	841
135°	1217	1235	1239	1237	1232	941
145°	1478	1489	1499	1500	1494	923
155°	1690	1694	1700	1708	1702	778
165°	1838	1836	1836	1848	1840	519
175°	1913	1908	1905	1916	1906	182
180°	1916	1916	1916	1916	1916	

TEST NUMBER: P908824

CATALOG NUMBER: DFN2DIP-PN4F0-100D060US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3929.5	3929.5	3929.5	3929.5	3929.5
2.5°	3952.3	3933.4	3891.7	3929.5	3922.2
5°	3929.5	3914.6	3872.9	3903.0	3895.8
7.5°	3903.0	3880.5	3838.8	3869.3	3861.7
10°	3861.7	3835.3	3789.9	3820.0	3808.8
12.5°	3804.8	3782.4	3737.0	3755.9	3748.2
15°	3740.6	3718.2	3668.8	3684.1	3665.3
17.5°	3661.3	3638.8	3589.5	3608.4	3589.5
20°	3574.2	3551.8	3498.9	3510.1	3495.2
22.5°	3487.7	3453.6	3404.3	3404.3	3396.7
25°	3385.5	3355.4	3291.3	3298.4	3291.3
27.5°	3272.0	3245.5	3196.6	3185.4	3166.5
30°	3159.0	3128.5	3071.9	3060.7	3045.5
32.5°	3037.9	3015.5	2954.9	2932.0	2916.8
35°	2920.8	2883.2	2822.6	2799.8	2780.9
37.5°	2788.5	2754.4	2693.9	2667.5	2648.6
40°	2652.6	2622.1	2561.6	2528.0	2512.7
42.5°	2520.3	2489.8	2429.7	2391.7	2369.2
45°	2376.8	2350.4	2293.4	2252.1	2237.0
47.5°	2237.0	2210.5	2149.9	2108.2	2085.8
50°	2089.4	2070.5	2017.6	1964.7	1945.9
52.5°	1945.9	1919.5	1870.5	1828.9	1802.4
55°	1798.8	1775.9	1730.6	1685.3	1666.5
57.5°	1651.2	1632.3	1583.1	1537.8	1522.6
60°	1503.7	1488.8	1435.9	1394.2	1383.0
62.5°	1360.2	1333.7	1296.1	1258.4	1243.1
65°	1213.1	1190.2	1152.6	1118.4	1099.6
67.5°	1062.0	1042.7	1009.1	982.6	967.4
70°	922.0	906.8	872.7	846.3	831.4
72.5°	778.5	763.3	744.5	718.0	706.7
75°	634.6	627.4	608.1	585.7	593.3
77.5°	506.3	491.1	483.4	472.2	461.0
80°	378.0	374.1	366.4	355.2	347.6
82.5°	257.0	257.0	253.4	238.1	238.1
85°	154.7	151.2	147.5	135.9	132.3
87.5°	68.2	60.5	52.9	41.7	37.7
90°	1.7	20.8	56.7	53.1	54.8
92.5°	35.9	48.6	50.3	52.0	52.0
95°	84.3	100.5	103.4	103.4	100.5
97.5°	140.4	155.4	161.8	161.8	161.8
100°	205.1	218.3	223.0	223.0	221.3
102.5°	273.3	283.1	289.4	291.1	289.4
105°	347.8	352.4	355.9	358.8	358.8
107.5°	421.7	428.7	428.7	429.8	421.7
110°	493.4	502.6	502.6	502.6	498.0

TEST NUMBER: P908824

CATALOG NUMBER: DFN2DIP-PN4F0-100D060US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	570.8	580.6	578.9	574.2	570.8
115°	647.0	656.3	653.4	651.7	647.0
117.5°	722.8	735.5	727.3	722.8	718.1
120°	799.0	811.7	799.0	799.0	793.8
122.5°	868.3	884.4	876.4	871.8	868.3
125°	941.1	955.5	950.9	945.7	944.0
127.5°	1012.2	1030.1	1023.7	1016.8	1012.2
130°	1078.6	1099.4	1096.5	1093.1	1086.7
132.5°	1153.2	1169.3	1170.4	1162.4	1157.7
135°	1217.3	1235.2	1238.6	1236.9	1232.2
137.5°	1288.9	1303.3	1306.3	1305.0	1298.2
140°	1351.9	1366.3	1374.4	1374.4	1368.1
142.5°	1416.5	1431.0	1435.6	1437.3	1431.0
145°	1477.8	1489.3	1498.6	1500.4	1494.0
147.5°	1532.7	1547.1	1554.1	1556.9	1550.5
150°	1589.3	1599.1	1605.5	1610.6	1605.5
152.5°	1639.5	1649.4	1657.5	1663.9	1657.5
155°	1689.8	1694.5	1699.6	1707.8	1702.5
157.5°	1733.1	1736.7	1739.5	1751.1	1743.0
160°	1771.9	1775.3	1777.1	1786.9	1780.0
162.5°	1807.7	1807.7	1809.4	1820.4	1812.3
165°	1838.3	1836.5	1836.5	1848.2	1840.1
167.5°	1866.0	1860.9	1860.9	1872.4	1864.3
170°	1886.8	1882.2	1880.5	1892.0	1882.2
172.5°	1901.3	1896.6	1894.9	1906.4	1896.6
175°	1912.8	1908.2	1904.7	1916.3	1906.4
177.5°	1919.1	1914.6	1911.1	1920.9	1911.1
180°	1916.3	1916.3	1916.3	1916.3	1916.3

TEST NUMBER: P908824

CATALOG NUMBER: DFN2DIP-PN4F0-100D060US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.23	13.24	13.04	14.08	15.12	11.79	12.80	12.60	13.64	14.68
	3H	13.90	14.82	14.73	15.66	16.73	13.42	14.33	14.25	15.18	16.24
	4H	14.50	15.36	15.34	16.22	17.29	14.01	14.87	14.86	15.73	16.81
	6H	14.91	15.71	15.77	16.57	17.66	14.42	15.21	15.28	16.08	17.17
	8H	15.02	15.78	15.89	16.66	17.75	14.53	15.29	15.39	16.17	17.26
	12H	15.08	15.80	15.95	16.67	17.79	14.58	15.30	15.45	16.17	17.29
4H	2H	12.71	13.57	13.56	14.43	15.50	12.36	13.22	13.21	14.07	15.15
	3H	14.59	15.31	15.45	16.20	17.29	14.19	14.91	15.05	15.80	16.89
	4H	15.31	15.97	16.19	16.86	17.97	14.90	15.55	15.77	16.44	17.56
	6H	15.84	16.41	16.73	17.32	18.44	15.42	15.98	16.31	16.89	18.01
	8H	16.00	16.53	16.89	17.43	18.56	15.57	16.10	16.46	17.00	18.14
	12H	16.08	16.56	16.99	17.48	18.62	15.64	16.12	16.55	17.04	18.18
8H	4H	15.52	16.05	16.42	16.96	18.09	15.15	15.68	16.04	16.59	17.72
	6H	16.17	16.60	17.08	17.55	18.68	15.79	16.23	16.71	17.17	18.31
	8H	16.39	16.78	17.32	17.72	18.87	16.00	16.39	16.93	17.33	18.48
	12H	16.53	16.87	17.46	17.80	19.00	16.13	16.47	17.06	17.40	18.60
12H	4H	15.52	15.99	16.43	16.92	18.06	15.15	15.63	16.07	16.55	17.69
	6H	16.20	16.59	17.13	17.52	18.67	15.83	16.22	16.76	17.16	18.31
	8H	16.45	16.79	17.38	17.72	18.92	16.08	16.42	17.01	17.35	18.55

END OF REPORT