

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908909

Luminaire Tested: DFN2DIP-PN4F0-120D090US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908909
REPORT IS A COMBINATION OF REPORTS P901235 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-120D090US840-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 20995.1 lumens
Efficiency: N/A
Efficacy: 108.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 192.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908909

CATALOG NUMBER: DFN2DIP-PN4F0-120D090US840-FLLONL

Luminous Intensity Polar Plot

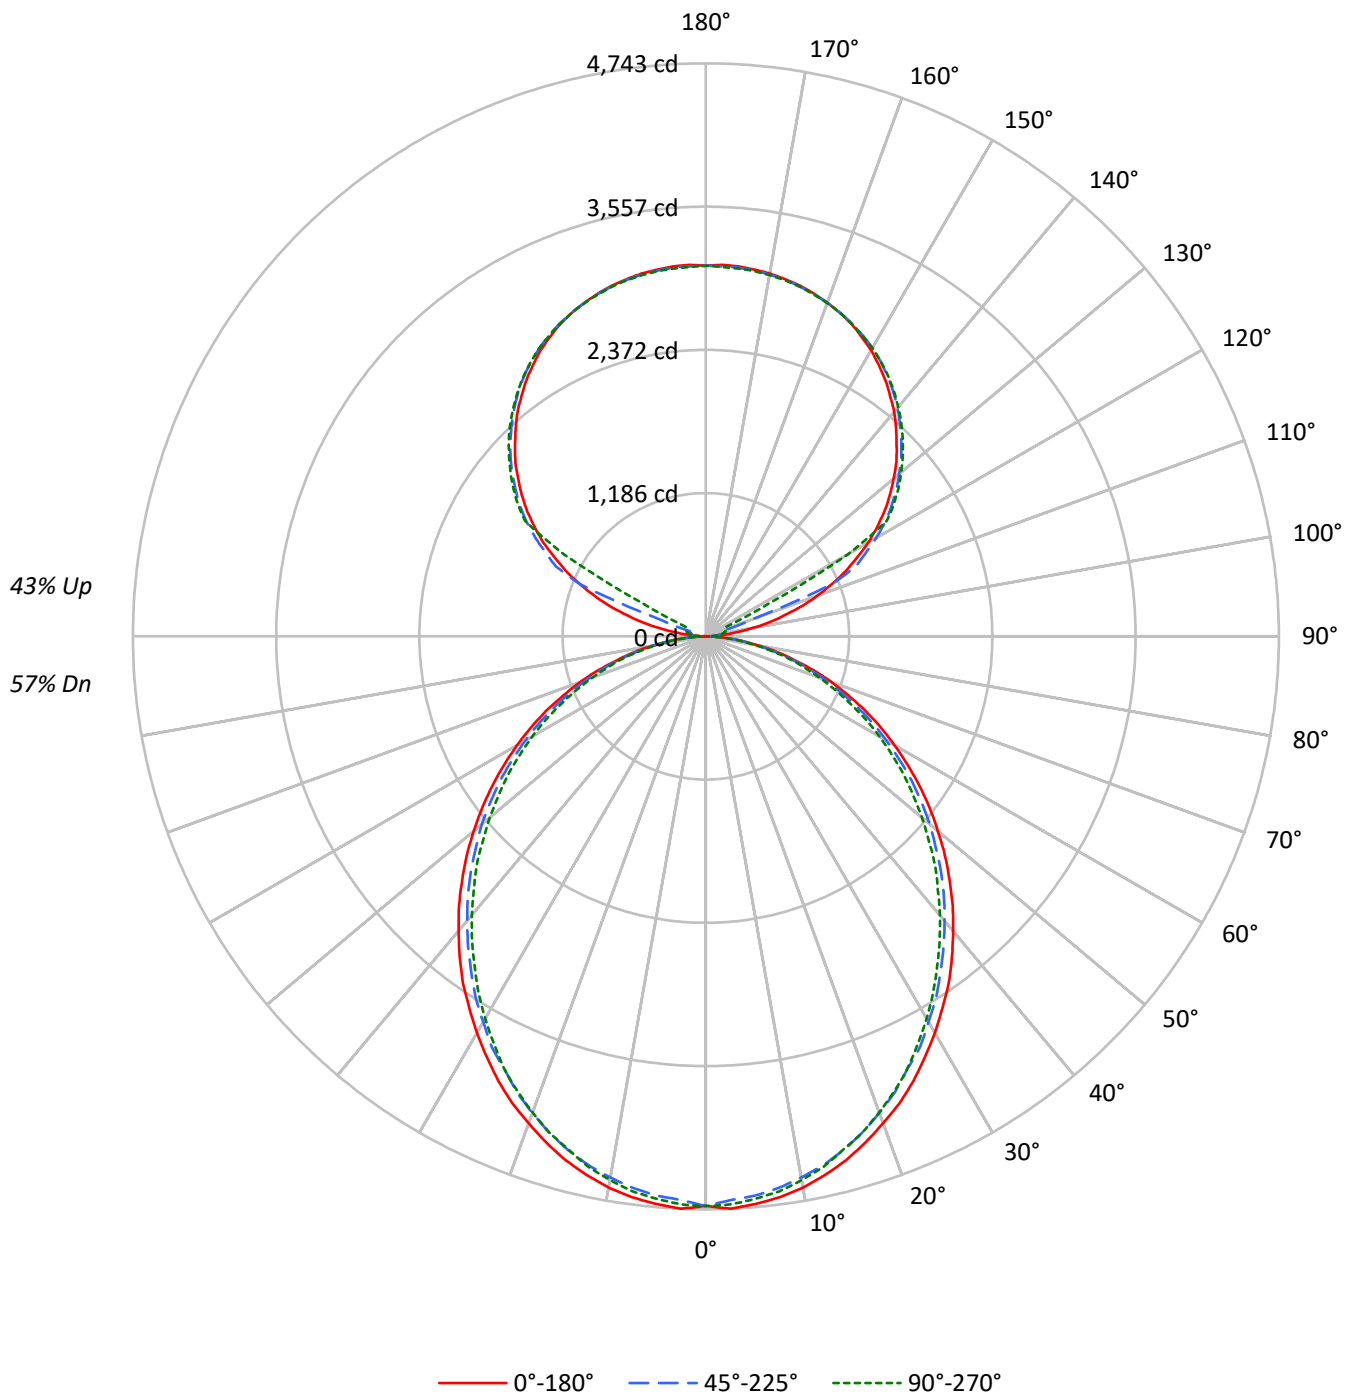

TEST NUMBER: P908909

CATALOG NUMBER: DFN2DIP-PN4F0-120D090US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	55	54	53
2	91	83	77	72	84	77	72	67	67	63	59	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	40	38
4	76	65	57	50	70	61	53	48	53	47	43	45	41	38	39	35	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	32	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	22	30	24	20	26	22	18	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3442	3442	3442
5°	3448	3394	3418
10°	3420	3349	3372
15°	3369	3295	3300
20°	3301	3218	3227
25°	3234	3127	3142
30°	3149	3042	3034
35°	3069	2942	2919
40°	2970	2841	2810
45°	2871	2740	2699
50°	2764	2634	2570
55°	2651	2511	2451
60°	2523	2365	2316
65°	2384	2214	2156
70°	2207	2030	1984
75°	1962	1809	1826
80°	1667	1529	1523
85°	1205	1043	1019

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2871 cd/sqm

TEST NUMBER: P908909

CATALOG NUMBER: DFN2DIP-PN4F0-120D090US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	443.8	2.1
10°-20°	1248.7	5.9
20°-30°	1835.1	8.7
30°-40°	2131.4	10.2
40°-50°	2128.7	10.1
50°-60°	1856.2	8.8
60°-70°	1372.1	6.5
70°-80°	776.3	3.7
80°-90°	210.3	1.0
90°-100°	101.2	0.5
100°-110°	377.0	1.8
110°-120°	1000.0	4.8
120°-130°	1658.6	7.9
130°-140°	1761.8	8.4
140°-150°	1637.4	7.8
150°-160°	1316.4	6.3
160°-170°	848.2	4.0
170°-180°	292.0	1.4
0°-30°	3527.6	16.8
0°-40°	5659.0	27.0
0°-60°	9643.8	45.9
0°-90°	12002.6	57.2
90°-120°	1478.2	7.0
90°-150°	6535.9	31.1
90°-180°	8992.0	42.8
0°-180°	20995.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4715	4715	4715	4715	4715	
5°	4715	4698	4648	4684	4675	448
15°	4489	4462	4403	4421	4398	1264
25°	4062	4026	3950	3958	3950	1869
35°	3505	3460	3387	3360	3337	2189
45°	2852	2820	2752	2703	2684	2201
55°	2158	2131	2077	2022	2000	1930
65°	1456	1428	1383	1342	1320	1439
75°	762	753	730	703	712	813
85°	186	181	177	163	159	207
90°	2	27	44	56	60	19
95°	144	71	86	98	95	171
105°	675	741	135	160	169	721
115°	1276	1314	1370	342	182	1256
125°	1804	1833	1876	1891	1898	1609
135°	2233	2268	2288	2311	2306	1725
145°	2590	2588	2626	2641	2630	1620
155°	2852	2832	2859	2872	2854	1314
165°	3005	2992	2999	3014	2999	849
175°	3074	3058	3063	3078	3056	293
180°	3067	3067	3067	3067	3067	

TEST NUMBER: P908909

CATALOG NUMBER: DFN2DIP-PN4F0-120D090US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4715.4	4715.4	4715.4	4715.4	4715.4
2.5°	4742.7	4720.1	4670.1	4715.4	4706.7
5°	4715.4	4697.5	4647.5	4683.6	4674.9
7.5°	4683.6	4656.6	4606.6	4643.2	4634.1
10°	4634.1	4602.3	4547.9	4584.0	4570.6
12.5°	4565.7	4538.7	4484.4	4507.0	4497.8
15°	4488.8	4461.8	4402.6	4420.9	4398.3
17.5°	4393.5	4366.6	4307.4	4330.0	4307.4
20°	4289.1	4262.1	4198.7	4212.1	4194.4
22.5°	4185.2	4144.3	4085.1	4085.1	4076.0
25°	4062.5	4026.4	3949.5	3958.2	3949.5
27.5°	3926.4	3894.6	3836.0	3822.4	3799.9
30°	3790.7	3754.2	3686.3	3672.9	3654.6
32.5°	3645.4	3618.6	3545.8	3518.5	3500.2
35°	3504.9	3459.8	3387.1	3359.7	3337.1
37.5°	3346.2	3305.4	3232.7	3201.0	3178.3
40°	3183.2	3146.6	3073.9	3033.5	3015.3
42.5°	3024.4	2987.9	2915.7	2870.0	2843.1
45°	2852.2	2820.5	2752.1	2702.6	2684.3
47.5°	2684.3	2652.5	2579.9	2529.9	2503.0
50°	2507.3	2484.7	2421.2	2357.6	2335.0
52.5°	2335.0	2303.3	2244.6	2194.5	2162.8
55°	2158.5	2131.1	2076.7	2022.4	1999.7
57.5°	1981.5	1958.8	1899.7	1845.3	1827.0
60°	1804.4	1786.7	1723.1	1673.1	1659.6
62.5°	1632.2	1600.4	1555.3	1510.1	1491.8
65°	1455.7	1428.3	1383.0	1342.1	1319.6
67.5°	1274.3	1251.2	1210.8	1179.1	1160.8
70°	1106.4	1088.1	1047.2	1015.5	997.7
72.5°	934.2	915.9	893.3	861.6	848.1
75°	761.5	752.9	729.7	702.9	712.0
77.5°	607.5	589.3	580.2	566.6	553.2
80°	453.6	448.8	439.7	426.3	417.1
82.5°	308.3	308.3	304.1	285.8	285.8
85°	185.7	181.4	177.0	163.1	158.8
87.5°	81.8	72.6	63.5	50.0	45.2
90°	2.1	26.7	44.2	55.6	59.8
92.5°	55.6	46.7	53.2	57.8	59.8
95°	144.2	70.9	86.4	97.8	95.4
97.5°	259.6	77.8	113.1	119.9	122.0
100°	392.9	88.9	126.5	144.2	148.7
102.5°	539.3	535.0	131.0	155.2	162.1
105°	674.7	741.4	135.4	159.8	168.6
107.5°	832.3	887.7	140.0	164.2	173.2
110°	983.3	1029.8	388.5	166.5	175.3

TEST NUMBER: P908909

CATALOG NUMBER: DFN2DIP-PN4F0-120D090US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1125.4	1165.2	1127.5	170.8	177.6
115°	1276.2	1313.8	1369.5	341.8	182.1
117.5°	1407.1	1451.5	1489.3	1171.8	590.4
120°	1553.7	1586.9	1627.0	1653.6	1353.9
122.5°	1677.9	1713.4	1758.0	1771.1	1773.5
125°	1804.3	1833.3	1875.5	1891.1	1897.6
127.5°	1919.8	1950.9	1984.4	2006.5	2008.6
130°	2028.6	2064.3	2088.5	2112.9	2110.9
132.5°	2139.6	2168.6	2192.8	2212.9	2210.8
135°	2232.9	2268.5	2288.3	2310.7	2306.2
137.5°	2330.5	2357.0	2379.4	2401.6	2395.0
140°	2425.8	2443.8	2468.0	2488.0	2477.0
142.5°	2506.0	2521.5	2550.2	2567.9	2556.9
145°	2590.3	2587.9	2625.7	2641.2	2630.1
147.5°	2663.3	2656.8	2694.4	2705.5	2696.7
150°	2734.5	2719.0	2754.5	2767.6	2756.6
152.5°	2794.3	2776.6	2809.8	2823.3	2807.7
155°	2852.1	2832.3	2858.8	2872.1	2854.4
157.5°	2898.7	2881.0	2901.0	2916.6	2898.7
160°	2938.7	2925.3	2938.7	2951.9	2936.4
162.5°	2974.1	2960.8	2971.9	2987.5	2967.5
165°	3005.2	2991.9	2998.6	3014.1	2998.6
167.5°	3029.7	3016.3	3023.0	3038.6	3018.6
170°	3049.7	3036.3	3040.7	3056.3	3036.3
172.5°	3062.9	3049.7	3054.1	3069.7	3049.7
175°	3073.9	3058.4	3062.9	3078.4	3056.3
177.5°	3078.4	3062.9	3065.2	3080.8	3060.8
180°	3067.4	3067.4	3067.4	3067.4	3067.4

TEST NUMBER: P908909

CATALOG NUMBER: DFN2DIP-PN4F0-120D090US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.21	13.14	13.10	14.05	15.22	11.77	12.70	12.66	13.61	14.78
	3H	13.88	14.71	14.78	15.64	16.83	13.39	14.23	14.30	15.15	16.34
	4H	14.47	15.26	15.39	16.19	17.39	13.98	14.77	14.90	15.70	16.90
	6H	14.88	15.60	15.81	16.54	17.75	14.39	15.11	15.32	16.05	17.26
	8H	14.98	15.68	15.92	16.63	17.84	14.49	15.18	15.43	16.14	17.35
	12H	15.04	15.70	15.98	16.64	17.88	14.54	15.20	15.48	16.14	17.38
4H	2H	12.68	13.47	13.61	14.40	15.60	12.33	13.12	13.25	14.05	15.24
	3H	14.56	15.21	15.49	16.17	17.39	14.15	14.81	15.09	15.77	16.98
	4H	15.27	15.88	16.22	16.83	18.07	14.86	15.46	15.80	16.41	17.65
	6H	15.80	16.32	16.76	17.29	18.53	15.37	15.89	16.33	16.87	18.11
	8H	15.95	16.43	16.91	17.40	18.66	15.52	16.01	16.48	16.98	18.23
	12H	16.03	16.46	17.01	17.45	18.71	15.59	16.02	16.57	17.01	18.27
8H	4H	15.48	15.96	16.44	16.93	18.19	15.11	15.59	16.07	16.56	17.81
	6H	16.11	16.52	17.10	17.53	18.78	15.74	16.14	16.73	17.15	18.40
	8H	16.34	16.69	17.33	17.69	18.96	15.95	16.31	16.95	17.31	18.58
	12H	16.47	16.79	17.47	17.78	19.10	16.07	16.38	17.07	17.38	18.70
12H	4H	15.47	15.90	16.45	16.89	18.15	15.10	15.54	16.08	16.53	17.79
	6H	16.15	16.50	17.14	17.50	18.77	15.78	16.14	16.78	17.14	18.41
	8H	16.39	16.70	17.39	17.70	19.01	16.02	16.33	17.02	17.33	18.64

END OF REPORT