

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911365

Luminaire Tested: DFN2DIP-PN4F0-050D040US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911365
REPORT IS A COMBINATION OF REPORTS P901131 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-050D040US850-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9881.2 lumens
Efficiency: N/A
Efficacy: 132.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 74.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911365

CATALOG NUMBER: DFN2DIP-PN4F0-050D040US850-FLLONL

Luminous Intensity Polar Plot

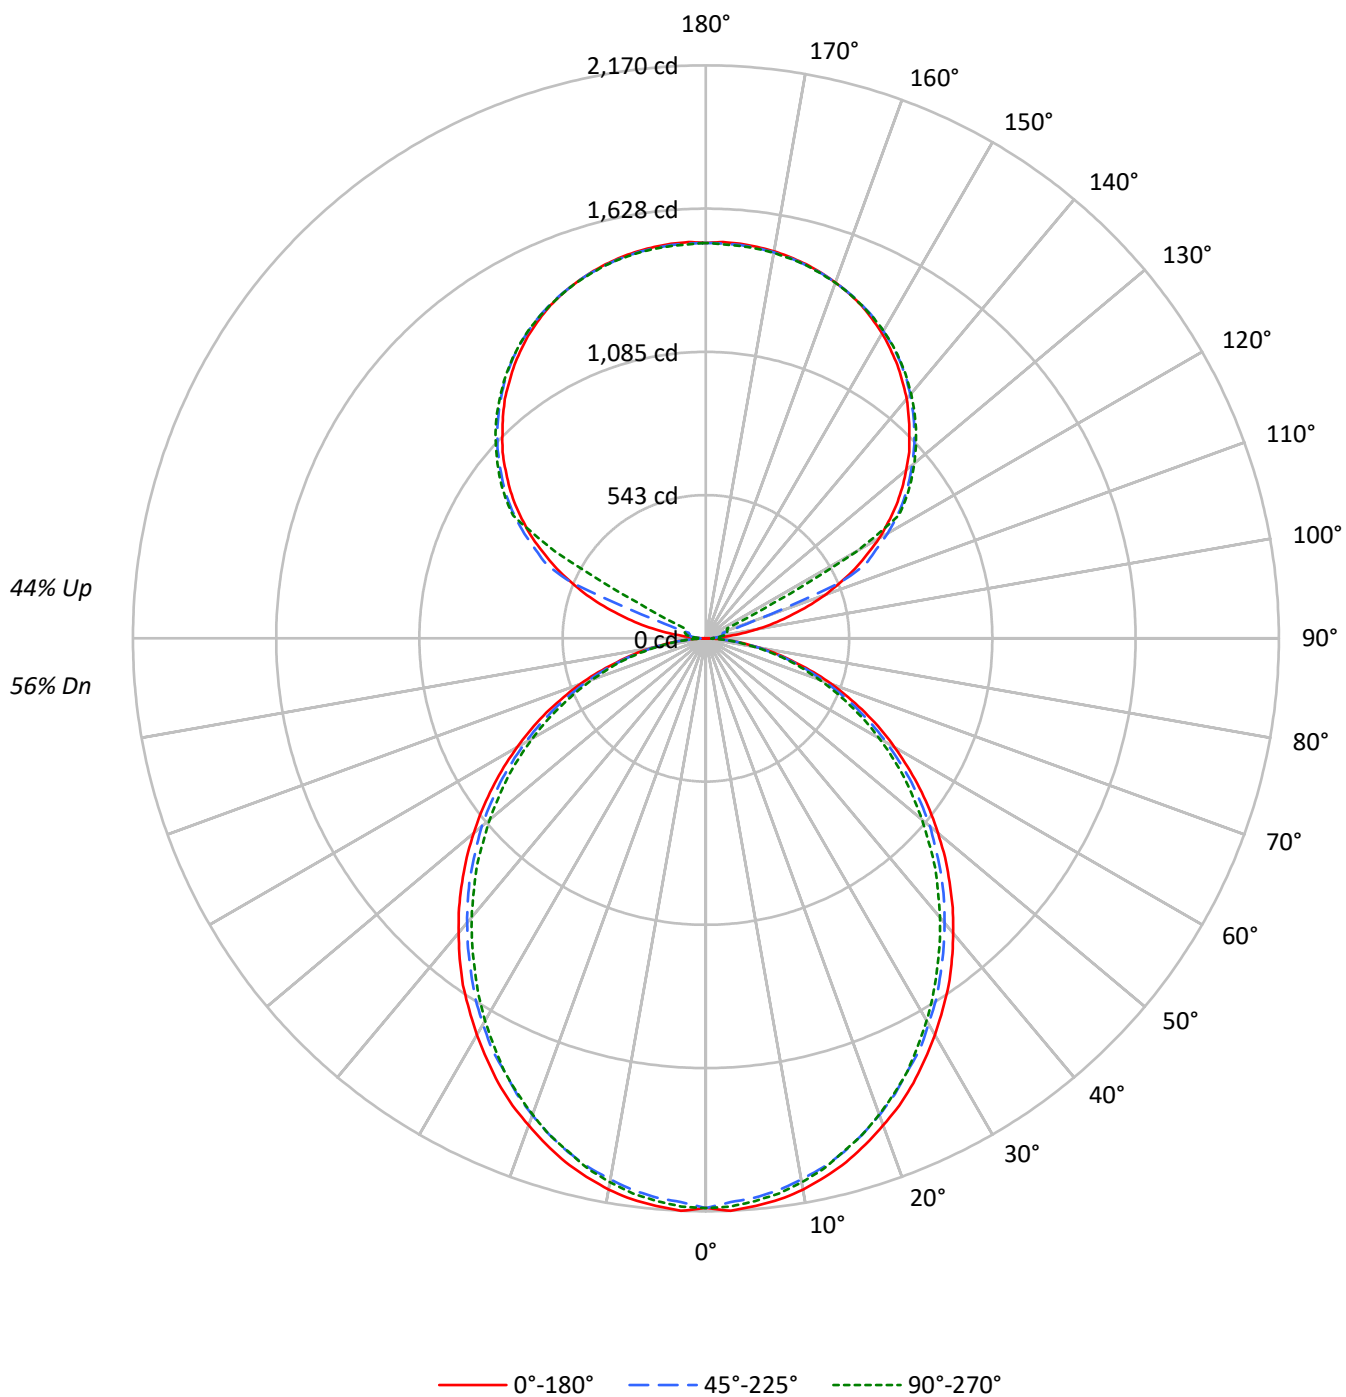

TEST NUMBER: P911365

CATALOG NUMBER: DFN2DIP-PN4F0-050D040US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	108	108	108	108		101	101	101	101		86	86	86		73	73	73		61	61	61
1	99	95	91	87		92	88	85	82		76	73	71		65	63	61		54	53	52
2	90	83	76	71		84	77	72	67		66	62	59		57	54	51		48	46	44
3	82	73	65	59		76	68	61	56		59	54	50		50	46	43		42	39	37
4	75	64	56	50		70	60	53	48		52	47	42		45	40	37		38	35	32
5	69	57	49	43		64	54	46	41		47	41	36		40	36	32		34	31	28
6	64	52	43	37		59	48	41	36		42	36	32		36	32	28		31	27	25
7	59	47	39	33		55	44	36	31		38	32	28		33	28	25		28	25	22
8	55	42	34	29		51	40	33	28		35	29	25		30	26	22		26	22	20
9	51	39	31	26		47	36	29	25		32	26	22		28	23	20		24	20	18
10	48	35	28	23		44	33	27	22		29	24	20		26	21	18		22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1575	1575	1575
5°	1577	1553	1564
10°	1565	1533	1543
15°	1542	1507	1510
20°	1511	1473	1476
25°	1480	1431	1438
30°	1441	1392	1388
35°	1404	1346	1336
40°	1359	1300	1286
45°	1314	1254	1235
50°	1265	1205	1176
55°	1213	1149	1122
60°	1155	1082	1060
65°	1091	1013	986
70°	1010	929	908
75°	898	828	836
80°	763	700	697
85°	551	477	466

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1314 cd/sqm

TEST NUMBER: P911365

CATALOG NUMBER: DFN2DIP-PN4F0-050D040US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	2.1
10°-20°	571.4	5.8
20°-30°	839.7	8.5
30°-40°	975.2	9.9
40°-50°	974.0	9.9
50°-60°	849.3	8.6
60°-70°	627.9	6.4
70°-80°	355.2	3.6
80°-90°	96.4	1.0
90°-100°	49.4	0.5
100°-110°	184.0	1.9
110°-120°	488.1	4.9
120°-130°	809.5	8.2
130°-140°	859.9	8.7
140°-150°	799.2	8.1
150°-160°	642.5	6.5
160°-170°	414.0	4.2
170°-180°	142.5	1.4
0°-30°	1614.1	16.3
0°-40°	2589.4	26.2
0°-60°	4412.7	44.7
0°-90°	5492.2	55.6
90°-120°	721.5	7.3
90°-150°	3190.0	32.3
90°-180°	4389.0	44.4
0°-180°	9881.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2126	2143	2139	205
15°	2054	2042	2014	2023	2012	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1001
45°	1305	1290	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	1	13	22	27	29	9
95°	70	35	42	48	47	83
105°	329	362	66	78	82	352
115°	623	641	668	167	89	613
125°	881	895	915	923	926	785
135°	1090	1107	1117	1128	1126	842
145°	1264	1263	1281	1289	1284	791
155°	1392	1382	1395	1402	1393	641
165°	1467	1460	1464	1471	1464	414
175°	1500	1493	1495	1502	1492	143
180°	1497	1497	1497	1497	1497	

TEST NUMBER: P911365

CATALOG NUMBER: DFN2DIP-PN4F0-050D040US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.6	2157.6	2157.6	2157.6	2157.6
2.5°	2170.1	2159.8	2136.9	2157.6	2153.7
5°	2157.6	2149.5	2126.5	2143.0	2139.2
7.5°	2143.0	2130.7	2107.9	2124.6	2120.4
10°	2120.4	2105.9	2081.0	2097.5	2091.4
12.5°	2089.1	2076.8	2052.0	2062.3	2058.1
15°	2053.9	2041.6	2014.5	2022.9	2012.5
17.5°	2010.3	1998.0	1970.9	1981.2	1970.9
20°	1962.6	1950.3	1921.2	1927.3	1919.2
22.5°	1915.0	1896.3	1869.2	1869.2	1865.0
25°	1858.9	1842.4	1807.1	1811.1	1807.1
27.5°	1796.6	1782.1	1755.2	1749.0	1738.7
30°	1734.5	1717.8	1686.8	1680.6	1672.3
32.5°	1668.0	1655.7	1622.5	1609.9	1601.6
35°	1603.7	1583.1	1549.8	1537.3	1527.0
37.5°	1531.1	1512.5	1479.2	1464.7	1454.3
40°	1456.6	1439.8	1406.5	1388.0	1379.7
42.5°	1383.9	1367.2	1334.1	1313.2	1300.9
45°	1305.1	1290.5	1259.3	1236.6	1228.2
47.5°	1228.2	1213.7	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.8	1068.4
52.5°	1068.4	1053.9	1027.0	1004.2	989.7
55°	987.7	975.1	950.2	925.3	915.0
57.5°	906.6	896.3	869.2	844.4	836.0
60°	825.7	817.6	788.5	765.5	759.4
62.5°	746.9	732.4	711.6	690.9	682.6
65°	666.1	653.5	632.8	614.2	603.7
67.5°	583.1	572.6	554.1	539.5	531.1
70°	506.3	497.9	479.2	464.7	456.6
72.5°	427.5	419.1	408.8	394.2	388.0
75°	348.4	344.5	333.9	321.6	325.8
77.5°	278.0	269.6	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.1	190.9
82.5°	141.1	141.1	139.1	130.8	130.8
85°	84.9	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.8	20.7
90°	1.0	13.0	21.6	27.2	29.2
92.5°	27.2	22.7	26.0	28.2	29.2
95°	70.3	34.6	42.1	47.7	46.6
97.5°	126.8	37.9	55.2	58.6	59.6
100°	191.7	43.4	61.8	70.3	72.5
102.5°	263.2	261.2	63.9	75.7	79.1
105°	329.3	361.9	66.1	78.0	82.3
107.5°	406.2	433.3	68.3	80.2	84.5
110°	480.0	502.6	189.6	81.3	85.5

TEST NUMBER: P911365

CATALOG NUMBER: DFN2DIP-PN4F0-050D040US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	549.3	568.7	550.3	83.4	86.7
115°	622.8	641.2	668.4	166.8	88.9
117.5°	686.8	708.4	726.9	571.9	288.1
120°	758.3	774.5	794.0	807.1	660.9
122.5°	818.9	836.3	858.0	864.5	865.6
125°	880.7	894.9	915.4	923.0	926.2
127.5°	937.0	952.2	968.5	979.4	980.4
130°	990.1	1007.5	1019.3	1031.3	1030.3
132.5°	1044.2	1058.4	1070.3	1080.1	1079.1
135°	1089.8	1107.2	1116.9	1127.7	1125.6
137.5°	1137.4	1150.4	1161.3	1172.1	1168.9
140°	1184.0	1192.7	1204.6	1214.4	1208.9
142.5°	1223.1	1230.7	1244.7	1253.3	1248.0
145°	1264.3	1263.2	1281.4	1289.1	1283.7
147.5°	1299.9	1296.6	1315.1	1320.5	1316.3
150°	1334.6	1327.0	1344.4	1350.9	1345.4
152.5°	1363.8	1355.2	1371.4	1377.9	1370.4
155°	1392.0	1382.4	1395.3	1401.8	1393.1
157.5°	1414.8	1406.1	1416.0	1423.5	1414.8
160°	1434.3	1427.7	1434.3	1440.7	1433.2
162.5°	1451.6	1445.1	1450.6	1458.1	1448.4
165°	1466.8	1460.3	1463.5	1471.1	1463.5
167.5°	1478.7	1472.1	1475.5	1483.1	1473.3
170°	1488.5	1482.0	1484.1	1491.7	1482.0
172.5°	1494.9	1488.5	1490.7	1498.3	1488.5
175°	1500.3	1492.7	1494.9	1502.5	1491.7
177.5°	1502.5	1494.9	1496.0	1503.7	1493.9
180°	1497.2	1497.2	1497.2	1497.2	1497.2

TEST NUMBER: P911365

CATALOG NUMBER: DFN2DIP-PN4F0-050D040US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.36	10.27	10.26	11.20	12.39	8.92	9.83	9.83	10.76	11.95
	3H	11.02	11.84	11.94	12.78	13.99	10.54	11.36	11.46	12.30	13.51
	4H	11.62	12.39	12.55	13.33	14.56	11.13	11.91	12.06	12.85	14.07
	6H	12.02	12.74	12.97	13.68	14.92	11.53	12.24	12.48	13.19	14.43
	8H	12.13	12.81	13.08	13.77	15.01	11.64	12.32	12.59	13.28	14.52
	12H	12.18	12.83	13.14	13.79	15.05	11.68	12.33	12.64	13.29	14.55
4H	2H	9.83	10.60	10.77	11.54	12.76	9.47	10.25	10.41	11.19	12.41
	3H	11.70	12.35	12.65	13.32	14.56	11.30	11.94	12.25	12.92	14.15
	4H	12.42	13.01	13.38	13.98	15.24	12.00	12.59	12.96	13.56	14.82
	6H	12.94	13.45	13.91	14.44	15.70	12.51	13.02	13.49	14.01	15.27
	8H	13.09	13.57	14.07	14.55	15.83	12.66	13.14	13.64	14.12	15.40
	12H	13.17	13.60	14.16	14.60	15.88	12.73	13.16	13.72	14.16	15.44
8H	4H	12.62	13.10	13.59	14.08	15.35	12.25	12.72	13.22	13.71	14.98
	6H	13.26	13.65	14.26	14.68	15.95	12.88	13.27	13.88	14.30	15.57
	8H	13.48	13.83	14.49	14.84	16.13	13.10	13.44	14.10	14.46	15.75
	12H	13.62	13.92	14.63	14.93	16.27	13.21	13.52	14.23	14.53	15.86
12H	4H	12.61	13.04	13.60	14.04	15.32	12.25	12.68	13.24	13.67	14.96
	6H	13.29	13.64	14.30	14.65	15.94	12.92	13.27	13.93	14.28	15.57
	8H	13.53	13.84	14.55	14.85	16.18	13.16	13.47	14.17	14.47	15.81

END OF REPORT