

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911619

Luminaire Tested: DFN2DIP-PN4F0-120D040US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911619
REPORT IS A COMBINATION OF REPORTS P901146 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-120D040US850-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15703.4 lumens
Efficiency: N/A
Efficacy: 100.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 156.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911619

CATALOG NUMBER: DFN2DIP-PN4F0-120D040US850-RLLONL

Luminous Intensity Polar Plot

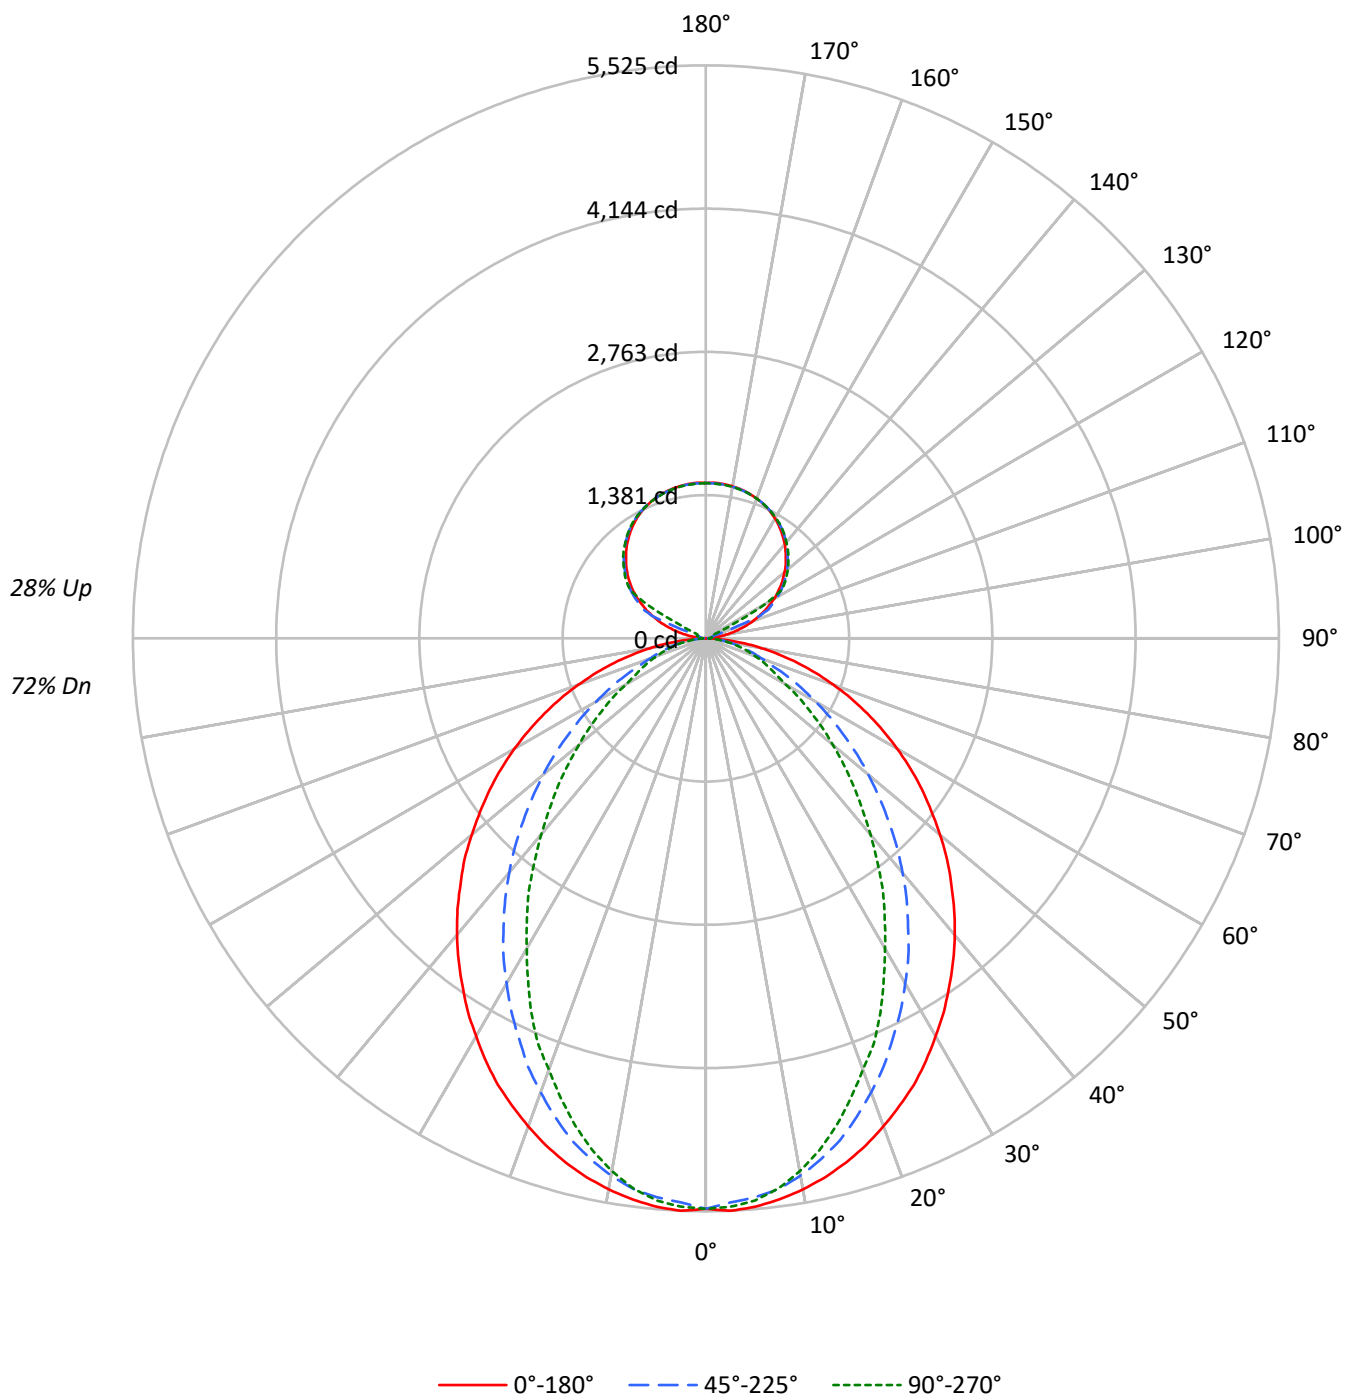

TEST NUMBER: P911619

CATALOG NUMBER: DFN2DIP-PN4F0-120D040US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	107	107	107	107	96	96	96	86	86	86	76	76	76
1	103	99	95	92	98	94	91	88	85	82	80	76	75	73	69	67	66
2	95	87	81	76	90	83	78	73	75	71	68	68	65	62	61	59	57
3	87	78	70	65	82	74	67	62	67	62	58	61	57	53	55	52	49
4	80	69	61	55	76	66	59	54	60	54	50	55	50	46	50	46	43
5	74	62	54	48	70	59	52	47	54	48	44	50	45	41	45	41	38
6	68	56	48	42	65	54	46	41	49	43	39	45	40	36	41	37	34
7	63	51	43	38	60	49	42	36	45	39	34	41	36	32	38	34	30
8	59	47	39	34	56	45	38	33	41	35	31	38	33	29	35	31	27
9	55	43	35	30	52	41	34	30	38	32	28	35	30	26	32	28	25
10	52	40	32	28	49	38	31	27	35	29	25	33	28	24	30	26	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4015	4015	4015
5°	4021	3952	3977
10°	3981	3875	3849
15°	3927	3747	3649
20°	3854	3571	3404
25°	3780	3374	3168
30°	3680	3171	2867
35°	3583	2954	2604
40°	3483	2728	2301
45°	3368	2478	2027
50°	3248	2226	1759
55°	3124	1956	1501
60°	2979	1673	1237
65°	2813	1386	1114
70°	2612	1119	1009
75°	2359	987	919
80°	1993	830	800
85°	1388	557	606

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3368 cd/sqm

TEST NUMBER: P911619

CATALOG NUMBER: DFN2DIP-PN4F0-120D040US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	515.5	3.3
10°-20°	1415.1	9.0
20°-30°	1986.8	12.7
30°-40°	2165.7	13.8
40°-50°	1990.5	12.7
50°-60°	1563.2	10.0
60°-70°	1017.5	6.5
70°-80°	523.8	3.3
80°-90°	136.3	0.9
90°-100°	49.4	0.3
100°-110°	184.0	1.2
110°-120°	488.1	3.1
120°-130°	809.5	5.2
130°-140°	859.9	5.5
140°-150°	799.2	5.1
150°-160°	642.5	4.1
160°-170°	414.0	2.6
170°-180°	142.5	0.9
0°-30°	3917.3	24.9
0°-40°	6083.0	38.7
0°-60°	9636.8	61.4
0°-90°	11314.4	72.1
90°-120°	721.5	4.6
90°-150°	3190.0	20.3
90°-180°	4389.0	27.9
0°-180°	15703.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5500	5500	5500	5500	5500	
5°	5500	5475	5410	5455	5440	522
15°	5231	5176	5008	4913	4863	1474
25°	4749	4589	4261	4057	3982	2184
35°	4092	3838	3400	3086	2976	2561
45°	3345	3011	2489	2135	2016	2583
55°	2543	2155	1618	1319	1225	2273
65°	1717	1314	866	697	682	1703
75°	916	567	398	363	358	969
85°	214	109	94	94	94	246
90°	1	13	22	27	29	15
95°	70	35	42	48	47	83
105°	329	362	66	78	82	352
115°	623	641	668	167	89	613
125°	881	895	915	923	926	785
135°	1090	1107	1117	1128	1126	842
145°	1264	1263	1281	1289	1284	791
155°	1392	1382	1395	1402	1393	641
165°	1467	1460	1464	1471	1464	414
175°	1500	1493	1495	1502	1492	143
180°	1497	1497	1497	1497	1497	

TEST NUMBER: P911619

CATALOG NUMBER: DFN2DIP-PN4F0-120D040US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5500.2	5500.2	5500.2	5500.2	5500.2
2.5°	5525.0	5500.2	5445.3	5495.4	5485.3
5°	5500.2	5475.4	5410.4	5455.3	5440.5
7.5°	5455.3	5425.7	5356.0	5375.5	5350.7
10°	5395.6	5360.8	5261.4	5246.1	5216.6
12.5°	5321.1	5276.3	5141.5	5112.0	5057.2
15°	5231.4	5176.5	5007.5	4912.9	4863.3
17.5°	5126.8	5047.1	4837.9	4728.7	4648.9
20°	5007.5	4907.7	4658.9	4534.8	4424.9
22.5°	4878.0	4763.5	4474.6	4305.6	4231.2
25°	4748.7	4589.2	4260.7	4056.8	3981.9
27.5°	4594.5	4424.9	4061.6	3827.7	3713.0
30°	4430.2	4240.7	3842.5	3588.9	3454.3
32.5°	4270.8	4041.5	3633.9	3335.0	3210.3
35°	4091.8	3837.7	3399.9	3086.2	2976.3
37.5°	3917.4	3643.4	3180.7	2836.9	2712.8
40°	3733.1	3434.8	2951.6	2598.3	2468.9
42.5°	3544.0	3225.6	2722.9	2354.3	2230.2
45°	3345.0	3011.3	2488.9	2135.2	2015.7
47.5°	3155.9	2802.7	2265.0	1911.3	1801.9
50°	2946.8	2593.5	2045.9	1702.1	1598.1
52.5°	2742.4	2369.0	1836.7	1508.2	1413.8
55°	2543.4	2155.2	1617.6	1319.2	1224.7
57.5°	2339.4	1941.3	1423.7	1144.9	1065.2
60°	2130.4	1732.1	1219.3	965.9	886.2
62.5°	1926.6	1528.3	1045.1	806.5	766.8
65°	1717.4	1313.9	866.1	697.1	681.8
67.5°	1518.3	1114.8	697.1	612.1	597.3
70°	1309.2	921.0	577.2	527.6	507.5
72.5°	1110.1	741.5	482.6	443.0	433.1
75°	915.7	567.1	398.2	363.3	358.5
77.5°	722.0	402.9	313.7	293.7	283.6
80°	542.4	288.9	238.7	219.1	219.1
82.5°	378.2	194.3	164.2	154.2	154.2
85°	213.9	109.3	94.5	94.5	94.5
87.5°	79.7	39.6	39.6	34.8	34.8
90°	1.0	13.0	21.6	27.2	29.2
92.5°	27.2	22.7	26.0	28.2	29.2
95°	70.3	34.6	42.1	47.7	46.6
97.5°	126.8	37.9	55.2	58.6	59.6
100°	191.7	43.4	61.8	70.3	72.5
102.5°	263.2	261.2	63.9	75.7	79.1
105°	329.3	361.9	66.1	78.0	82.3
107.5°	406.2	433.3	68.3	80.2	84.5
110°	480.0	502.6	189.6	81.3	85.5

TEST NUMBER: P911619

CATALOG NUMBER: DFN2DIP-PN4F0-120D040US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	549.3	568.7	550.3	83.4	86.7
115°	622.8	641.2	668.4	166.8	88.9
117.5°	686.8	708.4	726.9	571.9	288.1
120°	758.3	774.5	794.0	807.1	660.9
122.5°	818.9	836.3	858.0	864.5	865.6
125°	880.7	894.9	915.4	923.0	926.2
127.5°	937.0	952.2	968.5	979.4	980.4
130°	990.1	1007.5	1019.3	1031.3	1030.3
132.5°	1044.2	1058.4	1070.3	1080.1	1079.1
135°	1089.8	1107.2	1116.9	1127.7	1125.6
137.5°	1137.4	1150.4	1161.3	1172.1	1168.9
140°	1184.0	1192.7	1204.6	1214.4	1208.9
142.5°	1223.1	1230.7	1244.7	1253.3	1248.0
145°	1264.3	1263.2	1281.4	1289.1	1283.7
147.5°	1299.9	1296.6	1315.1	1320.5	1316.3
150°	1334.6	1327.0	1344.4	1350.9	1345.4
152.5°	1363.8	1355.2	1371.4	1377.9	1370.4
155°	1392.0	1382.4	1395.3	1401.8	1393.1
157.5°	1414.8	1406.1	1416.0	1423.5	1414.8
160°	1434.3	1427.7	1434.3	1440.7	1433.2
162.5°	1451.6	1445.1	1450.6	1458.1	1448.4
165°	1466.8	1460.3	1463.5	1471.1	1463.5
167.5°	1478.7	1472.1	1475.5	1483.1	1473.3
170°	1488.5	1482.0	1484.1	1491.7	1482.0
172.5°	1494.9	1488.5	1490.7	1498.3	1488.5
175°	1500.3	1492.7	1494.9	1502.5	1491.7
177.5°	1502.5	1494.9	1496.0	1503.7	1493.9
180°	1497.2	1497.2	1497.2	1497.2	1497.2

TEST NUMBER: P911619

CATALOG NUMBER: DFN2DIP-PN4F0-120D040US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.83	14.88	14.58	15.65	16.57	9.80	10.85	10.55	11.61	12.53
	3H	15.53	16.47	16.29	17.25	18.20	11.01	11.95	11.77	12.72	13.67
	4H	16.15	17.04	16.93	17.82	18.78	11.47	12.35	12.25	13.14	14.10
	6H	16.59	17.40	17.38	18.20	19.17	11.80	12.61	12.59	13.41	14.38
	8H	16.72	17.50	17.52	18.31	19.29	11.90	12.67	12.70	13.48	14.46
	12H	16.79	17.53	17.60	18.34	19.34	11.95	12.69	12.76	13.49	14.50
4H	2H	13.88	14.76	14.66	15.55	16.51	10.42	11.31	11.21	12.09	13.06
	3H	15.73	16.47	16.53	17.29	18.26	11.79	12.53	12.59	13.35	14.33
	4H	16.43	17.10	17.24	17.92	18.93	12.35	13.02	13.16	13.84	14.84
	6H	16.96	17.54	17.79	18.38	19.40	12.78	13.36	13.61	14.20	15.22
	8H	17.15	17.68	17.98	18.52	19.55	12.92	13.45	13.75	14.29	15.32
	12H	17.25	17.73	18.10	18.59	19.62	12.99	13.48	13.84	14.33	15.37
8H	4H	16.42	16.96	17.25	17.79	18.82	12.65	13.19	13.48	14.02	15.05
	6H	17.00	17.44	17.85	18.32	19.35	13.18	13.62	14.04	14.50	15.53
	8H	17.22	17.61	18.09	18.49	19.53	13.37	13.76	14.24	14.64	15.68
	12H	17.37	17.71	18.24	18.58	19.68	13.50	13.85	14.37	14.71	15.81
12H	4H	16.38	16.86	17.23	17.72	18.75	12.66	13.15	13.51	14.01	15.04
	6H	16.97	17.37	17.84	18.24	19.29	13.23	13.62	14.10	14.50	15.54
	8H	17.20	17.55	18.08	18.42	19.52	13.45	13.80	14.32	14.66	15.76

END OF REPORT