

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914061

Luminaire Tested: DFN2DIP-PN4F0-040D050US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914061
REPORT IS A COMBINATION OF REPORTS P901147 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-040D050US927-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7058.3 lumens
Efficiency: N/A
Efficacy: 99.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 71
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914061

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US927-FLLONL

Luminous Intensity Polar Plot

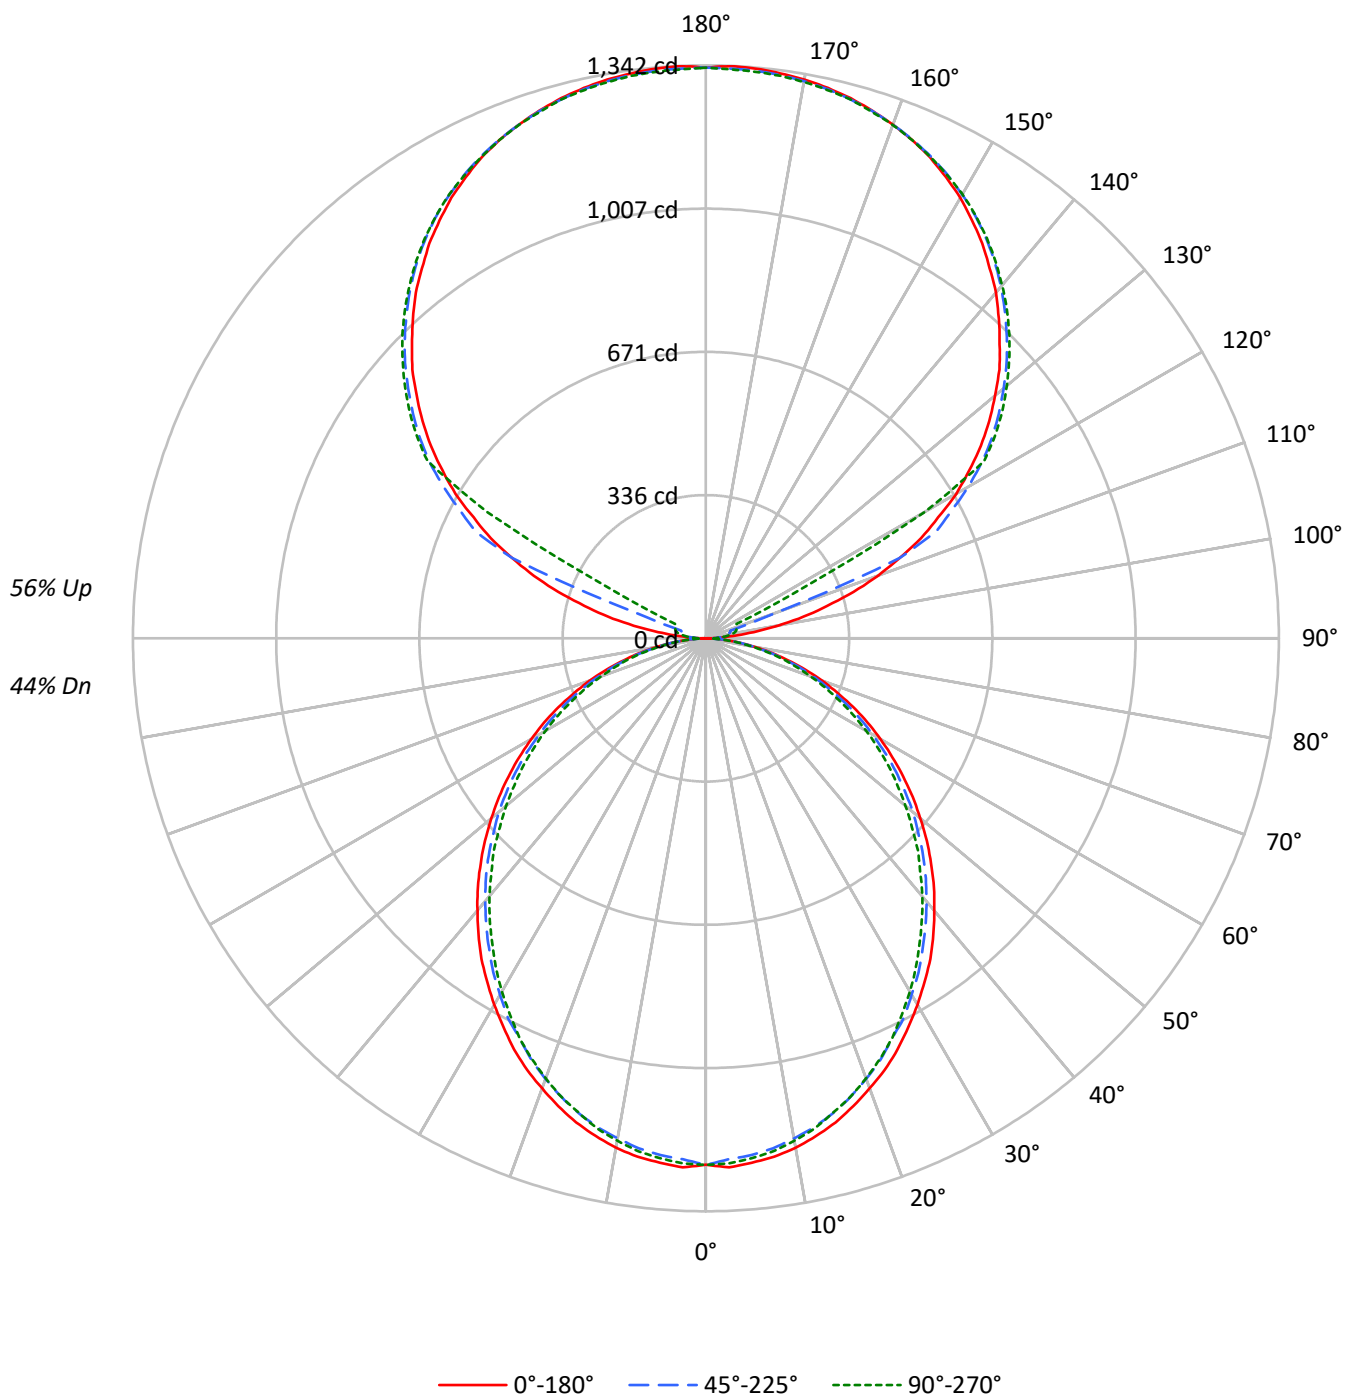

TEST NUMBER: P914061

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	46	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	25	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	900	900	900
5°	901	888	894
10°	894	876	882
15°	881	861	863
20°	863	842	844
25°	846	818	822
30°	823	796	793
35°	802	769	763
40°	777	743	735
45°	751	716	706
50°	723	689	672
55°	693	657	641
60°	660	618	606
65°	623	579	564
70°	577	531	519
75°	513	473	478
80°	436	400	398
85°	315	273	266

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 751 cd/sqm

TEST NUMBER: P914061

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.0	1.6
10°-20°	326.5	4.6
20°-30°	479.8	6.8
30°-40°	557.3	7.9
40°-50°	556.6	7.9
50°-60°	485.3	6.9
60°-70°	358.8	5.1
70°-80°	203.0	2.9
80°-90°	55.9	0.8
90°-100°	44.1	0.6
100°-110°	164.3	2.3
110°-120°	435.8	6.2
120°-130°	722.8	10.2
130°-140°	767.8	10.9
140°-150°	713.6	10.1
150°-160°	573.7	8.1
160°-170°	369.7	5.2
170°-180°	127.2	1.8
0°-30°	922.4	13.1
0°-40°	1479.7	21.0
0°-60°	2521.7	35.7
0°-90°	3139.4	44.5
90°-120°	644.2	9.1
90°-150°	2848.4	40.4
90°-180°	3919.0	55.5
0°-180°	7058.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1233	1233	1233	1233	1233	
5°	1233	1228	1215	1225	1222	117
15°	1174	1167	1151	1156	1150	331
25°	1062	1053	1033	1035	1033	489
35°	916	905	886	878	873	572
45°	746	738	720	707	702	576
55°	564	557	543	529	523	505
65°	381	373	362	351	345	376
75°	199	197	191	184	186	213
85°	49	48	46	43	42	54
90°	1	12	19	24	26	7
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P914061

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1233.0	1233.0	1233.0	1233.0	1233.0
2.5°	1240.2	1234.2	1221.1	1233.0	1230.7
5°	1233.0	1228.3	1215.2	1224.6	1222.4
7.5°	1224.6	1217.6	1204.5	1214.1	1211.7
10°	1211.7	1203.4	1189.2	1198.6	1195.1
12.5°	1193.8	1186.8	1172.6	1178.5	1176.1
15°	1173.7	1166.6	1151.2	1156.0	1150.1
17.5°	1148.8	1141.8	1126.3	1132.2	1126.3
20°	1121.5	1114.4	1097.9	1101.4	1096.8
22.5°	1094.3	1083.6	1068.2	1068.2	1065.8
25°	1062.2	1052.8	1032.7	1035.0	1032.7
27.5°	1026.7	1018.3	1003.1	999.5	993.6
30°	991.2	981.7	963.9	960.4	955.6
32.5°	953.2	946.2	927.2	920.0	915.2
35°	916.5	904.7	885.7	878.5	872.6
37.5°	875.0	864.3	845.3	837.0	831.1
40°	832.3	822.8	803.7	793.2	788.5
42.5°	790.8	781.2	762.4	750.4	743.4
45°	745.8	737.5	719.6	706.7	701.9
47.5°	701.9	693.6	674.6	661.6	654.5
50°	655.6	649.7	633.1	616.5	610.5
52.5°	610.5	602.3	586.9	573.9	565.5
55°	564.4	557.2	543.0	528.8	522.9
57.5°	518.1	512.2	496.7	482.5	477.8
60°	471.8	467.1	450.6	437.5	434.0
62.5°	426.8	418.5	406.7	394.8	390.1
65°	380.6	373.4	361.6	350.9	345.1
67.5°	333.2	327.2	316.6	308.3	303.6
70°	289.3	284.6	273.9	265.5	260.9
72.5°	244.3	239.5	233.6	225.3	221.7
75°	199.2	196.9	190.8	183.8	186.2
77.5°	158.8	154.1	151.7	148.1	144.7
80°	118.6	117.3	114.9	111.5	109.1
82.5°	80.6	80.6	79.5	74.7	74.7
85°	48.6	47.5	46.3	42.6	41.5
87.5°	21.4	19.0	16.6	13.1	11.8
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P914061

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P914061

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.38	7.19	7.38	8.21	9.56	5.94	6.75	6.94	7.77	9.12
	3H	8.04	8.77	9.05	9.79	11.16	7.56	8.28	8.57	9.31	10.68
	4H	8.63	9.32	9.65	10.34	11.72	8.14	8.83	9.17	9.86	11.23
	6H	9.03	9.66	10.06	10.69	12.08	8.53	9.17	9.57	10.20	11.59
	8H	9.13	9.74	10.17	10.78	12.17	8.64	9.24	9.68	10.29	11.68
	12H	9.18	9.76	10.23	10.80	12.20	8.68	9.26	9.73	10.30	11.70
4H	2H	6.84	7.53	7.87	8.55	9.93	6.48	7.18	7.52	8.20	9.58
	3H	8.70	9.28	9.74	10.33	11.72	8.30	8.87	9.34	9.93	11.32
	4H	9.42	9.94	10.46	10.99	12.40	9.00	9.53	10.05	10.57	11.98
	6H	9.93	10.38	10.99	11.45	12.86	9.51	9.96	10.56	11.03	12.44
	8H	10.08	10.50	11.14	11.57	12.99	9.65	10.08	10.71	11.14	12.56
	12H	10.15	10.54	11.23	11.61	13.04	9.71	10.10	10.79	11.17	12.60
8H	4H	9.61	10.03	10.67	11.09	12.52	9.24	9.66	10.30	10.72	12.15
	6H	10.24	10.59	11.32	11.69	13.11	9.86	10.22	10.95	11.32	12.74
	8H	10.46	10.77	11.55	11.86	13.30	10.08	10.39	11.17	11.47	12.91
	12H	10.59	10.87	11.69	11.95	13.43	10.19	10.46	11.28	11.55	13.02
12H	4H	9.59	9.98	10.67	11.05	12.48	9.23	9.61	10.31	10.69	12.12
	6H	10.27	10.58	11.36	11.67	13.10	9.91	10.21	10.99	11.30	12.74
	8H	10.51	10.78	11.60	11.87	13.34	10.14	10.41	11.23	11.49	12.97

END OF REPORT