

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914171

Luminaire Tested: DFN2DIP-PN4F0-070D050US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914171
REPORT IS A COMBINATION OF REPORTS P901154 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-070D050US927-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8634.8 lumens
Efficiency: N/A
Efficacy: 82.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 104.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914171

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US927-RLLONL

Luminous Intensity Polar Plot

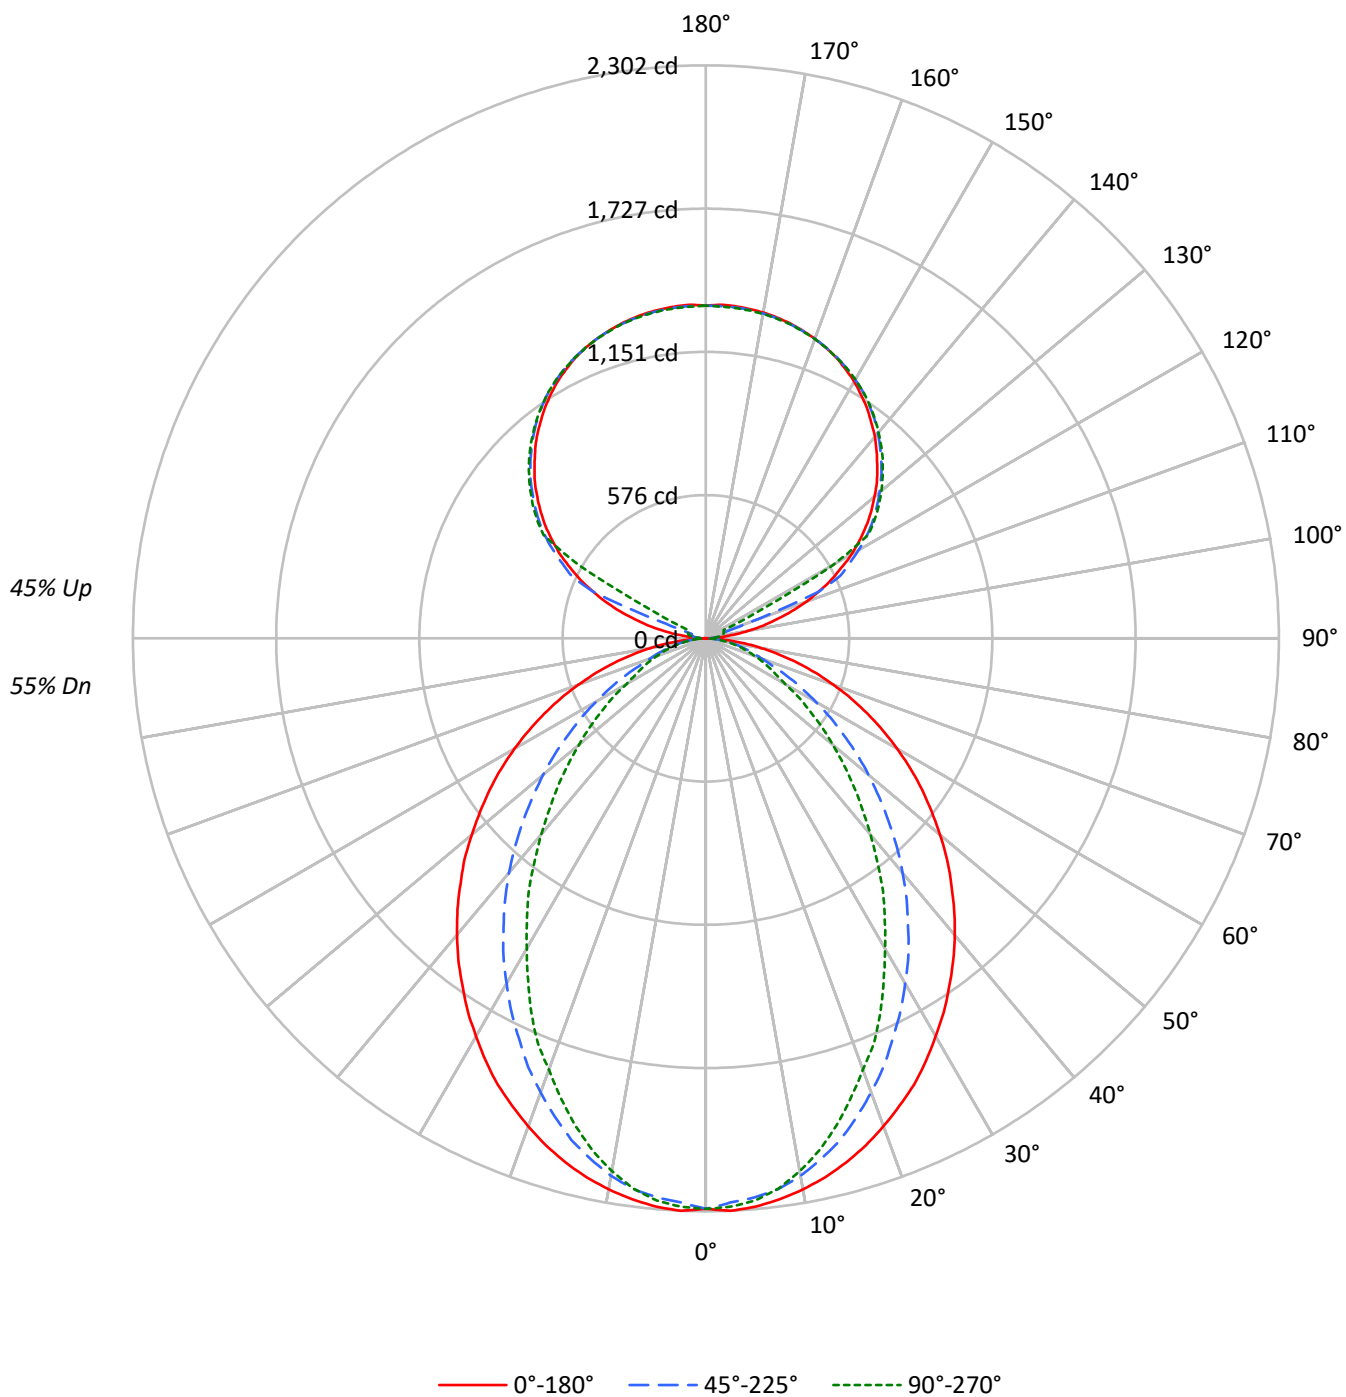

TEST NUMBER: P914171

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	95	91	88	92	89	85	82	76	74	72	65	63	62	54	53	52
2	91	84	78	73	84	78	73	69	67	63	60	57	55	52	48	46	45
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	43	41	39
4	76	66	58	52	71	62	55	50	54	48	44	46	42	39	39	36	34
5	70	59	51	45	65	55	48	43	48	43	38	42	37	34	35	32	30
6	65	53	45	40	60	50	43	38	44	38	34	38	33	30	32	29	26
7	60	48	40	35	56	45	38	33	40	34	30	35	30	27	30	26	24
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21
9	52	40	33	28	49	38	31	27	34	28	24	29	25	22	25	22	19
10	49	37	30	25	46	35	28	24	31	26	22	27	23	20	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1673	1673	1673
5°	1676	1647	1657
10°	1659	1615	1604
15°	1636	1561	1521
20°	1606	1488	1418
25°	1575	1406	1320
30°	1533	1321	1195
35°	1493	1231	1085
40°	1451	1137	959
45°	1403	1033	844
50°	1353	927	733
55°	1302	815	626
60°	1241	697	515
65°	1172	578	464
70°	1088	466	420
75°	983	411	383
80°	830	346	333
85°	578	232	253

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1403 cd/sqm

TEST NUMBER: P914171

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	214.8	2.5
10°-20°	589.7	6.8
20°-30°	827.9	9.6
30°-40°	902.4	10.5
40°-50°	829.4	9.6
50°-60°	651.4	7.5
60°-70°	424.0	4.9
70°-80°	218.2	2.5
80°-90°	58.1	0.7
90°-100°	44.1	0.5
100°-110°	164.3	1.9
110°-120°	435.8	5.0
120°-130°	722.8	8.4
130°-140°	767.8	8.9
140°-150°	713.6	8.3
150°-160°	573.7	6.6
160°-170°	369.7	4.3
170°-180°	127.2	1.5
0°-30°	1632.3	18.9
0°-40°	2534.7	29.4
0°-60°	4015.5	46.5
0°-90°	4715.8	54.6
90°-120°	644.2	7.5
90°-150°	2848.4	33.0
90°-180°	3919.0	45.4
0°-180°	8634.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2292	2292	2292	2292	2292	
5°	2292	2282	2254	2273	2267	217
15°	2180	2157	2086	2047	2026	614
25°	1979	1912	1775	1690	1659	910
35°	1705	1599	1417	1286	1240	1067
45°	1394	1255	1037	890	840	1076
55°	1060	898	674	550	510	947
65°	716	548	361	290	284	709
75°	382	236	166	151	149	404
85°	89	46	39	39	39	102
90°	1	12	19	24	26	8
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P914171

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2291.9	2291.9	2291.9	2291.9	2291.9
2.5°	2302.2	2291.9	2269.0	2289.9	2285.7
5°	2291.9	2281.5	2254.5	2273.2	2267.0
7.5°	2273.2	2260.8	2231.8	2239.9	2229.6
10°	2248.3	2233.8	2192.4	2186.0	2173.7
12.5°	2217.2	2198.5	2142.5	2130.1	2107.2
15°	2179.8	2157.0	2086.5	2047.2	2026.5
17.5°	2136.3	2103.1	2015.9	1970.3	1937.1
20°	2086.5	2044.9	1941.3	1889.6	1843.8
22.5°	2032.7	1984.9	1864.5	1794.1	1763.1
25°	1978.7	1912.2	1775.4	1690.4	1659.2
27.5°	1914.5	1843.8	1692.4	1595.0	1547.2
30°	1846.0	1767.0	1601.1	1495.5	1439.4
32.5°	1779.6	1684.1	1514.2	1389.6	1337.7
35°	1704.9	1599.1	1416.7	1286.0	1240.2
37.5°	1632.4	1518.1	1325.4	1182.1	1130.4
40°	1555.5	1431.2	1229.9	1082.7	1028.7
42.5°	1476.8	1344.1	1134.6	981.0	929.3
45°	1393.8	1254.7	1037.1	889.7	839.9
47.5°	1315.0	1167.8	943.8	796.4	750.8
50°	1227.9	1080.7	852.5	709.2	665.9
52.5°	1142.7	987.1	765.3	628.4	589.1
55°	1059.8	898.0	674.0	549.7	510.3
57.5°	974.9	808.9	593.3	477.1	443.9
60°	887.7	721.8	508.1	402.5	369.2
62.5°	802.7	636.8	435.5	336.0	319.5
65°	715.6	547.5	360.9	290.5	284.1
67.5°	632.6	464.5	290.5	255.0	248.9
70°	545.5	383.7	240.5	219.8	211.4
72.5°	462.6	309.0	201.1	184.7	180.5
75°	381.6	236.3	165.9	151.4	149.4
77.5°	300.8	167.9	130.7	122.3	118.2
80°	226.0	120.3	99.5	91.3	91.3
82.5°	157.6	81.0	68.4	64.2	64.2
85°	89.1	45.6	39.4	39.4	39.4
87.5°	33.2	16.5	16.5	14.5	14.5
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4



TEST NUMBER: P914171

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P914171

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.36	10.23	10.29	11.17	12.38	5.33	6.20	6.25	7.13	8.34
	3H	11.05	11.82	11.98	12.77	14.00	6.52	7.30	7.46	8.24	9.47
	4H	11.66	12.39	12.61	13.34	14.58	6.97	7.71	7.92	8.66	9.90
	6H	12.08	12.76	13.05	13.72	14.97	7.30	7.97	8.26	8.93	10.18
	8H	12.21	12.86	13.18	13.83	15.08	7.39	8.03	8.36	9.00	10.25
	12H	12.28	12.89	13.25	13.86	15.13	7.43	8.05	8.41	9.01	10.29
4H	2H	9.39	10.12	10.34	11.07	12.31	5.93	6.66	6.89	7.62	8.86
	3H	11.22	11.83	12.19	12.81	14.07	7.28	7.89	8.25	8.88	10.13
	4H	11.92	12.47	12.89	13.45	14.73	7.83	8.39	8.81	9.37	10.64
	6H	12.44	12.92	13.42	13.91	15.19	8.26	8.74	9.24	9.73	11.01
	8H	12.62	13.06	13.60	14.05	15.34	8.39	8.83	9.38	9.83	11.12
	12H	12.71	13.12	13.72	14.12	15.42	8.45	8.86	9.46	9.87	11.16
8H	4H	11.89	12.34	12.88	13.33	14.62	8.12	8.57	9.11	9.56	10.85
	6H	12.46	12.83	13.47	13.86	15.15	8.64	9.01	9.65	10.04	11.33
	8H	12.68	13.00	13.70	14.02	15.33	8.83	9.16	9.85	10.18	11.49
	12H	12.82	13.11	13.84	14.12	15.47	8.95	9.24	9.98	10.25	11.61
12H	4H	11.84	12.25	12.85	13.25	14.55	8.13	8.53	9.13	9.54	10.83
	6H	12.43	12.76	13.46	13.78	15.09	8.69	9.02	9.71	10.04	11.34
	8H	12.66	12.95	13.68	13.96	15.31	8.90	9.19	9.93	10.20	11.56

END OF REPORT