

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914205

Luminaire Tested: DFN2DIP-PN4F0-080D050US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914205
REPORT IS A COMBINATION OF REPORTS P901155 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-080D050US927-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10195.4 lumens
Efficiency: N/A
Efficacy: 88.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 114.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914205

CATALOG NUMBER: DFN2DIP-PN4F0-080D050US927-FLLONL

Luminous Intensity Polar Plot

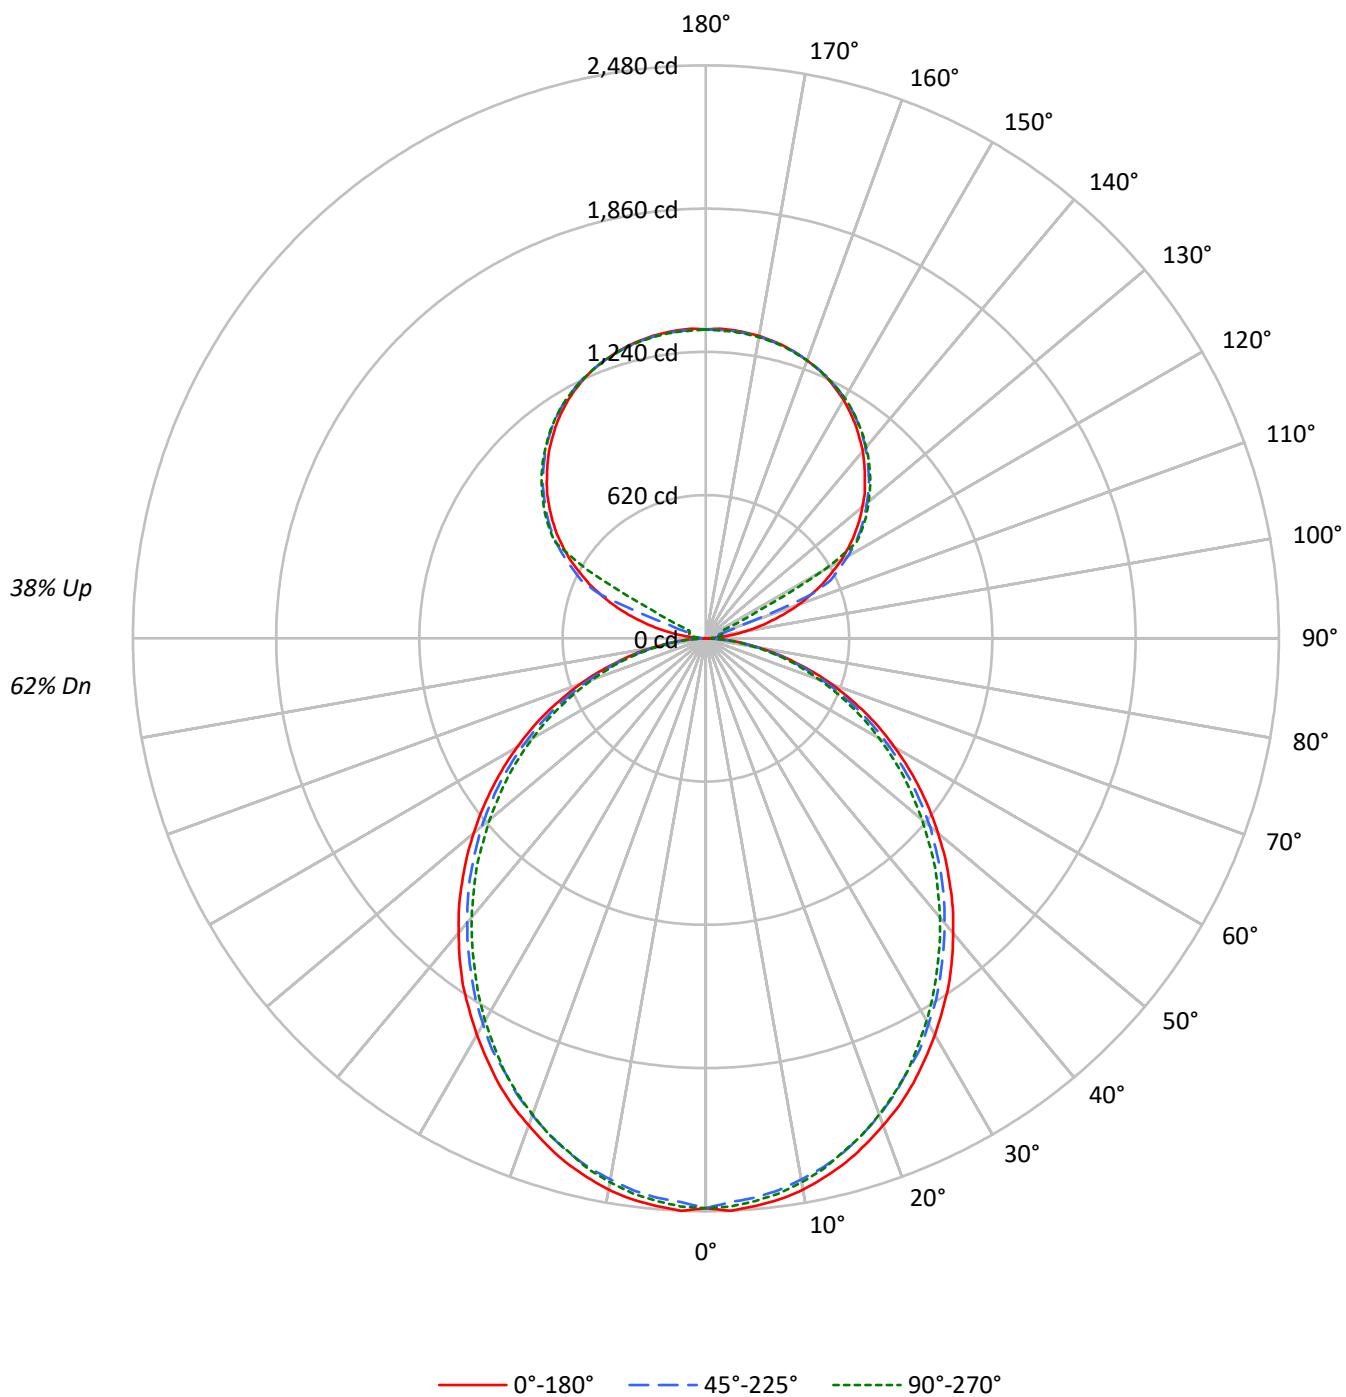

TEST NUMBER: P914205

CATALOG NUMBER: DFN2DIP-PN4F0-080D050US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	67	67	67
1	100	96	92	88	94	90	87	83	79	76	74	69	67	65	59	58	56
2	91	84	78	72	85	79	73	69	69	65	61	60	57	54	52	50	48
3	83	74	66	60	78	69	63	57	61	56	51	53	49	46	46	43	40
4	76	65	57	51	71	61	54	49	54	48	44	47	43	39	41	38	35
5	70	58	50	44	65	55	47	42	49	43	38	43	38	34	37	33	30
6	65	52	44	38	60	49	42	36	44	38	33	39	34	30	34	30	27
7	60	47	39	34	56	45	37	32	40	34	29	35	30	27	31	27	24
8	56	43	35	30	52	41	34	29	36	30	26	32	27	24	28	24	21
9	52	39	32	27	49	37	30	26	33	28	23	30	25	21	26	22	19
10	49	36	29	24	45	34	28	23	31	25	21	27	23	19	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1800	1800	1800
5°	1803	1775	1787
10°	1788	1752	1763
15°	1762	1723	1726
20°	1726	1683	1688
25°	1691	1635	1643
30°	1647	1591	1586
35°	1605	1539	1527
40°	1553	1486	1470
45°	1502	1433	1411
50°	1445	1377	1344
55°	1386	1313	1282
60°	1320	1237	1211
65°	1247	1158	1127
70°	1154	1061	1037
75°	1026	946	955
80°	872	800	796
85°	630	546	533

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1502 cd/sqm

TEST NUMBER: P914205

CATALOG NUMBER: DFN2DIP-PN4F0-080D050US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.1	2.3
10°-20°	653.0	6.4
20°-30°	959.7	9.4
30°-40°	1114.6	10.9
40°-50°	1113.2	10.9
50°-60°	970.7	9.5
60°-70°	717.6	7.0
70°-80°	406.0	4.0
80°-90°	109.5	1.1
90°-100°	44.1	0.4
100°-110°	164.3	1.6
110°-120°	435.8	4.3
120°-130°	722.8	7.1
130°-140°	767.8	7.5
140°-150°	713.6	7.0
150°-160°	573.7	5.6
160°-170°	369.7	3.6
170°-180°	127.2	1.2
0°-30°	1844.8	18.1
0°-40°	2959.4	29.0
0°-60°	5043.4	49.5
0°-90°	6276.4	61.6
90°-120°	644.2	6.3
90°-150°	2848.4	27.9
90°-180°	3919.0	38.4
0°-180°	10195.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2466	2466	2466	2466	2466	
5°	2466	2457	2430	2449	2445	234
15°	2348	2333	2302	2312	2300	661
25°	2125	2106	2066	2070	2066	978
35°	1833	1809	1771	1757	1745	1145
45°	1492	1475	1439	1413	1404	1151
55°	1129	1114	1086	1058	1046	1009
65°	761	747	723	702	690	753
75°	398	394	382	368	372	425
85°	97	95	93	85	83	108
90°	1	12	19	24	26	9
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P914205

CATALOG NUMBER: DFN2DIP-PN4F0-080D050US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2465.9	2465.9	2465.9	2465.9	2465.9
2.5°	2480.2	2468.4	2442.3	2465.9	2461.4
5°	2465.9	2456.6	2430.5	2449.3	2444.8
7.5°	2449.3	2435.2	2409.1	2428.2	2423.4
10°	2423.4	2406.8	2378.4	2397.2	2390.2
12.5°	2387.7	2373.6	2345.2	2357.0	2352.2
15°	2347.5	2333.4	2302.4	2312.0	2300.2
17.5°	2297.6	2283.5	2252.6	2264.4	2252.6
20°	2243.1	2229.0	2195.8	2202.8	2193.5
22.5°	2188.7	2167.3	2136.4	2136.4	2131.6
25°	2124.6	2105.7	2065.5	2070.0	2065.5
27.5°	2053.3	2036.8	2006.0	1999.0	1987.2
30°	1982.4	1963.3	1927.9	1920.8	1911.2
32.5°	1906.5	1892.4	1854.3	1840.0	1830.5
35°	1832.9	1809.3	1771.3	1757.0	1745.2
37.5°	1749.9	1728.5	1690.6	1674.0	1662.2
40°	1664.7	1645.5	1607.6	1586.4	1576.8
42.5°	1581.7	1562.5	1524.8	1500.9	1486.8
45°	1491.6	1475.0	1439.2	1413.3	1403.8
47.5°	1403.8	1387.2	1349.2	1323.0	1308.9
50°	1311.2	1299.4	1266.1	1233.0	1221.1
52.5°	1221.1	1204.5	1173.9	1147.7	1131.1
55°	1128.8	1114.4	1086.1	1057.6	1045.8
57.5°	1036.3	1024.4	993.5	965.0	955.4
60°	943.6	934.4	901.1	875.0	867.9
62.5°	853.6	837.0	813.3	789.7	780.1
65°	761.3	746.9	723.3	701.9	690.1
67.5°	666.4	654.3	633.2	616.6	607.0
70°	578.6	569.0	547.7	531.1	521.7
72.5°	488.5	479.0	467.1	450.6	443.5
75°	398.2	393.7	381.7	367.6	372.3
77.5°	317.7	308.2	303.4	296.4	289.3
80°	237.3	234.7	230.0	222.9	218.1
82.5°	161.3	161.3	159.0	149.4	149.4
85°	97.1	94.8	92.6	85.3	83.0
87.5°	42.8	38.0	33.2	26.1	23.7
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4



TEST NUMBER: P914205

CATALOG NUMBER: DFN2DIP-PN4F0-080D050US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P914205

CATALOG NUMBER: DFN2DIP-PN4F0-080D050US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.32	11.30	11.18	12.17	13.27	9.88	10.86	10.73	11.73	12.83
	3H	12.00	12.87	12.86	13.75	14.88	11.51	12.39	12.37	13.27	14.39
	4H	12.59	13.42	13.47	14.31	15.44	12.10	12.93	12.98	13.82	14.95
	6H	13.00	13.76	13.89	14.66	15.80	12.51	13.27	13.40	14.17	15.31
	8H	13.11	13.84	14.01	14.75	15.89	12.62	13.34	13.51	14.26	15.40
	12H	13.16	13.85	14.07	14.76	15.93	12.66	13.35	13.57	14.26	15.43
4H	2H	10.80	11.63	11.68	12.52	13.65	10.45	11.28	11.33	12.17	13.30
	3H	12.68	13.37	13.57	14.29	15.44	12.28	12.97	13.17	13.89	15.04
	4H	13.40	14.03	14.31	14.95	16.12	12.98	13.61	13.89	14.53	15.70
	6H	13.92	14.47	14.85	15.41	16.58	13.50	14.04	14.42	14.99	16.16
	8H	14.08	14.59	15.00	15.52	16.71	13.65	14.16	14.57	15.09	16.28
	12H	14.16	14.62	15.10	15.57	16.76	13.72	14.18	14.66	15.13	16.32
8H	4H	13.61	14.12	14.53	15.05	16.24	13.24	13.74	14.16	14.68	15.87
	6H	14.25	14.67	15.20	15.64	16.83	13.87	14.29	14.82	15.27	16.45
	8H	14.47	14.84	15.43	15.81	17.01	14.08	14.46	15.05	15.42	16.63
	12H	14.61	14.94	15.57	15.90	17.15	14.21	14.53	15.17	15.49	16.75
12H	4H	13.60	14.06	14.54	15.01	16.20	13.24	13.69	14.18	14.65	15.84
	6H	14.28	14.65	15.24	15.62	16.82	13.91	14.29	14.87	15.25	16.46
	8H	14.53	14.85	15.49	15.81	17.07	14.15	14.48	15.12	15.44	16.70