

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914226

Luminaire Tested: DFN2DIP-PN4F0-080D100US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914226
REPORT IS A COMBINATION OF REPORTS P899726 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-080D100US927-RLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12397.6 lumens
Efficiency: N/A
Efficacy: 81.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 152.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914226

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US927-RLLFLL

Luminous Intensity Polar Plot

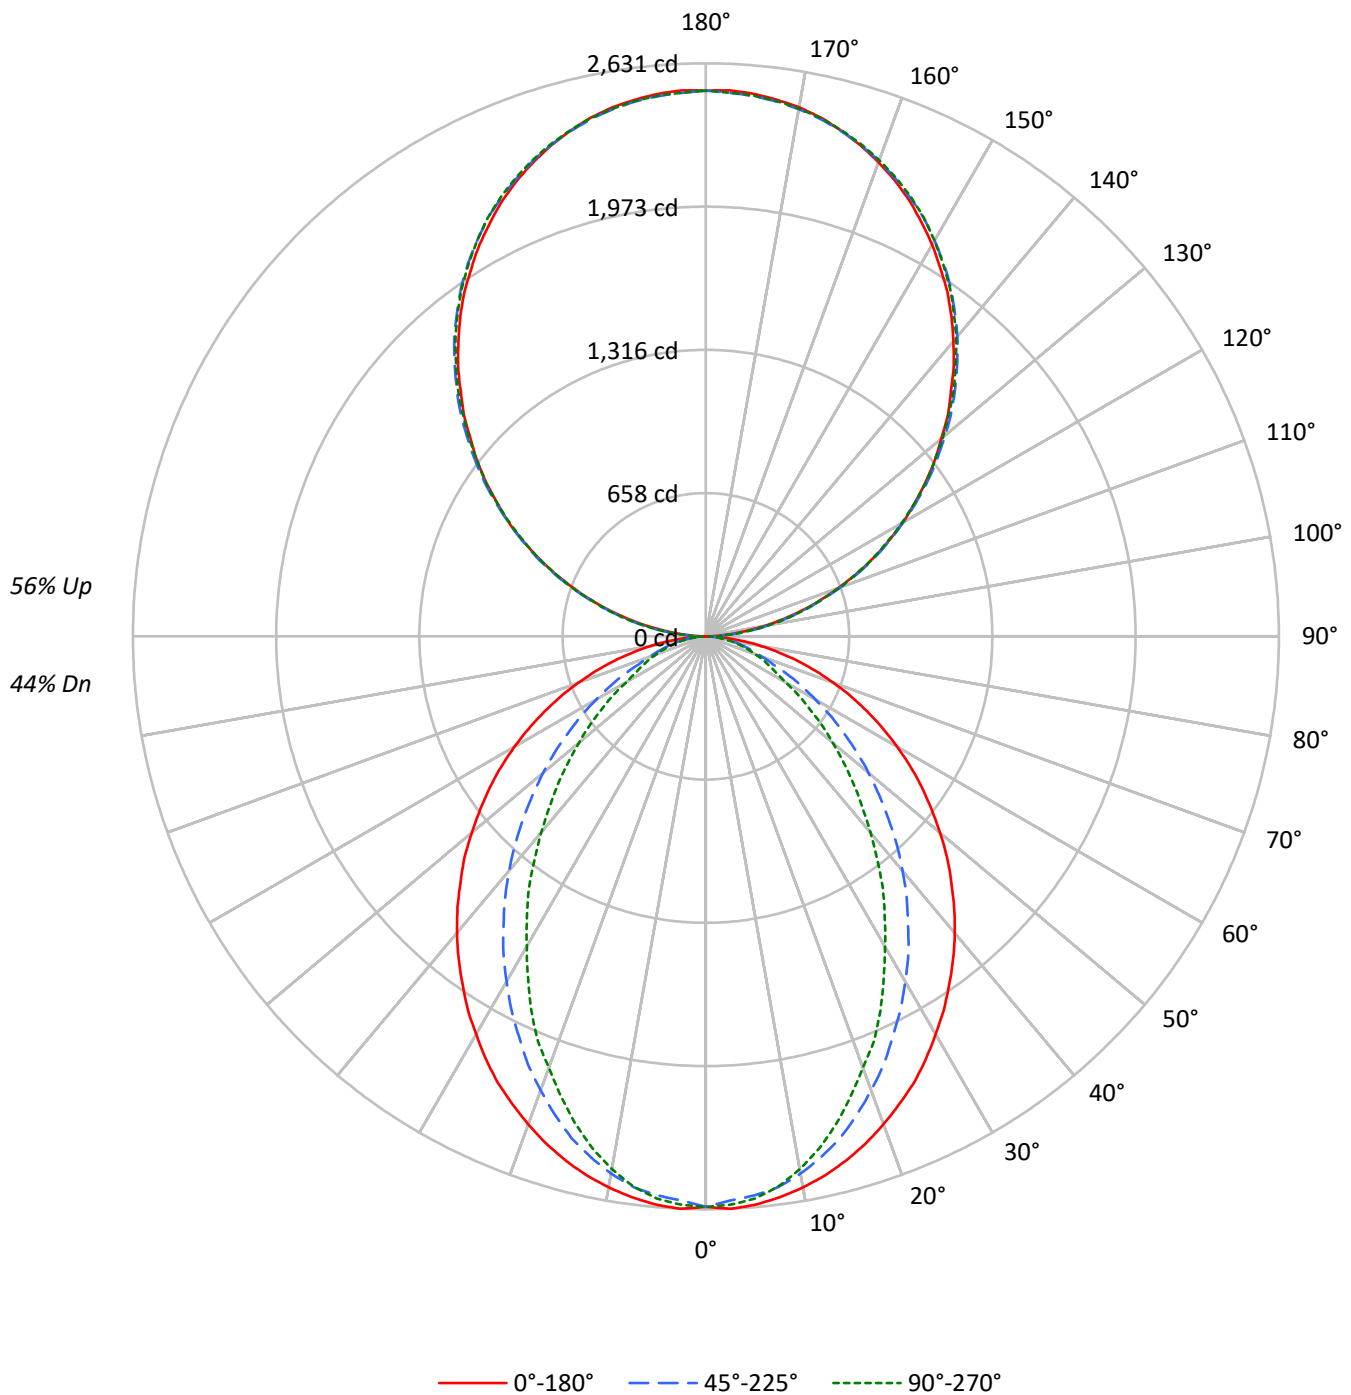

TEST NUMBER: P914226

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	70	68	66	57	56	54	45	44	43
2	88	81	75	71	81	75	70	65	62	59	55	51	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	40	41	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	37	33	30	29	27	25
6	63	51	43	38	57	47	41	35	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	25	22	20
8	54	42	35	30	50	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1912	1912	1912
5°	1915	1882	1894
10°	1896	1845	1833
15°	1870	1784	1738
20°	1835	1701	1621
25°	1800	1607	1508
30°	1753	1510	1365
35°	1706	1407	1240
40°	1659	1299	1096
45°	1604	1180	965
50°	1547	1060	838
55°	1487	931	715
60°	1419	797	589
65°	1340	660	530
70°	1244	533	481
75°	1123	470	438
80°	949	395	381
85°	661	265	289

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1963 cd/sqm

TEST NUMBER: P914226

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	245.5	2.0
10°-20°	673.9	5.4
20°-30°	946.1	7.6
30°-40°	1031.3	8.3
40°-50°	947.9	7.6
50°-60°	744.4	6.0
60°-70°	484.5	3.9
70°-80°	249.4	2.0
80°-90°	70.8	0.6
90°-100°	155.0	1.3
100°-110°	492.6	4.0
110°-120°	843.0	6.8
120°-130°	1108.6	8.9
130°-140°	1244.4	10.0
140°-150°	1220.3	9.8
150°-160°	1023.6	8.3
160°-170°	678.9	5.5
170°-180°	237.3	1.9
0°-30°	1865.5	15.0
0°-40°	2896.8	23.4
0°-60°	4589.2	37.0
0°-90°	5393.9	43.5
90°-120°	1490.6	12.0
90°-150°	5063.9	40.8
90°-180°	7004.0	56.5
0°-180°	12397.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2619	2619	2619	2619	2619	
5°	2619	2608	2576	2598	2591	248
15°	2491	2465	2385	2340	2316	702
25°	2261	2186	2029	1932	1896	1040
35°	1948	1828	1619	1470	1417	1220
45°	1593	1434	1185	1017	960	1230
55°	1211	1026	770	628	583	1082
65°	818	626	412	332	325	811
75°	436	270	190	173	171	461
85°	102	52	45	45	45	117
90°	2	27	74	70	72	12
95°	110	131	135	135	131	123
105°	455	461	465	469	469	480
115°	846	858	854	852	846	837
125°	1230	1249	1243	1236	1234	1100
135°	1591	1615	1619	1617	1611	1230
145°	1932	1947	1959	1962	1953	1207
155°	2209	2215	2222	2233	2226	1017
165°	2403	2401	2401	2416	2406	678
175°	2501	2495	2490	2505	2492	238
180°	2505	2505	2505	2505	2505	

TEST NUMBER: P914226

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US927-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2619.3	2619.3	2619.3	2619.3	2619.3
2.5°	2631.1	2619.3	2593.1	2617.0	2612.2
5°	2619.3	2607.5	2576.5	2597.9	2590.8
7.5°	2597.9	2583.8	2550.6	2559.9	2548.1
10°	2569.4	2552.9	2505.6	2498.3	2484.2
12.5°	2534.0	2512.6	2448.5	2434.4	2408.2
15°	2491.3	2465.1	2384.6	2339.6	2315.9
17.5°	2441.4	2403.5	2303.9	2251.9	2213.8
20°	2384.6	2337.1	2218.7	2159.6	2107.2
22.5°	2323.0	2268.4	2130.9	2050.4	2014.9
25°	2261.4	2185.5	2029.0	1932.0	1896.2
27.5°	2187.9	2107.2	1934.2	1822.8	1768.2
30°	2109.7	2019.4	1829.9	1709.1	1645.0
32.5°	2033.8	1924.7	1730.5	1588.2	1528.8
35°	1948.5	1827.6	1619.1	1469.7	1417.4
37.5°	1865.5	1735.0	1514.7	1351.0	1291.9
40°	1777.8	1635.7	1405.6	1237.3	1175.7
42.5°	1687.7	1536.1	1296.6	1121.2	1062.0
45°	1592.9	1434.0	1185.3	1016.8	960.0
47.5°	1502.9	1334.7	1078.6	910.1	858.1
50°	1403.3	1235.1	974.3	810.6	761.0
52.5°	1306.0	1128.1	874.6	718.3	673.3
55°	1211.2	1026.3	770.3	628.2	583.2
57.5°	1114.1	924.5	678.0	545.3	507.2
60°	1014.5	824.9	580.7	459.9	422.0
62.5°	917.4	727.8	497.7	384.0	365.2
65°	817.8	625.7	412.4	332.0	324.6
67.5°	723.0	530.9	332.0	291.4	284.5
70°	623.4	438.6	274.9	251.2	241.7
72.5°	528.6	353.1	229.9	211.0	206.2
75°	436.1	270.1	189.6	173.0	170.8
77.5°	343.8	191.9	149.4	139.8	135.1
80°	258.3	137.6	113.7	104.3	104.3
82.5°	180.1	92.5	78.2	73.4	73.4
85°	101.9	52.0	45.0	45.0	45.0
87.5°	37.9	18.9	18.9	16.6	16.6
90°	2.3	27.2	74.0	69.5	71.8
92.5°	46.8	63.5	65.8	68.0	68.0
95°	110.3	131.4	135.2	135.2	131.4
97.5°	183.5	203.2	211.5	211.5	211.5
100°	268.2	285.5	291.5	291.5	289.3
102.5°	357.3	370.1	378.4	380.6	378.4
105°	454.7	460.7	465.2	469.1	469.1
107.5°	551.4	560.5	560.5	562.0	551.4
110°	645.1	657.1	657.1	657.1	651.1

TEST NUMBER: P914226

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.2	759.1	756.8	750.8	746.2
115°	846.0	858.0	854.3	852.0	846.0
117.5°	944.9	961.5	950.9	944.9	938.8
120°	1044.6	1061.2	1044.6	1044.6	1037.8
122.5°	1135.2	1156.3	1145.8	1139.8	1135.2
125°	1230.4	1249.3	1243.2	1236.4	1234.2
127.5°	1323.3	1346.7	1338.4	1329.4	1323.3
130°	1410.2	1437.3	1433.6	1429.0	1420.8
132.5°	1507.6	1528.8	1530.3	1519.7	1513.6
135°	1591.4	1614.9	1619.4	1617.2	1611.1
137.5°	1685.1	1704.0	1707.8	1706.3	1697.2
140°	1767.4	1786.3	1796.9	1796.9	1788.6
142.5°	1852.0	1870.9	1876.9	1879.2	1870.9
145°	1932.1	1947.2	1959.3	1961.5	1953.2
147.5°	2003.8	2022.8	2031.8	2035.6	2027.3
150°	2077.9	2090.7	2099.0	2105.8	2099.0
152.5°	2143.6	2156.4	2167.0	2175.3	2167.0
155°	2209.3	2215.3	2222.1	2232.7	2225.9
157.5°	2266.0	2270.5	2274.3	2289.3	2278.8
160°	2316.6	2321.1	2323.3	2336.1	2327.1
162.5°	2363.4	2363.4	2365.6	2379.9	2369.4
165°	2403.4	2401.1	2401.1	2416.2	2405.7
167.5°	2439.7	2432.9	2432.9	2448.0	2437.4
170°	2466.9	2460.8	2458.5	2473.7	2460.8
172.5°	2485.7	2479.7	2477.4	2492.5	2479.7
175°	2500.8	2494.8	2490.3	2505.4	2492.5
177.5°	2509.2	2503.1	2498.5	2511.4	2498.5
180°	2505.4	2505.4	2505.4	2505.4	2505.4

TEST NUMBER: P914226

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.77	9.55	9.78	10.57	11.93	4.73	5.51	5.75	6.53	7.90
	3H	10.44	11.14	11.47	12.17	13.55	5.92	6.61	6.94	7.64	9.03
	4H	11.05	11.71	12.09	12.74	14.14	6.37	7.03	7.41	8.06	9.45
	6H	11.47	12.08	12.52	13.12	14.52	6.68	7.29	7.73	8.33	9.73
	8H	11.60	12.18	12.65	13.23	14.63	6.77	7.35	7.83	8.41	9.80
	12H	11.66	12.21	12.72	13.26	14.68	6.82	7.36	7.88	8.41	9.83
4H	2H	8.78	9.44	9.82	10.47	11.86	5.32	5.98	6.37	7.02	8.41
	3H	10.61	11.15	11.66	12.22	13.62	6.67	7.22	7.72	8.28	9.68
	4H	11.30	11.80	12.36	12.85	14.28	7.22	7.72	8.28	8.77	10.20
	6H	11.81	12.24	12.88	13.32	14.74	7.63	8.06	8.70	9.14	10.56
	8H	11.99	12.39	13.06	13.46	14.90	7.76	8.16	8.83	9.23	10.67
	12H	12.08	12.45	13.17	13.53	14.97	7.82	8.19	8.91	9.27	10.71
8H	4H	11.26	11.66	12.33	12.73	14.17	7.49	7.90	8.56	8.96	10.40
	6H	11.83	12.16	12.92	13.27	14.71	8.01	8.34	9.10	9.45	10.89
	8H	12.05	12.34	13.15	13.43	14.89	8.20	8.49	9.30	9.59	11.04
	12H	12.19	12.44	13.29	13.53	15.02	8.32	8.58	9.42	9.66	11.16
12H	4H	11.21	11.58	12.30	12.66	14.10	7.50	7.86	8.58	8.94	10.38
	6H	11.81	12.10	12.90	13.19	14.64	8.06	8.35	9.16	9.45	10.90
	8H	12.03	12.28	13.13	13.37	14.86	8.27	8.53	9.37	9.61	11.11

END OF REPORT

FIELD PERFORMANCE MAY DIFFER FROM LABORATORY PERFORMANCE

8 of 8