

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914377

Luminaire Tested: DFN2DIP-PN4F0-120D120US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914377
REPORT IS A COMBINATION OF REPORTS P901289 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-120D120US927-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18822.2 lumens
Efficiency: N/A
Efficacy: 81.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 229.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914377

CATALOG NUMBER: DFN2DIP-PN4F0-120D120US927-FLLONL

Luminous Intensity Polar Plot

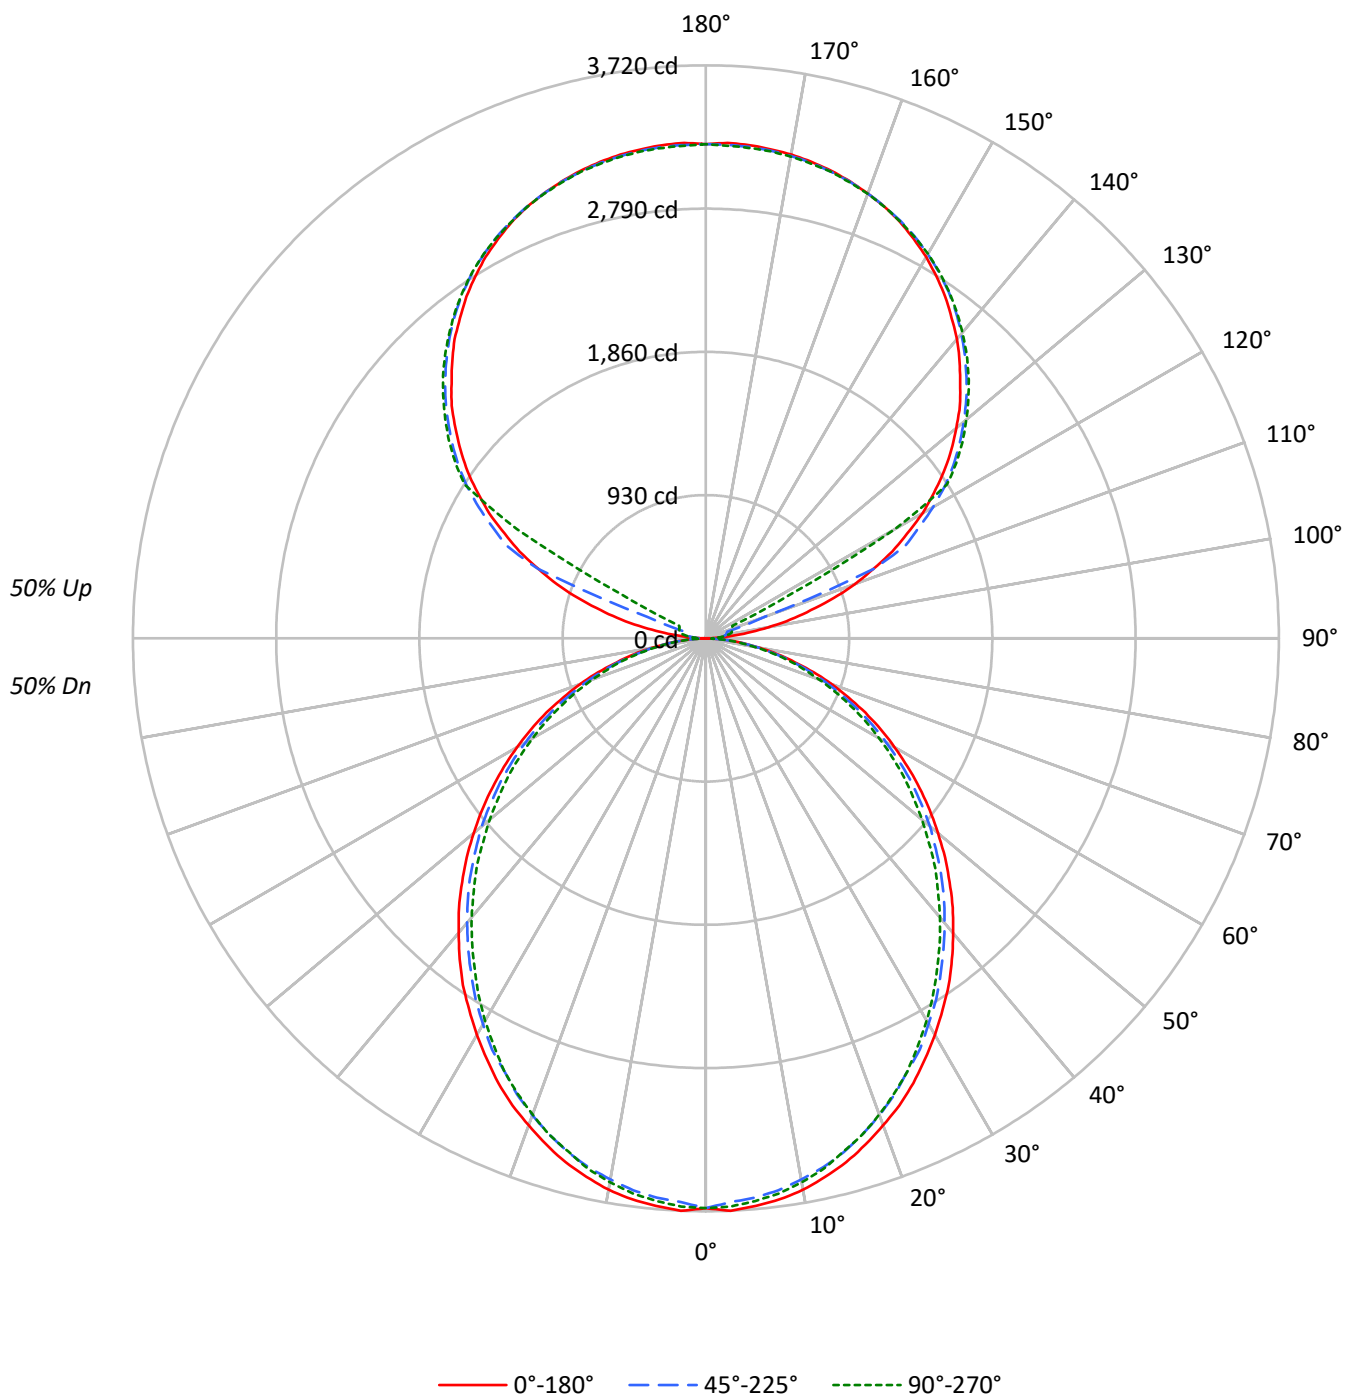

TEST NUMBER: P914377

CATALOG NUMBER: DFN2DIP-PN4F0-120D120US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2700	2700	2700
5°	2704	2663	2681
10°	2682	2627	2645
15°	2643	2584	2589
20°	2590	2525	2531
25°	2537	2453	2465
30°	2470	2387	2380
35°	2407	2308	2290
40°	2330	2229	2204
45°	2252	2149	2117
50°	2168	2066	2016
55°	2079	1970	1923
60°	1979	1855	1817
65°	1870	1737	1691
70°	1732	1592	1556
75°	1539	1419	1432
80°	1307	1199	1195
85°	946	819	799

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2252 cd/sqm

TEST NUMBER: P914377

CATALOG NUMBER: DFN2DIP-PN4F0-120D120US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	348.1	1.8
10°-20°	979.5	5.2
20°-30°	1439.5	7.6
30°-40°	1671.9	8.9
40°-50°	1669.9	8.9
50°-60°	1456.0	7.7
60°-70°	1076.3	5.7
70°-80°	609.0	3.2
80°-90°	166.4	0.9
90°-100°	105.8	0.6
100°-110°	394.4	2.1
110°-120°	1045.9	5.6
120°-130°	1734.7	9.2
130°-140°	1842.7	9.8
140°-150°	1712.6	9.1
150°-160°	1376.9	7.3
160°-170°	887.2	4.7
170°-180°	305.4	1.6
0°-30°	2767.2	14.7
0°-40°	4439.1	23.6
0°-60°	7565.0	40.2
0°-90°	9416.7	50.0
90°-120°	1546.1	8.2
90°-150°	6836.0	36.3
90°-180°	9405.0	50.0
0°-180°	18822.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3699	3699	3699	3699	3699	
5°	3699	3685	3646	3674	3667	351
15°	3521	3500	3454	3468	3450	992
25°	3187	3158	3098	3105	3098	1466
35°	2749	2714	2657	2636	2618	1717
45°	2237	2212	2159	2120	2106	1727
55°	1693	1672	1629	1586	1569	1514
65°	1142	1120	1085	1053	1035	1129
75°	597	591	572	551	558	638
85°	146	142	139	128	124	162
90°	2	28	46	58	63	17
95°	151	74	90	102	100	179
105°	706	776	142	167	176	754
115°	1335	1374	1432	358	190	1314
125°	1887	1918	1962	1978	1985	1683
135°	2335	2373	2393	2417	2412	1804
145°	2709	2707	2746	2762	2751	1694
155°	2983	2962	2990	3004	2986	1375
165°	3143	3129	3136	3153	3136	888
175°	3215	3199	3204	3220	3197	306
180°	3208	3208	3208	3208	3208	

TEST NUMBER: P914377

CATALOG NUMBER: DFN2DIP-PN4F0-120D120US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3698.9	3698.9	3698.9	3698.9	3698.9
2.5°	3720.4	3702.7	3663.4	3698.9	3692.1
5°	3698.9	3684.9	3645.7	3674.0	3667.2
7.5°	3674.0	3652.8	3613.6	3642.3	3635.2
10°	3635.2	3610.2	3567.6	3595.9	3585.3
12.5°	3581.5	3560.4	3517.8	3535.5	3528.3
15°	3521.2	3500.0	3453.6	3467.9	3450.2
17.5°	3446.5	3425.3	3378.9	3396.6	3378.9
20°	3364.6	3343.4	3293.7	3304.2	3290.2
22.5°	3283.0	3251.0	3204.5	3204.5	3197.4
25°	3186.8	3158.5	3098.1	3105.0	3098.1
27.5°	3080.0	3055.1	3009.1	2998.5	2980.8
30°	2973.6	2944.9	2891.7	2881.2	2866.8
32.5°	2859.6	2838.5	2781.5	2760.0	2745.7
35°	2749.4	2714.0	2657.0	2635.5	2617.8
37.5°	2624.9	2592.9	2535.9	2511.0	2493.2
40°	2497.0	2468.4	2411.3	2379.6	2365.3
42.5°	2372.5	2343.8	2287.2	2251.4	2230.2
45°	2237.4	2212.5	2158.9	2120.0	2105.7
47.5°	2105.7	2080.7	2023.8	1984.6	1963.4
50°	1966.8	1949.1	1899.3	1849.4	1831.7
52.5°	1831.7	1806.8	1760.8	1721.5	1696.6
55°	1693.2	1671.7	1629.0	1586.4	1568.7
57.5°	1554.3	1536.6	1490.2	1447.6	1433.2
60°	1415.5	1401.5	1351.7	1312.5	1301.9
62.5°	1280.4	1255.4	1220.0	1184.5	1170.2
65°	1141.9	1120.4	1084.9	1052.8	1035.1
67.5°	999.7	981.5	949.8	925.0	910.6
70°	867.9	853.6	821.5	796.6	782.7
72.5°	732.8	718.5	700.8	675.9	665.3
75°	597.4	590.6	572.4	551.4	558.5
77.5°	476.6	462.2	455.1	444.5	434.0
80°	355.8	352.0	344.9	334.4	327.2
82.5°	241.9	241.9	238.5	224.2	224.2
85°	145.7	142.3	138.9	127.9	124.5
87.5°	64.2	57.0	49.8	39.2	35.5
90°	2.2	27.8	46.3	58.1	62.6
92.5°	58.1	48.8	55.7	60.4	62.6
95°	150.8	74.1	90.4	102.3	99.8
97.5°	271.6	81.4	118.3	125.4	127.6
100°	411.0	92.9	132.3	150.8	155.5
102.5°	564.0	559.6	137.0	162.4	169.5
105°	705.7	775.5	141.7	167.1	176.4
107.5°	870.5	928.4	146.4	171.7	181.1
110°	1028.5	1077.0	406.3	174.2	183.3

TEST NUMBER: P914377

CATALOG NUMBER: DFN2DIP-PN4F0-120D120US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1177.1	1218.7	1179.3	178.6	185.8
115°	1334.7	1374.2	1432.3	357.5	190.5
117.5°	1471.8	1518.1	1557.8	1225.6	617.5
120°	1625.1	1659.8	1701.7	1729.6	1416.1
122.5°	1754.9	1792.2	1838.7	1852.5	1855.0
125°	1887.2	1917.6	1961.7	1977.9	1984.8
127.5°	2007.9	2040.5	2075.5	2098.6	2100.9
130°	2121.8	2159.0	2184.4	2210.0	2207.8
132.5°	2237.8	2268.2	2293.5	2314.5	2312.3
135°	2335.4	2372.7	2393.3	2416.8	2412.1
137.5°	2437.5	2465.3	2488.7	2511.8	2505.0
140°	2537.3	2556.0	2581.3	2602.3	2590.7
142.5°	2621.0	2637.3	2667.4	2685.8	2674.2
145°	2709.3	2706.8	2746.2	2762.5	2750.8
147.5°	2785.6	2778.7	2818.2	2829.8	2820.6
150°	2860.0	2843.8	2881.0	2894.8	2883.2
152.5°	2922.6	2904.1	2938.9	2952.9	2936.7
155°	2983.0	2962.3	2990.2	3004.0	2985.5
157.5°	3031.8	3013.3	3034.3	3050.5	3031.8
160°	3073.7	3059.6	3073.7	3087.4	3071.2
162.5°	3110.7	3096.9	3108.4	3124.7	3103.8
165°	3143.1	3129.4	3136.2	3152.6	3136.2
167.5°	3168.8	3154.7	3161.9	3178.2	3157.2
170°	3189.7	3175.7	3180.4	3196.6	3175.7
172.5°	3203.5	3189.7	3194.5	3210.7	3189.7
175°	3215.1	3198.8	3203.5	3219.8	3196.6
177.5°	3219.8	3203.5	3206.0	3222.3	3201.4
180°	3208.3	3208.3	3208.3	3208.3	3208.3

TEST NUMBER: P914377

CATALOG NUMBER: DFN2DIP-PN4F0-120D120US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.73	11.59	11.69	12.57	13.84	10.29	11.15	11.25	12.13	13.40
	3H	12.40	13.17	13.36	14.15	15.44	11.91	12.68	12.88	13.67	14.96
	4H	12.99	13.72	13.97	14.70	16.00	12.50	13.23	13.48	14.22	15.52
	6H	13.39	14.06	14.38	15.05	16.37	12.90	13.57	13.89	14.56	15.87
	8H	13.49	14.14	14.49	15.14	16.45	13.00	13.64	14.00	14.65	15.96
	12H	13.54	14.15	14.55	15.15	16.49	13.04	13.65	14.05	14.66	15.99
4H	2H	11.19	11.93	12.18	12.91	14.21	10.84	11.57	11.83	12.56	13.86
	3H	13.06	13.67	14.06	14.69	16.00	12.66	13.27	13.66	14.29	15.60
	4H	13.78	14.34	14.79	15.35	16.68	13.36	13.92	14.37	14.93	16.27
	6H	14.30	14.78	15.31	15.81	17.15	13.87	14.35	14.89	15.39	16.72
	8H	14.45	14.90	15.47	15.92	17.27	14.02	14.47	15.04	15.49	16.84
	12H	14.52	14.93	15.56	15.97	17.33	14.08	14.49	15.12	15.53	16.89
8H	4H	13.98	14.43	15.00	15.45	16.80	13.61	14.06	14.62	15.08	16.43
	6H	14.61	14.98	15.65	16.05	17.40	14.24	14.61	15.28	15.67	17.02
	8H	14.83	15.16	15.88	16.21	17.58	14.45	14.78	15.50	15.83	17.20
	12H	14.97	15.26	16.02	16.30	17.71	14.57	14.85	15.62	15.90	17.31
12H	4H	13.96	14.37	15.00	15.41	16.76	13.60	14.01	14.64	15.05	16.40
	6H	14.64	14.97	15.69	16.02	17.39	14.28	14.60	15.33	15.66	17.02
	8H	14.89	15.17	15.94	16.22	17.63	14.51	14.80	15.57	15.85	17.26

END OF REPORT