

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916791

Luminaire Tested: DFN2DIP-PN4F0-040D050US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916791
REPORT IS A COMBINATION OF REPORTS P901148 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-040D050US930-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6807.8 lumens
Efficiency: N/A
Efficacy: 95.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 71
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916791

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US930-RLLONL

Luminous Intensity Polar Plot

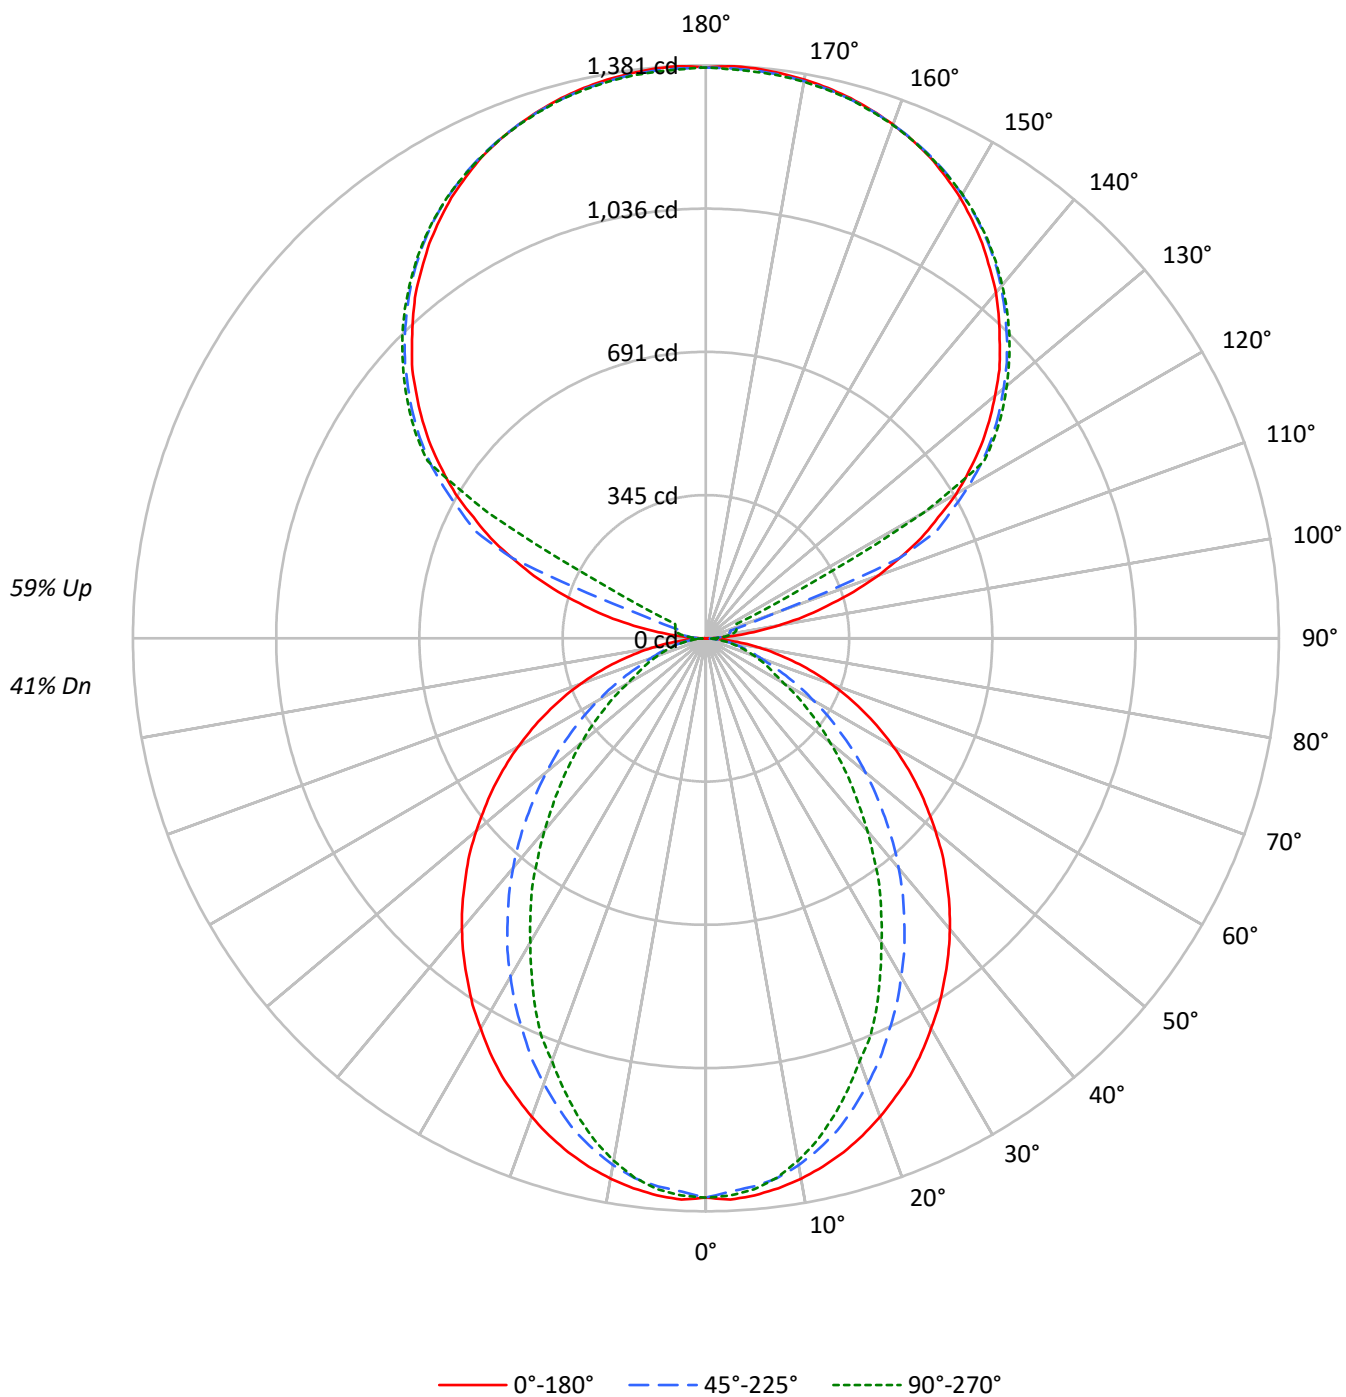

TEST NUMBER: P916791

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48
1	96	92	88	85	87	84	81	78	69	67	65	55	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	57	54	49	47	44	38	36	35
3	80	71	64	59	73	65	59	54	54	50	46	44	41	38	34	32	30
4	74	63	56	50	67	58	52	46	48	43	40	39	36	33	31	28	26
5	68	57	49	43	62	52	45	40	43	38	34	35	32	29	28	25	23
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	25	23	21
7	58	46	38	33	53	42	36	31	36	30	27	29	25	23	23	21	19
8	54	42	34	29	49	39	32	27	33	27	24	27	23	20	21	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	28	23	19	23	19	17	18	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	984	984	984
5°	985	968	975
10°	976	949	943
15°	962	918	894
20°	944	875	834
25°	926	827	776
30°	902	777	703
35°	878	724	638
40°	854	669	564
45°	825	607	497
50°	796	545	431
55°	765	479	368
60°	730	410	303
65°	689	340	273
70°	640	274	247
75°	578	242	225
80°	488	203	196
85°	340	137	149

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 825 cd/sqm

TEST NUMBER: P916791

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	126.3	1.9
10°-20°	346.8	5.1
20°-30°	486.9	7.2
30°-40°	530.7	7.8
40°-50°	487.8	7.2
50°-60°	383.1	5.6
60°-70°	249.3	3.7
70°-80°	128.4	1.9
80°-90°	35.2	0.5
90°-100°	45.4	0.7
100°-110°	169.1	2.5
110°-120°	448.5	6.6
120°-130°	743.9	10.9
130°-140°	790.2	11.6
140°-150°	734.4	10.8
150°-160°	590.4	8.7
160°-170°	380.5	5.6
170°-180°	130.9	1.9
0°-30°	960.0	14.1
0°-40°	1490.7	21.9
0°-60°	2361.5	34.7
0°-90°	2774.4	40.8
90°-120°	663.0	9.7
90°-150°	2931.5	43.1
90°-180°	4033.0	59.2
0°-180°	6807.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1348	1348	1348	1348	1348	
5°	1348	1342	1326	1337	1333	128
15°	1282	1268	1227	1204	1192	361
25°	1164	1125	1044	994	976	535
35°	1003	940	833	756	729	628
45°	820	738	610	523	494	633
55°	623	528	396	323	300	557
65°	421	322	212	171	167	417
75°	224	139	98	89	88	237
85°	52	27	23	23	23	60
90°	1	12	20	25	27	6
95°	65	32	39	44	43	77
105°	303	333	61	72	76	323
115°	572	589	614	153	82	564
125°	809	822	841	848	851	722
135°	1002	1018	1026	1036	1034	774
145°	1162	1161	1178	1185	1180	727
155°	1279	1270	1282	1288	1280	589
165°	1348	1342	1345	1352	1345	381
175°	1379	1372	1374	1381	1371	131
180°	1376	1376	1376	1376	1376	

TEST NUMBER: P916791

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1347.9	1347.9	1347.9	1347.9	1347.9
2.5°	1354.0	1347.9	1334.4	1346.7	1344.2
5°	1347.9	1341.7	1325.8	1336.8	1333.3
7.5°	1336.8	1329.6	1312.5	1317.3	1311.2
10°	1322.3	1313.7	1289.3	1285.6	1278.4
12.5°	1304.0	1293.0	1260.0	1252.7	1239.3
15°	1282.0	1268.5	1227.1	1204.0	1191.8
17.5°	1256.4	1236.8	1185.5	1158.8	1139.2
20°	1227.1	1202.6	1141.7	1111.3	1084.3
22.5°	1195.4	1167.3	1096.5	1055.1	1036.9
25°	1163.7	1124.6	1044.1	994.2	975.7
27.5°	1125.9	1084.3	995.3	938.0	909.9
30°	1085.7	1039.2	941.6	879.5	846.5
32.5°	1046.6	990.4	890.5	817.3	786.7
35°	1002.7	940.4	833.2	756.3	729.4
37.5°	960.0	892.8	779.4	695.2	664.8
40°	914.8	841.7	723.3	636.7	605.0
42.5°	868.5	790.4	667.2	576.9	546.5
45°	819.7	737.9	609.9	523.3	494.0
47.5°	773.4	686.8	555.1	468.4	441.6
50°	722.1	635.5	501.3	417.1	391.6
52.5°	672.1	580.6	450.1	369.6	346.4
55°	623.3	528.2	396.4	323.3	300.1
57.5°	573.3	475.7	348.9	280.5	261.1
60°	522.0	424.4	298.8	236.7	217.2
62.5°	472.1	374.5	256.1	197.6	187.9
65°	420.9	322.0	212.2	170.8	167.1
67.5°	372.1	273.2	170.8	150.0	146.3
70°	320.8	225.7	141.5	129.3	124.3
72.5°	272.1	181.7	118.3	108.6	106.2
75°	224.4	139.0	97.6	89.0	87.9
77.5°	176.9	98.7	76.9	72.0	69.5
80°	132.9	70.8	58.5	53.7	53.7
82.5°	92.7	47.6	40.3	37.7	37.7
85°	52.4	26.8	23.2	23.2	23.2
87.5°	19.6	9.7	9.7	8.6	8.6
90°	1.0	11.9	19.9	24.9	26.8
92.5°	24.9	21.0	23.9	25.9	26.8
95°	64.7	31.8	38.8	43.9	42.8
97.5°	116.4	34.9	50.7	53.8	54.7
100°	176.3	39.9	56.7	64.7	66.7
102.5°	241.9	239.9	58.8	69.6	72.7
105°	302.6	332.6	60.7	71.7	75.7
107.5°	373.3	398.1	62.8	73.6	77.7
110°	441.1	461.9	174.2	74.7	78.6

TEST NUMBER: P916791

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.8	522.6	505.7	76.6	79.7
115°	572.4	589.3	614.2	153.4	81.7
117.5°	631.1	651.0	668.1	525.5	264.8
120°	696.8	711.8	729.7	741.7	607.2
122.5°	752.5	768.5	788.5	794.4	795.5
125°	809.3	822.3	841.2	848.2	851.2
127.5°	861.0	875.0	890.1	899.9	900.9
130°	909.9	925.9	936.7	947.7	946.8
132.5°	959.7	972.7	983.5	992.5	991.6
135°	1001.5	1017.5	1026.3	1036.4	1034.4
137.5°	1045.2	1057.2	1067.2	1077.2	1074.2
140°	1088.0	1096.1	1106.9	1115.9	1111.0
142.5°	1124.0	1131.0	1143.9	1151.8	1146.8
145°	1161.8	1160.7	1177.6	1184.6	1179.7
147.5°	1194.6	1191.6	1208.5	1213.5	1209.6
150°	1226.5	1219.5	1235.4	1241.4	1236.4
152.5°	1253.3	1245.4	1260.3	1266.3	1259.3
155°	1279.2	1270.3	1282.2	1288.2	1280.3
157.5°	1300.1	1292.2	1301.1	1308.1	1300.1
160°	1318.1	1312.1	1318.1	1324.0	1317.0
162.5°	1333.9	1328.0	1332.9	1339.9	1331.0
165°	1347.9	1342.0	1344.9	1351.8	1344.9
167.5°	1358.9	1352.8	1355.9	1362.9	1353.9
170°	1367.8	1361.8	1363.8	1370.8	1361.8
172.5°	1373.8	1367.8	1369.9	1376.8	1367.8
175°	1378.8	1371.7	1373.8	1380.7	1370.8
177.5°	1380.7	1373.8	1374.8	1381.8	1372.8
180°	1375.7	1375.7	1375.7	1375.7	1375.7

TEST NUMBER: P916791

CATALOG NUMBER: DFN2DIP-PN4F0-040D050US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.17	6.93	7.21	7.97	9.37	2.13	2.89	3.17	3.93	5.33
	3H	7.84	8.52	8.89	9.57	10.99	3.32	4.00	4.37	5.05	6.46
	4H	8.45	9.09	9.51	10.15	11.57	3.76	4.41	4.83	5.46	6.89
	6H	8.87	9.46	9.94	10.52	11.96	4.08	4.68	5.15	5.73	7.17
	8H	9.00	9.56	10.07	10.63	12.06	4.17	4.73	5.25	5.81	7.24
	12H	9.06	9.59	10.14	10.66	12.11	4.21	4.75	5.29	5.81	7.27
4H	2H	6.18	6.82	7.25	7.87	9.30	2.72	3.36	3.79	4.42	5.84
	3H	8.00	8.54	9.08	9.62	11.06	4.07	4.60	5.14	5.68	7.12
	4H	8.70	9.19	9.78	10.26	11.72	4.61	5.10	5.69	6.17	7.63
	6H	9.21	9.63	10.30	10.72	12.18	5.03	5.45	6.12	6.54	8.00
	8H	9.39	9.78	10.47	10.86	12.33	5.16	5.55	6.24	6.63	8.10
	12H	9.48	9.83	10.58	10.93	12.41	5.22	5.57	6.32	6.67	8.15
8H	4H	8.66	9.05	9.75	10.14	11.61	4.89	5.28	5.98	6.37	7.84
	6H	9.23	9.55	10.34	10.68	12.14	5.41	5.73	6.52	6.86	8.32
	8H	9.44	9.73	10.56	10.84	12.32	5.60	5.88	6.71	6.99	8.48
	12H	9.58	9.83	10.70	10.94	12.46	5.71	5.96	6.83	7.07	8.59
12H	4H	8.61	8.96	9.71	10.06	11.54	4.89	5.25	6.00	6.34	7.82
	6H	9.20	9.48	10.32	10.59	12.08	5.46	5.74	6.57	6.85	8.34
	8H	9.42	9.67	10.54	10.78	12.30	5.66	5.91	6.78	7.02	8.54

END OF REPORT