

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916882

Luminaire Tested: DFN2DIP-PN4F0-060D100US930-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916882
REPORT IS A COMBINATION OF REPORTS P899722 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D100US930-RLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11373.4 lumens
Efficiency: N/A
Efficacy: 87.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 129.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916882

CATALOG NUMBER: DFN2DIP-PN4F0-060D100US930-RLLFLL

Luminous Intensity Polar Plot

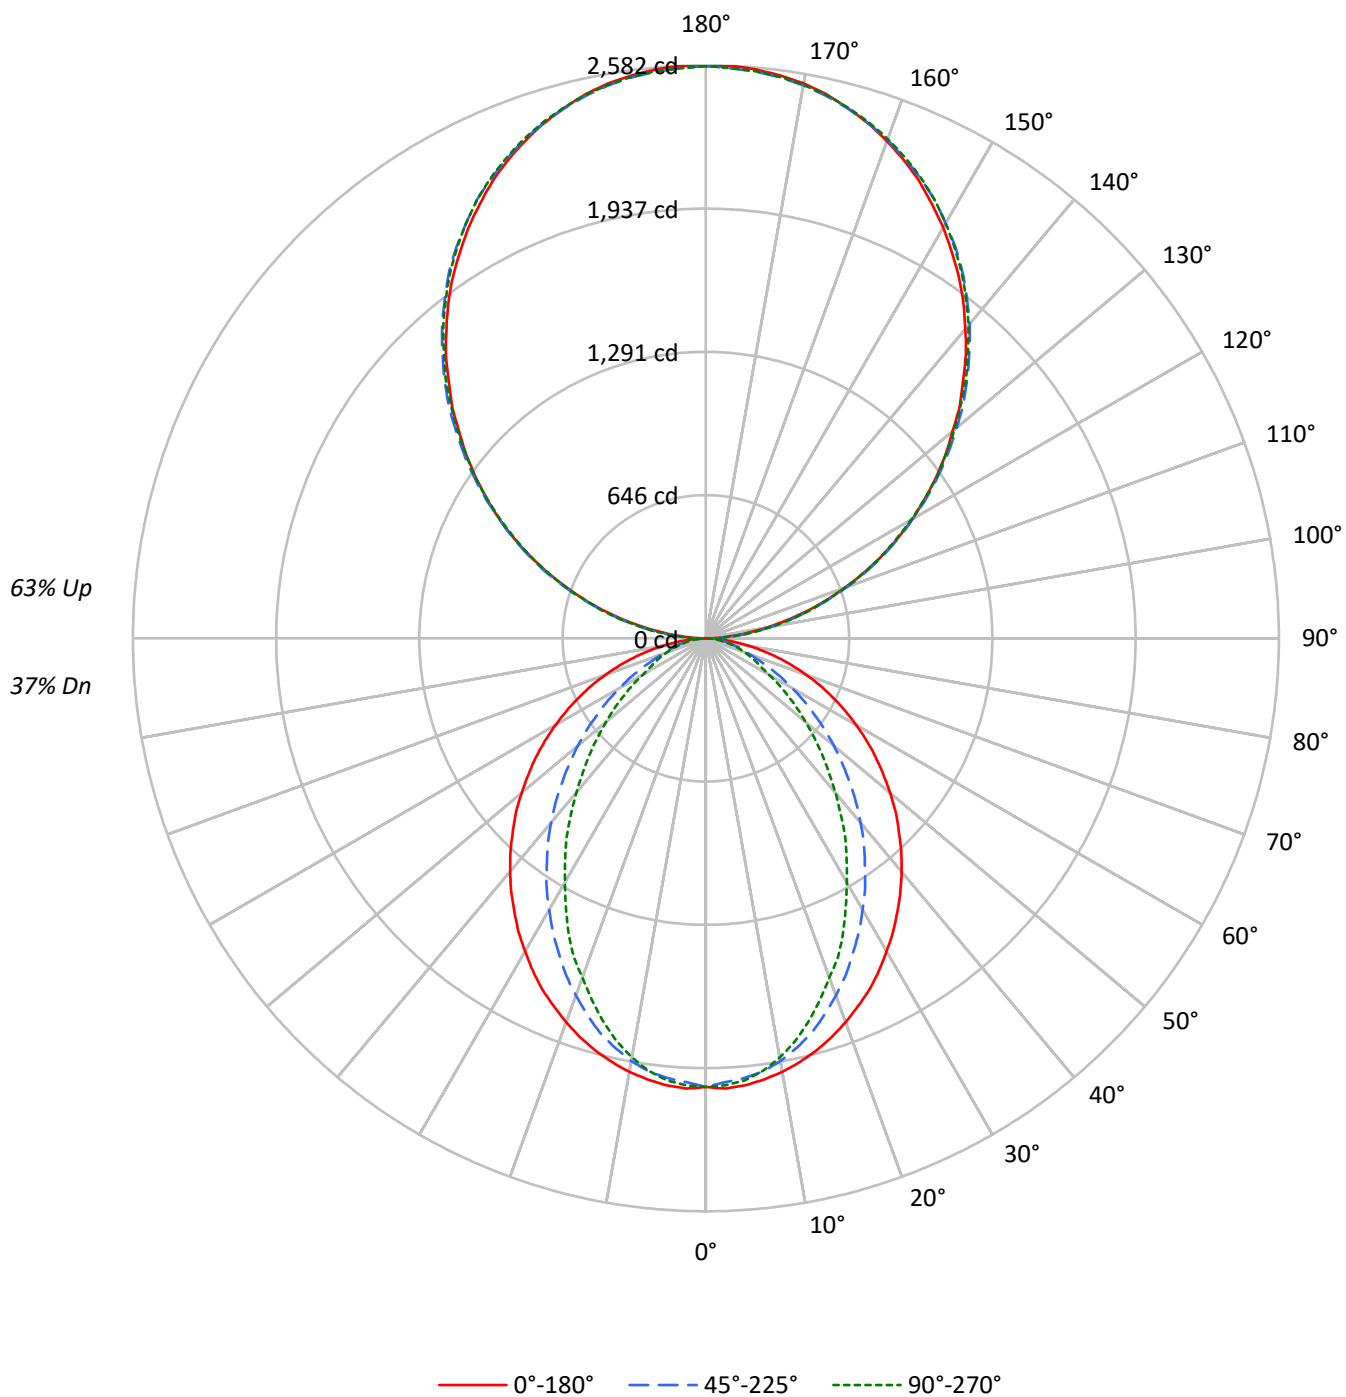

TEST NUMBER: P916882

CATALOG NUMBER: DFN2DIP-PN4F0-060D100US930-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	53	51	50	39	38	38
2	87	80	74	69	79	73	68	63	59	56	53	47	44	42	35	34	32
3	79	70	64	58	72	64	58	53	52	48	45	41	39	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	26	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	38	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	16	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1476	1476	1476
5°	1478	1453	1462
10°	1464	1424	1415
15°	1443	1377	1341
20°	1417	1313	1251
25°	1389	1240	1164
30°	1353	1166	1054
35°	1317	1086	957
40°	1280	1003	846
45°	1238	911	745
50°	1194	818	646
55°	1148	719	552
60°	1095	615	454
65°	1034	510	409
70°	960	411	371
75°	867	363	338
80°	732	305	294
85°	510	205	223

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2020 cd/sqm

TEST NUMBER: P916882

CATALOG NUMBER: DFN2DIP-PN4F0-060D100US930-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.5	1.7
10°-20°	520.2	4.6
20°-30°	730.3	6.4
30°-40°	796.1	7.0
40°-50°	731.7	6.4
50°-60°	574.6	5.1
60°-70°	374.0	3.3
70°-80°	192.5	1.7
80°-90°	56.5	0.5
90°-100°	159.6	1.4
100°-110°	507.0	4.5
110°-120°	867.6	7.6
120°-130°	1141.0	10.0
130°-140°	1280.7	11.3
140°-150°	1255.9	11.0
150°-160°	1053.5	9.3
160°-170°	698.7	6.1
170°-180°	244.2	2.1
0°-30°	1439.9	12.7
0°-40°	2236.0	19.7
0°-60°	3542.3	31.1
0°-90°	4165.3	36.6
90°-120°	1534.1	13.5
90°-150°	5211.7	45.8
90°-180°	7208.0	63.4
0°-180°	11373.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2022	2022	2022	2022	2022	
5°	2022	2013	1989	2005	2000	192
15°	1923	1903	1841	1806	1788	542
25°	1746	1687	1566	1491	1464	803
35°	1504	1411	1250	1134	1094	941
45°	1230	1107	915	785	741	950
55°	935	792	595	485	450	835
65°	631	483	318	256	251	626
75°	337	208	146	134	132	356
85°	79	40	35	35	35	90
90°	2	28	76	72	74	11
95°	114	135	139	139	135	126
105°	468	474	479	483	483	494
115°	871	883	879	877	871	861
125°	1266	1286	1280	1272	1270	1132
135°	1638	1662	1667	1664	1658	1266
145°	1988	2004	2016	2019	2010	1242
155°	2274	2280	2287	2298	2291	1047
165°	2474	2471	2471	2487	2476	698
175°	2574	2568	2563	2578	2565	245
180°	2578	2578	2578	2578	2578	

TEST NUMBER: P916882

CATALOG NUMBER: DFN2DIP-PN4F0-060D100US930-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2021.8	2021.8	2021.8	2021.8	2021.8
2.5°	2030.9	2021.8	2001.6	2020.0	2016.3
5°	2021.8	2012.6	1988.8	2005.3	1999.8
7.5°	2005.3	1994.4	1968.8	1976.0	1966.8
10°	1983.3	1970.5	1934.1	1928.4	1917.5
12.5°	1956.0	1939.4	1889.9	1879.1	1858.9
15°	1923.0	1902.7	1840.6	1805.9	1787.6
17.5°	1884.6	1855.2	1778.3	1738.1	1708.9
20°	1840.6	1803.9	1712.5	1666.9	1626.5
22.5°	1793.1	1750.9	1644.8	1582.7	1555.3
25°	1745.6	1686.9	1566.2	1491.3	1463.7
27.5°	1688.9	1626.5	1493.0	1407.0	1364.9
30°	1628.5	1558.8	1412.4	1319.2	1269.7
32.5°	1569.9	1485.6	1335.8	1225.9	1180.1
35°	1504.1	1410.7	1249.8	1134.4	1094.0
37.5°	1440.0	1339.2	1169.2	1042.8	997.2
40°	1372.2	1262.6	1084.9	955.0	907.5
42.5°	1302.8	1185.7	1000.9	865.4	819.8
45°	1229.6	1106.8	914.9	784.8	740.9
47.5°	1160.1	1030.2	832.6	702.5	662.3
50°	1083.2	953.3	752.0	625.7	587.4
52.5°	1008.0	870.8	675.1	554.4	519.7
55°	934.9	792.2	594.6	484.9	450.1
57.5°	860.0	713.5	523.3	420.9	391.5
60°	783.1	636.7	448.3	355.1	325.7
62.5°	708.2	561.8	384.2	296.4	281.8
65°	631.3	483.0	318.4	256.2	250.6
67.5°	558.1	409.8	256.2	225.0	219.6
70°	481.2	338.5	212.1	194.0	186.5
72.5°	408.1	272.6	177.4	162.9	159.1
75°	336.6	208.5	146.3	133.5	131.8
77.5°	265.4	148.1	115.3	107.9	104.3
80°	199.3	106.2	87.7	80.6	80.6
82.5°	139.0	71.4	60.3	56.7	56.7
85°	78.6	40.2	34.7	34.7	34.7
87.5°	29.4	14.6	14.6	12.8	12.8
90°	2.4	28.0	76.1	71.5	73.9
92.5°	48.2	65.3	67.7	70.0	70.0
95°	113.5	135.3	139.2	139.2	135.3
97.5°	188.9	209.1	217.7	217.7	217.7
100°	276.0	293.8	300.0	300.0	297.7
102.5°	367.7	380.9	389.5	391.8	389.5
105°	468.0	474.2	478.8	482.7	482.7
107.5°	567.4	576.8	576.8	578.4	567.4
110°	663.9	676.3	676.3	676.3	670.1

TEST NUMBER: P916882

CATALOG NUMBER: DFN2DIP-PN4F0-060D100US930-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	768.0	781.2	778.9	772.7	768.0
115°	870.7	883.0	879.2	876.9	870.7
117.5°	972.5	989.6	978.7	972.5	966.2
120°	1075.1	1092.2	1075.1	1075.1	1068.1
122.5°	1168.3	1190.1	1179.2	1173.1	1168.3
125°	1266.3	1285.7	1279.5	1272.5	1270.2
127.5°	1362.0	1386.0	1377.4	1368.2	1362.0
130°	1451.3	1479.3	1475.4	1470.7	1462.2
132.5°	1551.6	1573.4	1574.9	1564.1	1557.8
135°	1637.9	1662.0	1666.6	1664.3	1658.1
137.5°	1734.3	1753.7	1757.6	1756.1	1746.7
140°	1819.0	1838.4	1849.3	1849.3	1840.8
142.5°	1906.1	1925.5	1931.7	1934.1	1925.5
145°	1988.4	2004.0	2016.5	2018.8	2010.2
147.5°	2062.3	2081.8	2091.1	2095.0	2086.4
150°	2138.5	2151.7	2160.3	2167.2	2160.3
152.5°	2206.1	2219.3	2230.2	2238.8	2230.2
155°	2273.8	2280.0	2287.0	2297.8	2290.8
157.5°	2332.1	2336.7	2340.6	2356.1	2345.3
160°	2384.2	2388.8	2391.1	2404.3	2395.0
162.5°	2432.4	2432.4	2434.6	2449.4	2438.6
165°	2473.5	2471.2	2471.2	2486.7	2475.9
167.5°	2510.9	2503.9	2503.9	2519.4	2508.5
170°	2538.8	2532.6	2530.3	2545.9	2532.6
172.5°	2558.2	2552.0	2549.7	2565.3	2552.0
175°	2573.8	2567.6	2563.0	2578.5	2565.3
177.5°	2582.4	2576.2	2571.5	2584.7	2571.5
180°	2578.5	2578.5	2578.5	2578.5	2578.5

TEST NUMBER: P916882

CATALOG NUMBER: DFN2DIP-PN4F0-060D100US930-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.11	7.84	8.18	8.91	10.36	3.08	3.81	4.15	4.88	6.33
	3H	8.78	9.44	9.86	10.51	11.98	4.26	4.91	5.34	5.99	7.46
	4H	9.39	10.01	10.48	11.09	12.56	4.70	5.32	5.79	6.40	7.88
	6H	9.81	10.38	10.91	11.46	12.95	5.02	5.59	6.12	6.67	8.16
	8H	9.93	10.48	11.04	11.57	13.05	5.11	5.65	6.21	6.75	8.23
	12H	9.99	10.51	11.10	11.60	13.10	5.15	5.66	6.26	6.75	8.26
4H	2H	7.12	7.74	8.21	8.81	10.29	3.66	4.28	4.76	5.36	6.84
	3H	8.94	9.46	10.04	10.56	12.05	5.00	5.52	6.11	6.62	8.11
	4H	9.63	10.10	10.74	11.20	12.71	5.55	6.02	6.65	7.12	8.63
	6H	10.14	10.55	11.26	11.67	13.17	5.96	6.37	7.08	7.49	8.99
	8H	10.32	10.70	11.43	11.81	13.32	6.09	6.47	7.20	7.58	9.10
	12H	10.41	10.75	11.54	11.87	13.40	6.15	6.49	7.28	7.62	9.14
8H	4H	9.59	9.97	10.71	11.08	12.60	5.82	6.20	6.94	7.31	8.83
	6H	10.16	10.47	11.29	11.62	13.14	6.34	6.65	7.47	7.80	9.32
	8H	10.37	10.65	11.52	11.78	13.32	6.53	6.80	7.67	7.94	9.47
	12H	10.51	10.75	11.66	11.88	13.45	6.64	6.88	7.79	8.01	9.59
12H	4H	9.54	9.88	10.67	11.00	12.53	5.82	6.16	6.95	7.29	8.81
	6H	10.13	10.40	11.27	11.54	13.07	6.39	6.66	7.53	7.79	9.33
	8H	10.35	10.59	11.50	11.72	13.29	6.59	6.83	7.74	7.96	9.54

END OF REPORT