

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916976

Luminaire Tested: DFN2DIP-PN4F0-090D070US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916976
REPORT IS A COMBINATION OF REPORTS P899673 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-090D070US930-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12315.1 lumens
Efficiency: N/A
Efficacy: 87.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 140.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916976

CATALOG NUMBER: DFN2DIP-PN4F0-090D070US930-FLLFLL

Luminous Intensity Polar Plot

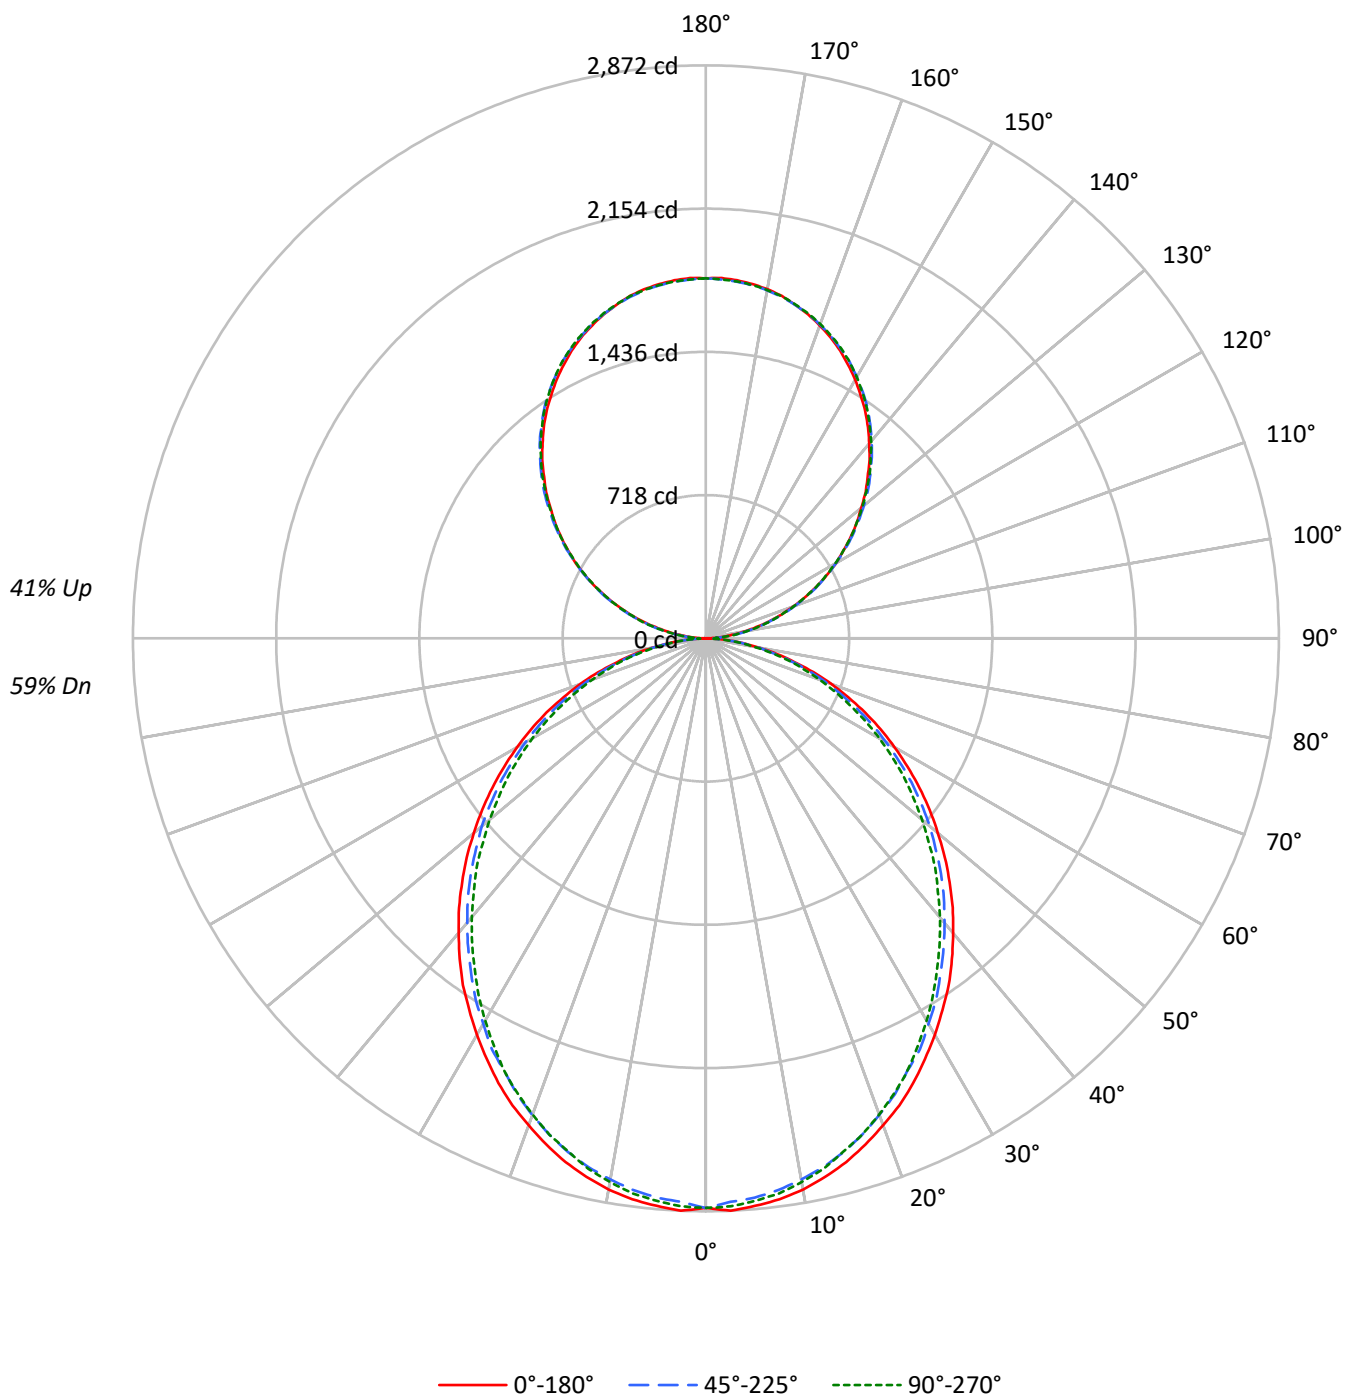

TEST NUMBER: P916976

CATALOG NUMBER: DFN2DIP-PN4F0-090D070US930-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	95	91	88	93	89	86	83	78	75	73	67	65	63	57	56	54
2	91	83	77	72	85	78	73	68	68	64	60	59	56	53	50	48	46
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	44	42	39
4	76	65	57	51	71	61	54	48	53	48	43	46	42	38	40	36	34
5	70	58	50	44	65	54	47	41	48	42	37	42	37	33	36	32	29
6	64	52	44	38	60	49	41	36	43	37	33	38	33	29	33	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	30	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	27	23	27	23	21
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2084	2084	2084
5°	2087	2055	2069
10°	2071	2028	2042
15°	2040	1995	1998
20°	1999	1949	1954
25°	1958	1894	1902
30°	1907	1842	1837
35°	1858	1782	1768
40°	1798	1720	1702
45°	1739	1659	1634
50°	1673	1595	1556
55°	1605	1520	1484
60°	1528	1432	1402
65°	1444	1340	1305
70°	1336	1229	1201
75°	1188	1096	1106
80°	1009	926	922
85°	730	632	617

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1739 cd/sqm

TEST NUMBER: P916976

CATALOG NUMBER: DFN2DIP-PN4F0-090D070US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	268.7	2.2
10°-20°	756.1	6.1
20°-30°	1111.2	9.0
30°-40°	1290.5	10.5
40°-50°	1288.9	10.5
50°-60°	1123.9	9.1
60°-70°	830.8	6.7
70°-80°	470.1	3.8
80°-90°	129.2	1.0
90°-100°	111.7	0.9
100°-110°	354.9	2.9
110°-120°	607.3	4.9
120°-130°	798.7	6.5
130°-140°	896.5	7.3
140°-150°	879.1	7.1
150°-160°	737.5	6.0
160°-170°	489.1	4.0
170°-180°	170.9	1.4
0°-30°	2136.0	17.3
0°-40°	3426.5	27.8
0°-60°	5839.4	47.4
0°-90°	7269.4	59.0
90°-120°	1073.9	8.7
90°-150°	3648.2	29.6
90°-180°	5046.0	41.0
0°-180°	12315.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2855	2855	2855	2855	2855	
5°	2855	2844	2814	2836	2831	271
15°	2718	2702	2666	2677	2663	765
25°	2460	2438	2391	2397	2391	1132
35°	2122	2095	2051	2034	2021	1325
45°	1727	1708	1666	1636	1625	1333
55°	1307	1290	1257	1225	1211	1169
65°	881	865	837	813	799	871
75°	461	456	442	426	431	492
85°	112	110	107	99	96	125
90°	2	20	53	50	52	12
95°	79	95	97	97	95	88
105°	328	332	335	338	338	346
115°	609	618	616	614	609	603
125°	886	900	896	891	889	792
135°	1147	1163	1167	1165	1161	886
145°	1392	1403	1412	1413	1407	870
155°	1592	1596	1601	1608	1604	733
165°	1731	1730	1730	1741	1733	488
175°	1802	1797	1794	1805	1796	171
180°	1805	1805	1805	1805	1805	

TEST NUMBER: P916976

CATALOG NUMBER: DFN2DIP-PN4F0-090D070US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2855.1	2855.1	2855.1	2855.1	2855.1
2.5°	2871.7	2858.0	2827.8	2855.1	2849.9
5°	2855.1	2844.3	2814.1	2835.9	2830.6
7.5°	2835.9	2819.6	2789.3	2811.5	2805.9
10°	2805.9	2786.7	2753.8	2775.6	2767.4
12.5°	2764.5	2748.2	2715.4	2729.0	2723.5
15°	2718.0	2701.7	2665.8	2676.9	2663.2
17.5°	2660.2	2643.9	2608.1	2621.8	2608.1
20°	2597.1	2580.7	2542.3	2550.4	2539.7
22.5°	2534.1	2509.4	2473.5	2473.5	2468.0
25°	2459.8	2438.0	2391.4	2396.7	2391.4
27.5°	2377.4	2358.2	2322.7	2314.6	2300.9
30°	2295.3	2273.1	2232.0	2223.9	2212.9
32.5°	2207.3	2191.0	2147.0	2130.5	2119.4
35°	2122.3	2094.9	2050.9	2034.3	2020.6
37.5°	2026.2	2001.4	1957.4	1938.2	1924.5
40°	1927.4	1905.3	1861.2	1836.8	1825.8
42.5°	1831.2	1809.1	1765.4	1737.8	1721.5
45°	1727.0	1707.8	1666.4	1636.4	1625.4
47.5°	1625.4	1606.1	1562.1	1531.9	1515.6
50°	1518.2	1504.5	1466.0	1427.6	1413.9
52.5°	1413.9	1394.6	1359.1	1328.9	1309.6
55°	1307.0	1290.4	1257.4	1224.6	1210.9
57.5°	1199.8	1186.1	1150.3	1117.4	1106.3
60°	1092.6	1081.8	1043.3	1013.1	1004.9
62.5°	988.3	969.1	941.7	914.4	903.3
65°	881.4	864.8	837.4	812.7	799.0
67.5°	771.6	757.7	733.1	714.0	702.9
70°	669.9	658.8	634.1	614.9	604.1
72.5°	565.7	554.6	540.9	521.7	513.6
75°	461.1	455.8	441.9	425.6	431.1
77.5°	367.9	356.9	351.3	343.2	335.0
80°	274.7	271.7	266.2	258.0	252.6
82.5°	186.7	186.7	184.1	173.0	173.0
85°	112.4	109.8	107.2	98.7	96.1
87.5°	49.5	43.9	38.5	30.3	27.4
90°	1.6	19.6	53.3	50.1	51.7
92.5°	33.8	45.7	47.4	49.0	49.0
95°	79.4	94.7	97.4	97.4	94.7
97.5°	132.2	146.3	152.4	152.4	152.4
100°	193.1	205.7	210.0	210.0	208.4
102.5°	257.4	266.6	272.6	274.3	272.6
105°	327.6	331.9	335.2	337.9	337.9
107.5°	397.2	403.7	403.7	404.9	397.2
110°	464.7	473.4	473.4	473.4	469.0

TEST NUMBER: P916976

CATALOG NUMBER: DFN2DIP-PN4F0-090D070US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	537.6	546.9	545.3	540.9	537.6
115°	609.4	618.2	615.5	613.8	609.4
117.5°	680.7	692.7	685.1	680.7	676.4
120°	752.5	764.5	752.5	752.5	747.6
122.5°	817.8	833.1	825.5	821.1	817.8
125°	886.4	900.0	895.7	890.8	889.2
127.5°	953.3	970.2	964.3	957.7	953.3
130°	1015.9	1035.5	1032.8	1029.6	1023.5
132.5°	1086.1	1101.4	1102.4	1094.9	1090.5
135°	1146.6	1163.3	1166.7	1165.0	1160.7
137.5°	1214.0	1227.6	1230.3	1229.2	1222.7
140°	1273.3	1286.9	1294.5	1294.5	1288.6
142.5°	1334.2	1347.9	1352.2	1353.8	1347.9
145°	1392.0	1402.8	1411.5	1413.2	1407.2
147.5°	1443.6	1457.3	1463.8	1466.5	1460.5
150°	1497.0	1506.2	1512.2	1517.1	1512.2
152.5°	1544.3	1553.6	1561.1	1567.2	1561.1
155°	1591.6	1595.9	1600.9	1608.5	1603.6
157.5°	1632.5	1635.7	1638.4	1649.3	1641.7
160°	1668.9	1672.2	1673.8	1683.0	1676.5
162.5°	1702.7	1702.7	1704.3	1714.6	1707.0
165°	1731.4	1729.8	1729.8	1740.7	1733.1
167.5°	1757.6	1752.7	1752.7	1763.6	1756.0
170°	1777.2	1772.9	1771.2	1782.1	1772.9
172.5°	1790.8	1786.4	1784.8	1795.7	1786.4
175°	1801.6	1797.3	1794.1	1804.9	1795.7
177.5°	1807.7	1803.3	1800.0	1809.3	1800.0
180°	1804.9	1804.9	1804.9	1804.9	1804.9

TEST NUMBER: P916976

CATALOG NUMBER: DFN2DIP-PN4F0-090D070US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.62	11.57	11.50	12.47	13.60	10.18	11.13	11.06	12.03	13.16
	3H	12.29	13.14	13.18	14.05	15.21	11.81	12.66	12.70	13.57	14.73
	4H	12.89	13.69	13.79	14.60	15.77	12.40	13.20	13.30	14.12	15.29
	6H	13.29	14.04	14.21	14.95	16.14	12.80	13.54	13.72	14.46	15.65
	8H	13.40	14.11	14.32	15.04	16.23	12.91	13.62	13.83	14.55	15.74
	12H	13.45	14.13	14.38	15.06	16.27	12.95	13.63	13.88	14.56	15.77
4H	2H	11.10	11.90	12.00	12.81	13.98	10.74	11.55	11.65	12.46	13.63
	3H	12.97	13.64	13.89	14.59	15.77	12.57	13.24	13.49	14.18	15.37
	4H	13.69	14.31	14.62	15.24	16.46	13.27	13.89	14.20	14.83	16.04
	6H	14.22	14.74	15.16	15.71	16.92	13.79	14.32	14.73	15.28	16.49
	8H	14.37	14.86	15.31	15.82	17.05	13.94	14.43	14.89	15.39	16.62
	12H	14.45	14.89	15.41	15.87	17.10	14.01	14.45	14.97	15.43	16.66
8H	4H	13.90	14.39	14.84	15.35	16.57	13.53	14.02	14.47	14.98	16.20
	6H	14.53	14.94	15.51	15.94	17.17	14.16	14.57	15.13	15.57	16.79
	8H	14.76	15.12	15.74	16.11	17.35	14.37	14.74	15.35	15.72	16.97
	12H	14.90	15.21	15.88	16.19	17.48	14.49	14.81	15.48	15.79	17.08
12H	4H	13.89	14.33	14.85	15.31	16.54	13.52	13.97	14.49	14.94	16.18
	6H	14.57	14.93	15.55	15.91	17.16	14.20	14.56	15.18	15.55	16.79
	8H	14.81	15.13	15.80	16.11	17.40	14.44	14.76	15.43	15.74	17.03

END OF REPORT