

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917032

Luminaire Tested: DFN2DIP-PN4F0-100D120US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917032
REPORT IS A COMBINATION OF REPORTS P899765 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-100D120US930-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16729.9 lumens
Efficiency: N/A
Efficacy: 81.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 204.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917032

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US930-FLLFLL

Luminous Intensity Polar Plot

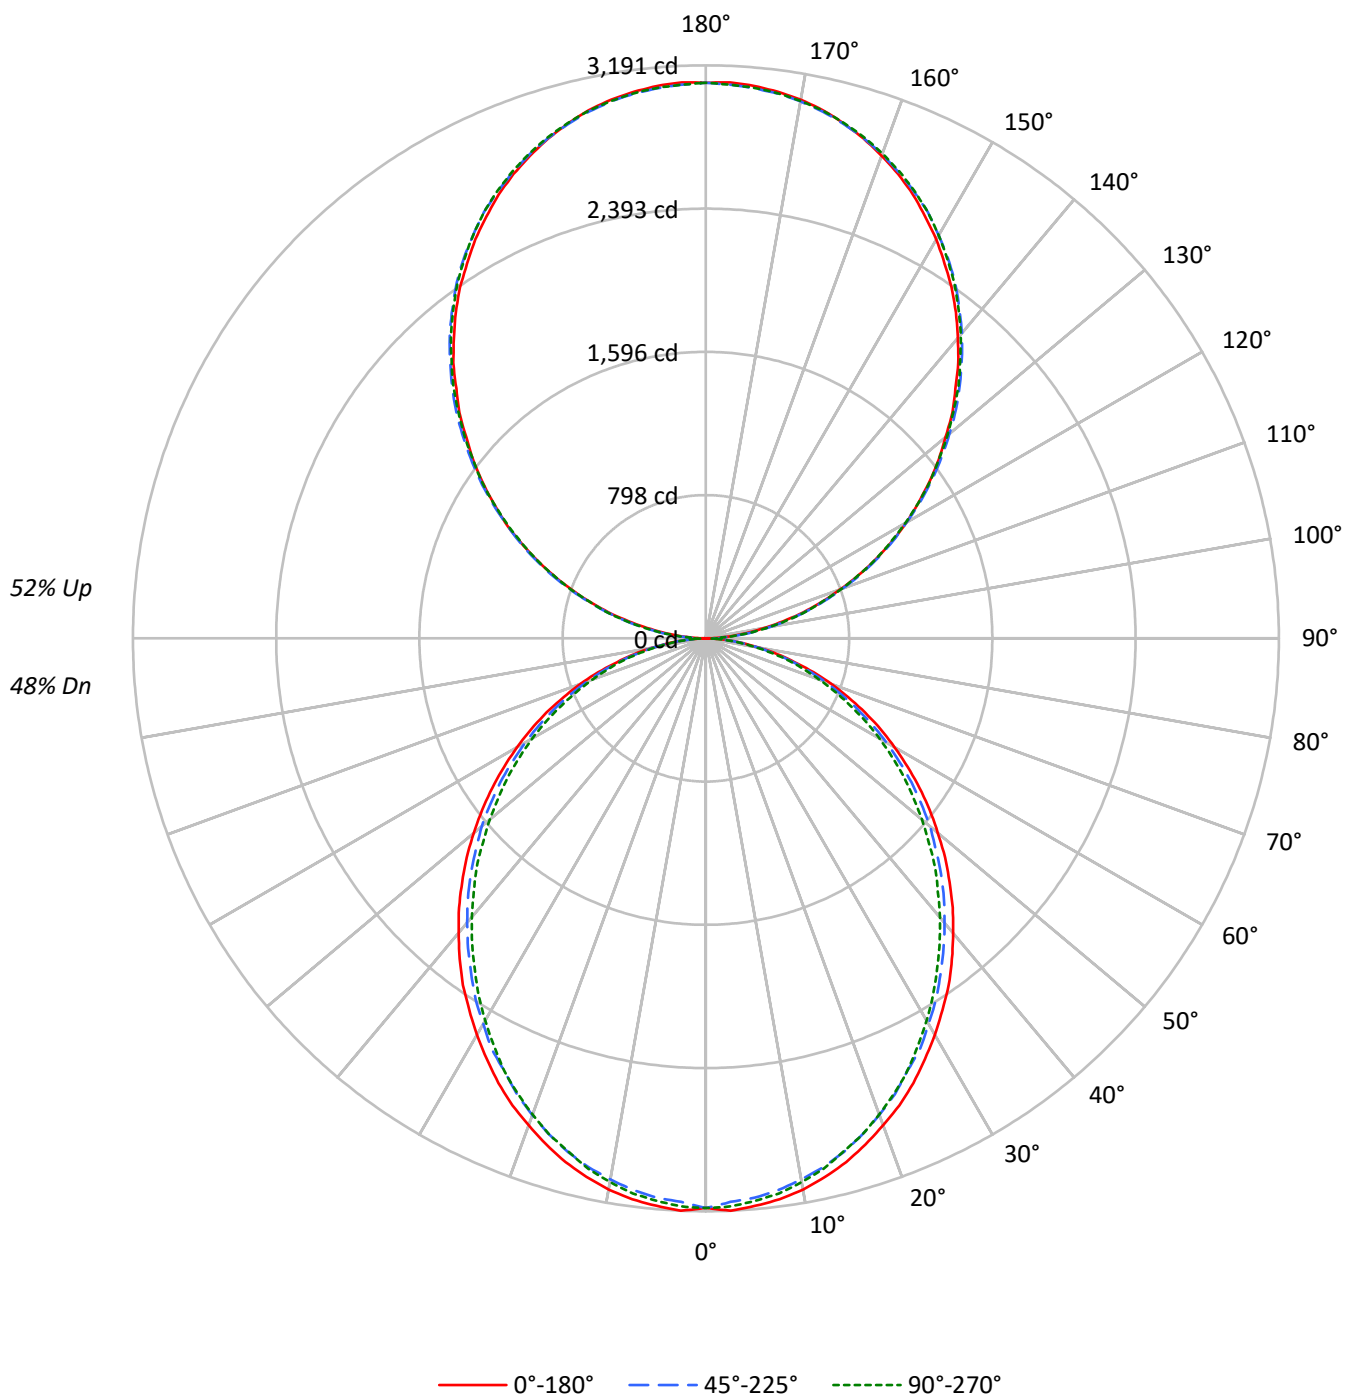

TEST NUMBER: P917032

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US930-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	68	68	68	55	55	55
1	97	93	89	86	89	86	82	79	72	70	68	60	58	57	48	47	46
2	89	81	75	70	81	75	70	65	63	59	56	52	50	47	42	41	39
3	81	71	64	58	74	66	60	54	56	51	47	46	43	40	38	35	33
4	74	63	55	49	68	59	52	46	50	44	40	41	37	34	34	31	28
5	68	56	48	42	62	52	45	40	44	39	35	37	33	30	30	27	25
6	63	51	42	37	57	47	40	34	40	34	30	34	29	26	27	24	22
7	58	46	38	32	53	42	35	30	36	31	27	30	26	23	25	22	19
8	54	41	34	28	49	39	32	27	33	28	24	28	24	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	26	21	18	21	18	16
10	47	35	27	23	43	32	26	21	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2316	2316	2316
5°	2319	2284	2299
10°	2301	2253	2269
15°	2267	2217	2220
20°	2221	2165	2171
25°	2176	2104	2114
30°	2119	2047	2041
35°	2065	1980	1964
40°	1998	1912	1891
45°	1932	1843	1816
50°	1859	1772	1729
55°	1783	1689	1649
60°	1698	1591	1558
65°	1604	1490	1450
70°	1485	1366	1335
75°	1320	1217	1229
80°	1121	1029	1024
85°	811	702	685

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2422 cd/sqm

TEST NUMBER: P917032

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	298.6	1.8
10°-20°	840.1	5.0
20°-30°	1234.6	7.4
30°-40°	1433.9	8.6
40°-50°	1432.1	8.6
50°-60°	1248.8	7.5
60°-70°	923.1	5.5
70°-80°	522.3	3.1
80°-90°	146.6	0.9
90°-100°	191.5	1.1
100°-110°	608.3	3.6
110°-120°	1041.1	6.2
120°-130°	1369.2	8.2
130°-140°	1536.9	9.2
140°-150°	1507.1	9.0
150°-160°	1264.2	7.6
160°-170°	838.4	5.0
170°-180°	293.0	1.8
0°-30°	2373.3	14.2
0°-40°	3807.2	22.8
0°-60°	6488.2	38.8
0°-90°	8080.2	48.3
90°-120°	1840.9	11.0
90°-150°	6254.0	37.4
90°-180°	8650.0	51.7
0°-180°	16729.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3172	3172	3172	3172	3172	
5°	3172	3160	3127	3151	3145	301
15°	3020	3002	2962	2974	2959	851
25°	2733	2709	2657	2663	2657	1258
35°	2358	2328	2279	2260	2245	1473
45°	1919	1898	1852	1818	1806	1481
55°	1452	1434	1397	1361	1345	1298
65°	979	961	930	903	888	968
75°	512	506	491	473	479	547
85°	125	122	119	110	107	139
90°	3	34	91	86	89	16
95°	136	162	167	167	162	152
105°	562	569	575	579	579	593
115°	1045	1060	1055	1052	1045	1033
125°	1520	1543	1536	1527	1524	1358
135°	1965	1994	2000	1997	1990	1519
145°	2386	2405	2420	2423	2412	1491
155°	2728	2736	2744	2757	2749	1256
165°	2968	2966	2966	2984	2971	837
175°	3089	3081	3076	3094	3078	293
180°	3094	3094	3094	3094	3094	

TEST NUMBER: P917032

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3172.4	3172.4	3172.4	3172.4	3172.4
2.5°	3190.8	3175.6	3141.9	3172.4	3166.5
5°	3172.4	3160.4	3126.8	3151.0	3145.2
7.5°	3151.0	3132.9	3099.2	3123.8	3117.7
10°	3117.7	3096.3	3059.7	3084.0	3075.0
12.5°	3071.7	3053.6	3017.0	3032.3	3026.1
15°	3019.9	3001.8	2962.0	2974.3	2959.1
17.5°	2955.9	2937.8	2897.9	2913.1	2897.9
20°	2885.6	2867.5	2824.8	2833.8	2821.8
22.5°	2815.7	2788.2	2748.4	2748.4	2742.3
25°	2733.2	2708.9	2657.1	2662.9	2657.1
27.5°	2641.6	2620.2	2580.7	2571.7	2556.4
30°	2550.3	2525.7	2480.1	2471.0	2458.7
32.5°	2452.6	2434.5	2385.6	2367.1	2354.8
35°	2358.1	2327.7	2278.8	2260.3	2245.1
37.5°	2251.3	2223.7	2174.9	2153.5	2138.3
40°	2141.5	2116.9	2068.1	2040.9	2028.6
42.5°	2034.7	2010.1	1961.6	1930.9	1912.8
45°	1918.9	1897.5	1851.5	1818.2	1806.0
47.5°	1806.0	1784.6	1735.7	1702.0	1683.9
50°	1686.9	1671.6	1628.9	1586.2	1571.0
52.5°	1571.0	1549.6	1510.1	1476.5	1455.1
55°	1452.2	1433.8	1397.2	1360.6	1345.4
57.5°	1333.1	1317.8	1278.1	1241.5	1229.2
60°	1214.0	1202.0	1159.3	1125.6	1116.6
62.5°	1098.1	1076.8	1046.4	1015.9	1003.6
65°	979.3	960.9	930.5	902.9	887.8
67.5°	857.4	841.8	814.6	793.3	781.0
70°	744.4	732.1	704.6	683.2	671.2
72.5°	628.5	616.2	601.0	579.7	570.5
75°	512.3	506.5	491.0	472.9	479.0
77.5°	408.8	396.5	390.3	381.2	372.2
80°	305.2	302.0	295.8	286.7	280.6
82.5°	207.5	207.5	204.6	192.2	192.2
85°	124.9	122.1	119.1	109.7	106.8
87.5°	55.0	48.8	42.7	33.7	30.4
90°	2.8	33.6	91.4	85.9	88.6
92.5°	57.8	78.4	81.1	84.0	84.0
95°	136.2	162.3	167.0	167.0	162.3
97.5°	226.7	250.9	261.2	261.2	261.2
100°	331.2	352.6	360.0	360.0	357.3
102.5°	441.2	457.1	467.3	470.2	467.3
105°	561.6	569.0	574.6	579.3	579.3
107.5°	680.9	692.2	692.2	694.0	680.9
110°	796.6	811.5	811.5	811.5	804.1

TEST NUMBER: P917032

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	921.6	937.5	934.7	927.2	921.6
115°	1044.7	1059.7	1055.0	1052.2	1044.7
117.5°	1166.9	1187.5	1174.4	1166.9	1159.5
120°	1290.1	1310.6	1290.1	1290.1	1281.7
122.5°	1402.1	1428.2	1415.1	1407.6	1402.1
125°	1519.6	1542.9	1535.5	1527.1	1524.2
127.5°	1634.3	1663.2	1652.9	1641.8	1634.3
130°	1741.6	1775.1	1770.5	1764.9	1754.6
132.5°	1861.9	1888.1	1889.9	1876.8	1869.4
135°	1965.4	1994.4	2000.0	1997.2	1989.7
137.5°	2081.1	2104.4	2109.1	2107.2	2096.1
140°	2182.8	2206.1	2219.2	2219.2	2208.9
142.5°	2287.3	2310.6	2318.1	2320.8	2310.6
145°	2386.1	2404.8	2419.7	2422.6	2412.3
147.5°	2474.8	2498.1	2509.3	2514.0	2503.7
150°	2566.2	2582.0	2592.3	2600.7	2592.3
152.5°	2647.4	2663.2	2676.3	2686.6	2676.3
155°	2728.5	2736.0	2744.4	2757.4	2749.0
157.5°	2798.5	2804.1	2808.7	2827.4	2814.3
160°	2861.0	2866.6	2869.4	2885.3	2874.0
162.5°	2918.8	2918.8	2921.6	2939.3	2926.3
165°	2968.3	2965.5	2965.5	2984.1	2971.0
167.5°	3013.0	3004.6	3004.6	3023.3	3010.2
170°	3046.6	3039.1	3036.3	3055.0	3039.1
172.5°	3069.9	3062.4	3059.7	3078.3	3062.4
175°	3088.6	3081.1	3075.5	3094.1	3078.3
177.5°	3098.9	3091.4	3085.7	3101.6	3085.7
180°	3094.1	3094.1	3094.1	3094.1	3094.1

TEST NUMBER: P917032

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.03	10.88	11.01	11.87	13.16	9.59	10.44	10.57	11.43	12.72
	3H	11.70	12.46	12.68	13.45	14.77	11.21	11.97	12.20	12.97	14.28
	4H	12.29	13.00	13.28	14.00	15.33	11.80	12.52	12.79	13.52	14.84
	6H	12.69	13.35	13.69	14.35	15.69	12.20	12.86	13.20	13.86	15.20
	8H	12.79	13.42	13.81	14.44	15.78	12.30	12.93	13.31	13.95	15.28
	12H	12.84	13.44	13.86	14.45	15.81	12.34	12.94	13.36	13.95	15.31
4H	2H	10.49	11.21	11.50	12.21	13.54	10.14	10.86	11.15	11.86	13.19
	3H	12.36	12.96	13.37	13.99	15.33	11.96	12.56	12.97	13.59	14.93
	4H	13.08	13.63	14.10	14.65	16.01	12.66	13.21	13.68	14.23	15.59
	6H	13.60	14.07	14.63	15.11	16.47	13.17	13.64	14.20	14.69	16.04
	8H	13.75	14.19	14.78	15.22	16.60	13.32	13.76	14.35	14.79	16.17
	12H	13.82	14.22	14.87	15.27	16.65	13.38	13.78	14.43	14.83	16.21
8H	4H	13.27	13.72	14.30	14.75	16.12	12.90	13.34	13.93	14.38	15.75
	6H	13.91	14.27	14.96	15.35	16.72	13.53	13.90	14.59	14.97	16.35
	8H	14.13	14.45	15.19	15.51	16.90	13.75	14.07	14.81	15.13	16.52
	12H	14.26	14.55	15.33	15.60	17.04	13.86	14.14	14.93	15.20	16.63
12H	4H	13.26	13.66	14.31	14.71	16.09	12.90	13.30	13.95	14.35	15.73
	6H	13.94	14.26	15.00	15.32	16.71	13.57	13.89	14.64	14.96	16.35
	8H	14.18	14.46	15.25	15.52	16.95	13.81	14.09	14.88	15.15	16.58