

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917060

Luminaire Tested: DFN2DIP-PN4F0-110D100US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917060
REPORT IS A COMBINATION OF REPORTS P899731 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-110D100US930-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16094.0 lumens
Efficiency: N/A
Efficacy: 85.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 189.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917060

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US930-FLLFLL

Luminous Intensity Polar Plot

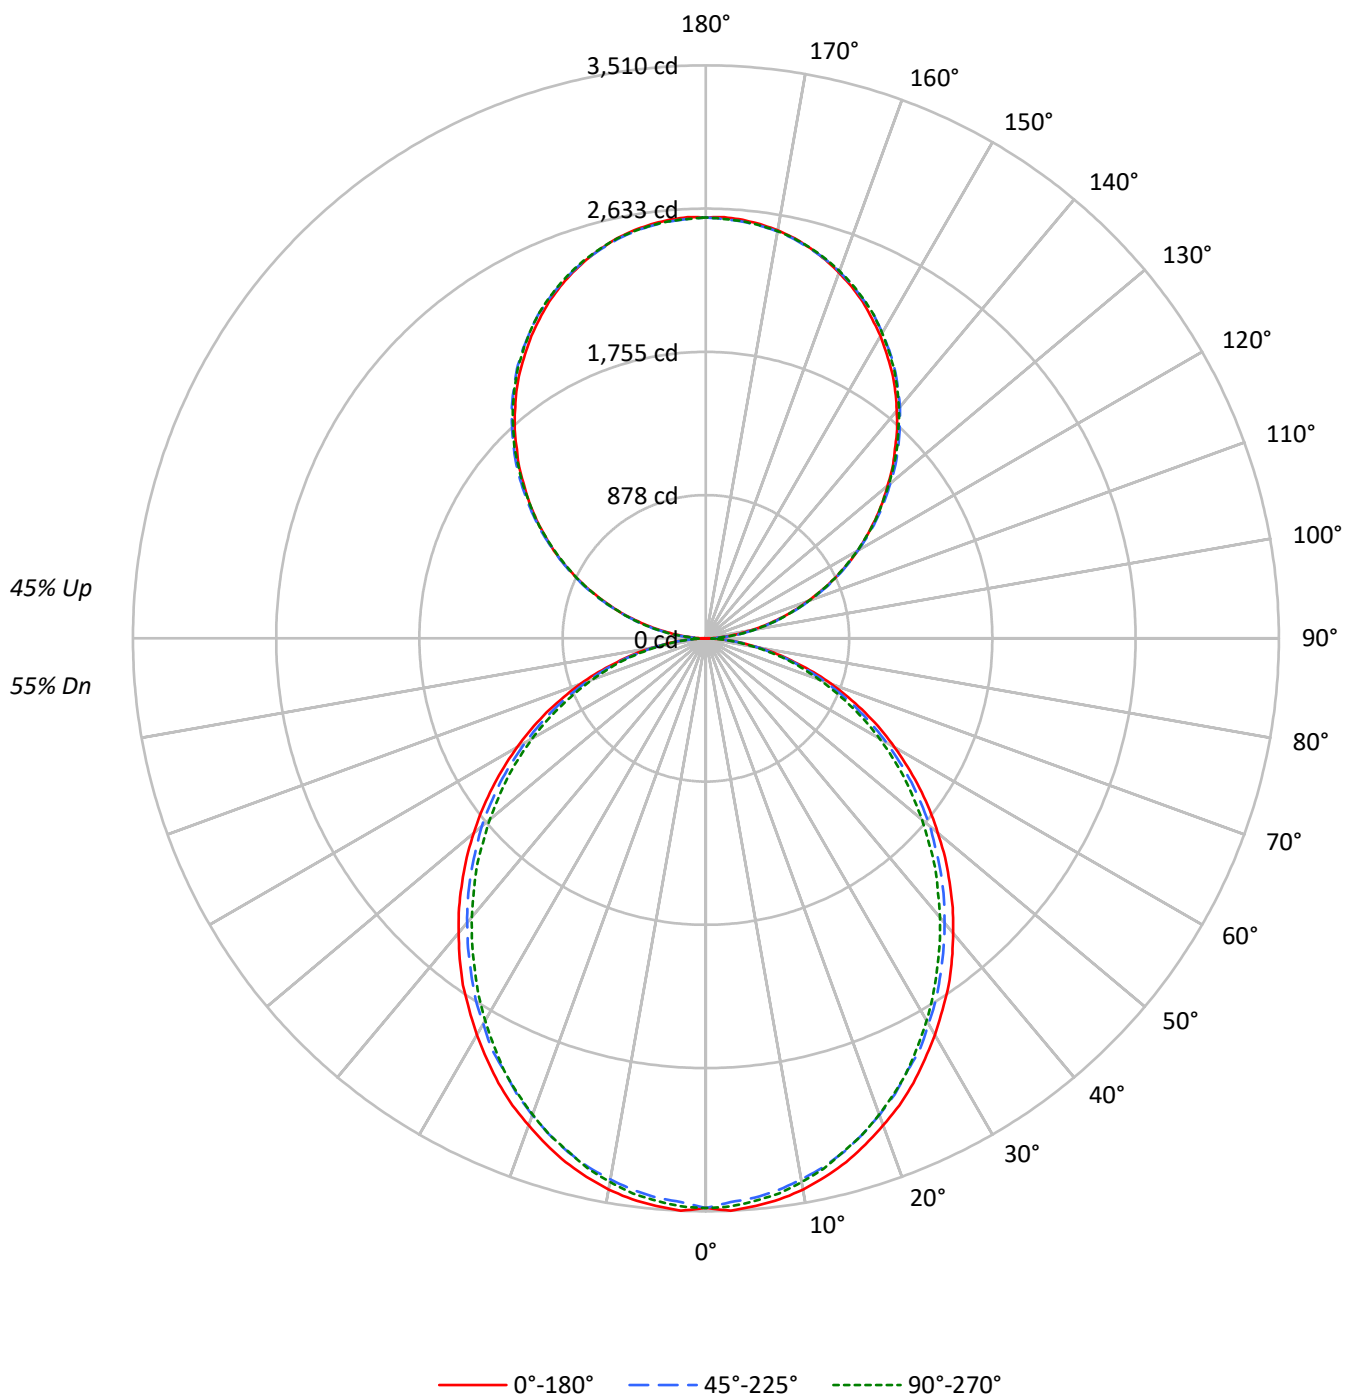

TEST NUMBER: P917060

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US930-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					0
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	108	108	108	108		101	101	101	101		86	86	86		73	73	73		61	61	61
1	99	95	91	87		92	88	85	82		76	73	71		64	63	61		54	53	51
2	90	83	76	71		83	77	72	67		66	62	59		56	53	51		47	45	43
3	82	73	65	59		76	68	61	56		58	53	49		50	46	43		42	39	37
4	75	64	56	50		70	60	53	47		52	46	42		45	40	37		38	34	32
5	69	57	49	43		64	54	46	41		47	41	36		40	36	32		34	30	28
6	64	51	43	37		59	48	41	36		42	36	32		36	32	28		31	27	24
7	59	47	38	33		55	44	36	31		38	32	28		33	28	25		28	24	22
8	55	42	34	29		51	40	33	28		35	29	25		30	26	22		26	22	19
9	51	39	31	26		47	36	29	25		32	26	22		28	23	20		24	20	18
10	48	35	28	23		44	33	27	22		29	24	20		26	21	18		22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2547	2547	2547
5°	2551	2512	2529
10°	2531	2479	2495
15°	2493	2438	2442
20°	2443	2382	2388
25°	2393	2314	2325
30°	2330	2252	2245
35°	2271	2177	2160
40°	2198	2103	2080
45°	2125	2028	1997
50°	2045	1949	1902
55°	1962	1858	1814
60°	1867	1750	1714
65°	1765	1638	1595
70°	1634	1502	1468
75°	1452	1339	1351
80°	1234	1131	1127
85°	893	772	754

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2125 cd/sqm

TEST NUMBER: P917060

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	328.4	2.0
10°-20°	924.1	5.7
20°-30°	1358.1	8.4
30°-40°	1577.3	9.8
40°-50°	1575.4	9.8
50°-60°	1373.7	8.5
60°-70°	1015.5	6.3
70°-80°	574.5	3.6
80°-90°	159.0	1.0
90°-100°	159.6	1.0
100°-110°	507.0	3.1
110°-120°	867.6	5.4
120°-130°	1141.0	7.1
130°-140°	1280.7	8.0
140°-150°	1255.9	7.8
150°-160°	1053.5	6.5
160°-170°	698.7	4.3
170°-180°	244.2	1.5
0°-30°	2610.6	16.2
0°-40°	4187.9	26.0
0°-60°	7137.0	44.3
0°-90°	8885.9	55.2
90°-120°	1534.1	9.5
90°-150°	5211.7	32.4
90°-180°	7208.0	44.8
0°-180°	16094.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3490	3490	3490	3490	3490	
5°	3490	3476	3439	3466	3460	331
15°	3322	3302	3258	3272	3255	936
25°	3006	2980	2923	2929	2923	1383
35°	2594	2560	2507	2486	2470	1620
45°	2111	2087	2037	2000	1987	1629
55°	1597	1577	1537	1497	1480	1428
65°	1077	1057	1024	993	977	1065
75°	564	557	540	520	527	602
85°	138	134	131	121	118	153
90°	2	28	76	72	74	16
95°	114	135	139	139	135	126
105°	468	474	479	483	483	494
115°	871	883	879	877	871	861
125°	1266	1286	1280	1272	1270	1132
135°	1638	1662	1667	1664	1658	1266
145°	1988	2004	2016	2019	2010	1242
155°	2274	2280	2287	2298	2291	1047
165°	2474	2471	2471	2487	2476	698
175°	2574	2568	2563	2578	2565	245
180°	2578	2578	2578	2578	2578	

TEST NUMBER: P917060

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US930-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3489.6	3489.6	3489.6	3489.6	3489.6
2.5°	3509.9	3493.1	3456.1	3489.6	3483.2
5°	3489.6	3476.4	3439.4	3466.1	3459.7
7.5°	3466.1	3446.2	3409.2	3436.2	3429.5
10°	3429.5	3405.9	3365.7	3392.4	3382.4
12.5°	3378.9	3358.9	3318.8	3335.5	3328.7
15°	3321.9	3302.0	3258.2	3271.7	3255.0
17.5°	3251.4	3231.5	3187.7	3204.4	3187.7
20°	3174.2	3154.2	3107.3	3117.2	3104.1
22.5°	3097.3	3067.0	3023.2	3023.2	3016.4
25°	3006.5	2979.8	2922.8	2929.3	2922.8
27.5°	2905.7	2882.2	2838.8	2828.8	2812.1
30°	2805.4	2778.3	2728.1	2718.1	2704.6
32.5°	2697.8	2677.9	2624.1	2603.8	2590.3
35°	2593.9	2560.4	2506.6	2486.3	2469.6
37.5°	2476.4	2446.1	2392.4	2368.8	2352.1
40°	2355.7	2328.7	2274.9	2245.0	2231.5
42.5°	2238.2	2211.2	2157.8	2123.9	2104.0
45°	2110.8	2087.2	2036.7	2000.1	1986.6
47.5°	1986.6	1963.1	1909.3	1872.3	1852.3
50°	1855.5	1838.8	1791.8	1744.8	1728.1
52.5°	1728.1	1704.5	1661.2	1624.1	1600.6
55°	1597.4	1577.1	1536.9	1496.6	1479.9
57.5°	1466.4	1449.7	1405.9	1365.6	1352.1
60°	1335.4	1322.3	1275.2	1238.2	1228.2
62.5°	1207.9	1184.5	1151.0	1117.5	1104.0
65°	1077.3	1057.0	1023.5	993.3	976.6
67.5°	943.1	926.0	896.1	872.6	859.1
70°	818.8	805.3	775.0	751.5	738.3
72.5°	691.4	677.8	661.1	637.6	627.6
75°	563.5	557.2	540.1	520.2	526.9
77.5°	449.6	436.1	429.3	419.4	409.4
80°	335.7	332.2	325.4	315.4	308.7
82.5°	228.2	228.2	225.0	211.5	211.5
85°	137.5	134.2	131.0	120.7	117.5
87.5°	60.5	53.7	47.0	37.0	33.4
90°	2.4	28.0	76.1	71.5	73.9
92.5°	48.2	65.3	67.7	70.0	70.0
95°	113.5	135.3	139.2	139.2	135.3
97.5°	188.9	209.1	217.7	217.7	217.7
100°	276.0	293.8	300.0	300.0	297.7
102.5°	367.7	380.9	389.5	391.8	389.5
105°	468.0	474.2	478.8	482.7	482.7
107.5°	567.4	576.8	576.8	578.4	567.4
110°	663.9	676.3	676.3	676.3	670.1

TEST NUMBER: P917060

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	768.0	781.2	778.9	772.7	768.0
115°	870.7	883.0	879.2	876.9	870.7
117.5°	972.5	989.6	978.7	972.5	966.2
120°	1075.1	1092.2	1075.1	1075.1	1068.1
122.5°	1168.3	1190.1	1179.2	1173.1	1168.3
125°	1266.3	1285.7	1279.5	1272.5	1270.2
127.5°	1362.0	1386.0	1377.4	1368.2	1362.0
130°	1451.3	1479.3	1475.4	1470.7	1462.2
132.5°	1551.6	1573.4	1574.9	1564.1	1557.8
135°	1637.9	1662.0	1666.6	1664.3	1658.1
137.5°	1734.3	1753.7	1757.6	1756.1	1746.7
140°	1819.0	1838.4	1849.3	1849.3	1840.8
142.5°	1906.1	1925.5	1931.7	1934.1	1925.5
145°	1988.4	2004.0	2016.5	2018.8	2010.2
147.5°	2062.3	2081.8	2091.1	2095.0	2086.4
150°	2138.5	2151.7	2160.3	2167.2	2160.3
152.5°	2206.1	2219.3	2230.2	2238.8	2230.2
155°	2273.8	2280.0	2287.0	2297.8	2290.8
157.5°	2332.1	2336.7	2340.6	2356.1	2345.3
160°	2384.2	2388.8	2391.1	2404.3	2395.0
162.5°	2432.4	2432.4	2434.6	2449.4	2438.6
165°	2473.5	2471.2	2471.2	2486.7	2475.9
167.5°	2510.9	2503.9	2503.9	2519.4	2508.5
170°	2538.8	2532.6	2530.3	2545.9	2532.6
172.5°	2558.2	2552.0	2549.7	2565.3	2552.0
175°	2573.8	2567.6	2563.0	2578.5	2565.3
177.5°	2582.4	2576.2	2571.5	2584.7	2571.5
180°	2578.5	2578.5	2578.5	2578.5	2578.5

TEST NUMBER: P917060

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.99	11.90	11.91	12.84	14.03	10.55	11.46	11.47	12.39	13.59
	3H	12.66	13.48	13.58	14.42	15.64	12.18	12.99	13.10	13.93	15.15
	4H	13.25	14.03	14.19	14.97	16.20	12.77	13.54	13.70	14.48	15.71
	6H	13.66	14.37	14.61	15.32	16.56	13.17	13.88	14.11	14.83	16.07
	8H	13.77	14.44	14.72	15.41	16.65	13.27	13.95	14.23	14.92	16.16
	12H	13.82	14.46	14.78	15.42	16.69	13.32	13.96	14.28	14.92	16.19
4H	2H	11.46	12.23	12.41	13.18	14.41	11.11	11.88	12.05	12.83	14.06
	3H	13.34	13.98	14.29	14.96	16.20	12.93	13.58	13.89	14.55	15.79
	4H	14.05	14.64	15.02	15.61	16.88	13.64	14.23	14.60	15.19	16.46
	6H	14.57	15.08	15.55	16.08	17.34	14.15	14.66	15.13	15.65	16.92
	8H	14.73	15.20	15.70	16.19	17.47	14.30	14.77	15.28	15.76	17.04
	12H	14.80	15.23	15.80	16.24	17.52	14.36	14.79	15.36	15.79	17.08
8H	4H	14.26	14.73	15.23	15.72	17.00	13.88	14.36	14.86	15.34	16.62
	6H	14.89	15.28	15.89	16.31	17.59	14.52	14.91	15.52	15.94	17.21
	8H	15.11	15.46	16.13	16.48	17.77	14.73	15.08	15.74	16.09	17.39
	12H	15.25	15.56	16.27	16.56	17.91	14.85	15.15	15.86	16.16	17.51
12H	4H	14.24	14.67	15.24	15.67	16.96	13.88	14.31	14.88	15.31	16.60
	6H	14.92	15.27	15.93	16.28	17.58	14.56	14.90	15.57	15.92	17.22
	8H	15.17	15.47	16.18	16.48	17.83	14.80	15.10	15.81	16.11	17.45

END OF REPORT