

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919523

Luminaire Tested: DFN2DIP-PN4F0-040D060US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919523
REPORT IS A COMBINATION OF REPORTS P901166 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-040D060US935-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8041.7 lumens
Efficiency: N/A
Efficacy: 102.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 78.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919523

CATALOG NUMBER: DFN2DIP-PN4F0-040D060US935-RLLONL

Luminous Intensity Polar Plot

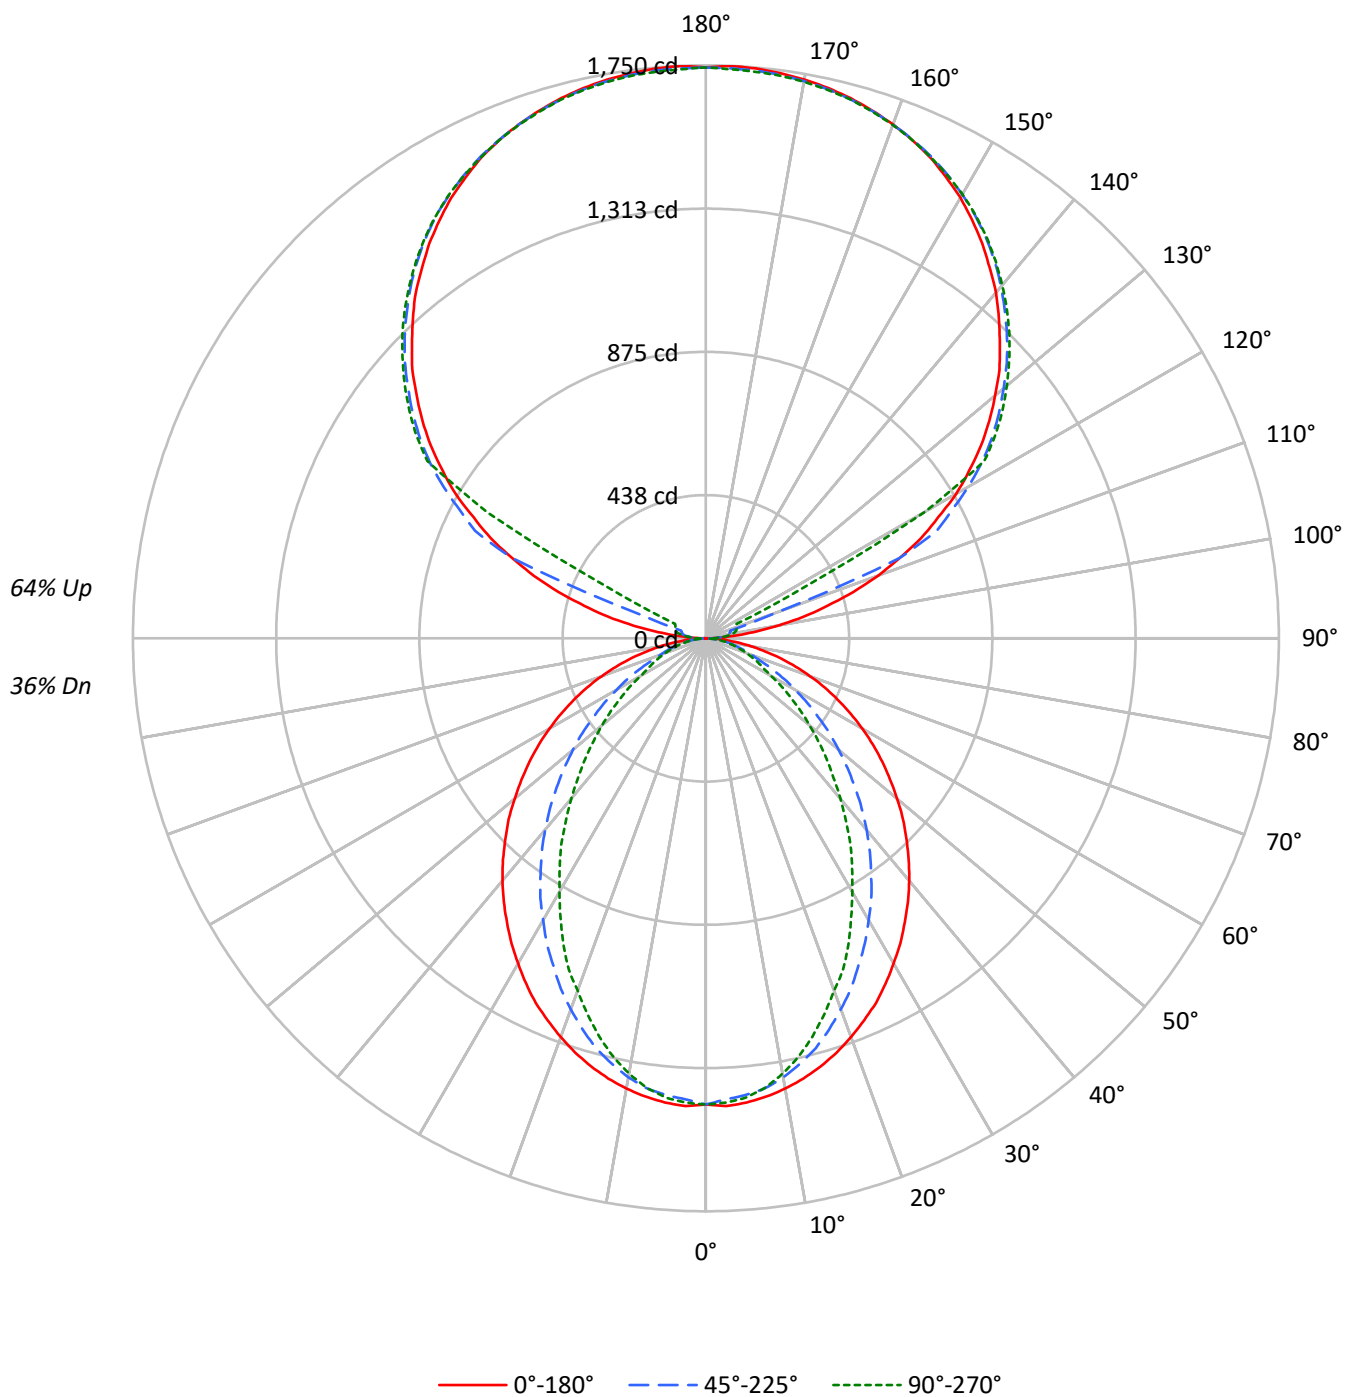

TEST NUMBER: P919523

CATALOG NUMBER: DFN2DIP-PN4F0-040D060US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	52	51	50	39	38	38
2	87	80	74	69	78	73	68	63	59	56	53	46	44	42	35	33	32
3	79	70	63	58	72	64	58	53	52	48	45	41	38	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	37	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	15	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1039	1039	1039
5°	1041	1023	1029
10°	1030	1003	996
15°	1016	970	944
20°	997	924	881
25°	978	873	820
30°	952	821	742
35°	927	764	674
40°	901	706	595
45°	871	641	525
50°	841	576	455
55°	808	506	388
60°	771	433	320
65°	728	359	288
70°	676	290	261
75°	610	256	238
80°	516	215	207
85°	360	144	157

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 929 cd/sqm

TEST NUMBER: P919523

CATALOG NUMBER: DFN2DIP-PN4F0-040D060US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	133.4	1.7
10°-20°	366.2	4.6
20°-30°	514.2	6.4
30°-40°	560.5	7.0
40°-50°	515.1	6.4
50°-60°	404.5	5.0
60°-70°	263.3	3.3
70°-80°	135.6	1.7
80°-90°	37.7	0.5
90°-100°	57.5	0.7
100°-110°	214.3	2.7
110°-120°	568.4	7.1
120°-130°	942.7	11.7
130°-140°	1001.4	12.5
140°-150°	930.7	11.6
150°-160°	748.2	9.3
160°-170°	482.1	6.0
170°-180°	165.9	2.1
0°-30°	1013.8	12.6
0°-40°	1574.2	19.6
0°-60°	2493.9	31.0
0°-90°	2930.4	36.4
90°-120°	840.2	10.4
90°-150°	3714.9	46.2
90°-180°	5111.0	63.6
0°-180°	8041.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1423	1423	1423	1423	1423	
5°	1423	1417	1400	1412	1408	135
15°	1354	1340	1296	1271	1259	382
25°	1229	1188	1103	1050	1030	565
35°	1059	993	880	799	770	663
45°	866	779	644	553	522	668
55°	658	558	419	341	317	588
65°	444	340	224	180	176	441
75°	237	147	103	94	93	251
85°	55	28	24	24	24	64
90°	1	15	25	32	34	7
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	

TEST NUMBER: P919523

CATALOG NUMBER: DFN2DIP-PN4F0-040D060US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1423.4	1423.4	1423.4	1423.4	1423.4
2.5°	1429.9	1423.4	1409.2	1422.2	1419.5
5°	1423.4	1416.9	1400.2	1411.8	1408.0
7.5°	1411.8	1404.1	1386.1	1391.1	1384.7
10°	1396.4	1387.3	1361.6	1357.6	1350.0
12.5°	1377.1	1365.5	1330.6	1322.9	1308.7
15°	1353.8	1339.6	1295.9	1271.4	1258.6
17.5°	1326.8	1306.1	1252.0	1223.7	1203.1
20°	1295.9	1270.1	1205.7	1173.5	1145.1
22.5°	1262.4	1232.8	1158.0	1114.2	1095.0
25°	1228.9	1187.7	1102.6	1049.9	1030.4
27.5°	1189.0	1145.1	1051.1	990.6	960.9
30°	1146.5	1097.4	994.4	928.8	894.0
32.5°	1105.3	1045.9	940.4	863.1	830.8
35°	1058.9	993.2	879.9	798.7	770.2
37.5°	1013.8	942.9	823.1	734.2	702.1
40°	966.1	888.9	763.9	672.4	638.9
42.5°	917.1	834.7	704.6	609.2	577.1
45°	865.6	779.3	644.1	552.6	521.7
47.5°	816.7	725.3	586.2	494.6	466.3
50°	762.6	671.1	529.4	440.5	413.5
52.5°	709.7	613.1	475.4	390.3	365.8
55°	658.2	557.8	418.6	341.4	316.9
57.5°	605.5	502.4	368.4	296.3	275.7
60°	551.3	448.2	315.6	249.9	229.4
62.5°	498.6	395.5	270.4	208.7	198.5
65°	444.4	340.0	224.1	180.4	176.4
67.5°	393.0	288.5	180.4	158.4	154.5
70°	338.8	238.3	149.4	136.6	131.3
72.5°	287.3	191.9	124.9	114.7	112.1
75°	236.9	146.8	103.1	94.0	92.8
77.5°	186.8	104.3	81.2	76.0	73.4
80°	140.3	74.7	61.7	56.7	56.7
82.5°	97.9	50.3	42.5	39.9	39.9
85°	55.4	28.3	24.5	24.5	24.5
87.5°	20.7	10.2	10.2	9.0	9.0
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6

TEST NUMBER: P919523

CATALOG NUMBER: DFN2DIP-PN4F0-040D060US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.0	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.0	1402.8	1414.2	1407.9
142.5°	1424.3	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.4	1725.8	1728.4	1737.1	1725.8
172.5°	1740.9	1733.4	1735.9	1744.8	1733.4
175°	1747.2	1738.4	1740.9	1749.7	1737.1
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4

TEST NUMBER: P919523

CATALOG NUMBER: DFN2DIP-PN4F0-040D060US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.87	6.60	6.94	7.67	9.13	1.84	2.57	2.91	3.64	5.09
	3H	7.55	8.20	8.63	9.28	10.75	3.02	3.67	4.10	4.75	6.22
	4H	8.15	8.77	9.24	9.85	11.33	3.46	4.08	4.56	5.16	6.64
	6H	8.57	9.14	9.67	10.22	11.71	3.78	4.35	4.88	5.43	6.92
	8H	8.69	9.24	9.80	10.33	11.82	3.87	4.41	4.97	5.51	6.99
	12H	8.75	9.27	9.86	10.36	11.87	3.91	4.42	5.02	5.52	7.02
4H	2H	5.88	6.50	6.98	7.58	9.06	2.42	3.04	3.52	4.12	5.60
	3H	7.70	8.22	8.81	9.32	10.81	3.76	4.28	4.87	5.38	6.88
	4H	8.39	8.86	9.50	9.96	11.47	4.31	4.78	5.42	5.88	7.39
	6H	8.90	9.31	10.02	10.43	11.93	4.72	5.13	5.84	6.25	7.75
	8H	9.08	9.46	10.20	10.57	12.09	4.85	5.23	5.97	6.34	7.86
	12H	9.17	9.51	10.30	10.64	12.16	4.91	5.25	6.04	6.38	7.90
8H	4H	8.35	8.73	9.47	9.84	11.36	4.58	4.96	5.70	6.07	7.59
	6H	8.92	9.23	10.06	10.38	11.90	5.10	5.41	6.24	6.56	8.08
	8H	9.14	9.41	10.28	10.54	12.08	5.29	5.56	6.43	6.70	8.23
	12H	9.27	9.51	10.42	10.64	12.22	5.41	5.65	6.55	6.78	8.35
12H	4H	8.30	8.64	9.43	9.77	11.29	4.58	4.93	5.72	6.05	7.58
	6H	8.89	9.17	10.04	10.30	11.84	5.15	5.42	6.29	6.55	8.09
	8H	9.11	9.35	10.26	10.48	12.06	5.36	5.60	6.50	6.73	8.30

END OF REPORT