

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919572

Luminaire Tested: DFN2DIP-PN4F0-050D100US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919572
REPORT IS A COMBINATION OF REPORTS P899719 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-050D100US935-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11881.8 lumens
Efficiency: N/A
Efficacy: 99.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 119
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919572

CATALOG NUMBER: DFN2DIP-PN4F0-050D100US935-FLLFLL

Luminous Intensity Polar Plot

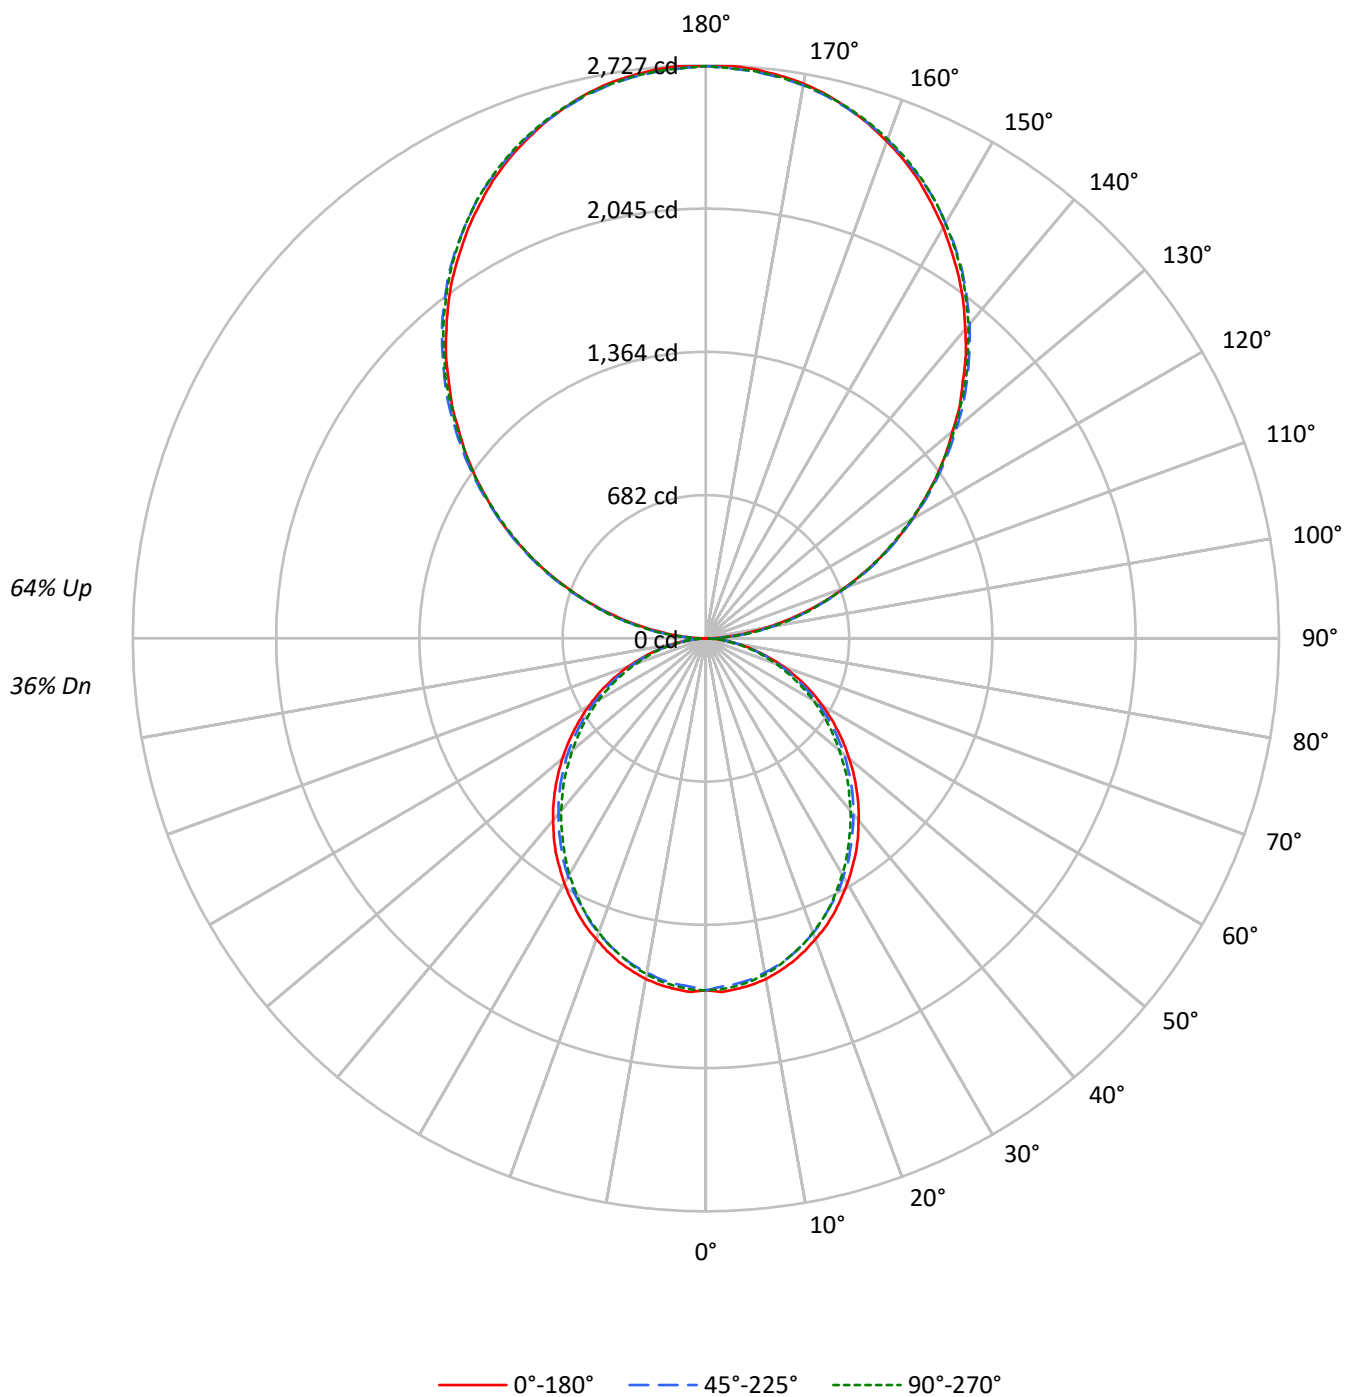

TEST NUMBER: P919572

CATALOG NUMBER: DFN2DIP-PN4F0-050D100US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1223	1223	1223
5°	1225	1206	1214
10°	1215	1190	1198
15°	1197	1170	1172
20°	1173	1143	1146
25°	1149	1111	1116
30°	1119	1081	1078
35°	1090	1045	1037
40°	1055	1009	998
45°	1020	973	959
50°	982	936	913
55°	942	892	871
60°	896	840	823
65°	847	786	766
70°	784	721	705
75°	697	643	649
80°	592	543	541
85°	428	371	362

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2132 cd/sqm

TEST NUMBER: P919572

CATALOG NUMBER: DFN2DIP-PN4F0-050D100US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.7	1.3
10°-20°	443.6	3.7
20°-30°	651.9	5.5
30°-40°	757.2	6.4
40°-50°	756.2	6.4
50°-60°	659.4	5.5
60°-70°	487.4	4.1
70°-80°	275.8	2.3
80°-90°	80.5	0.7
90°-100°	168.5	1.4
100°-110°	535.4	4.5
110°-120°	916.2	7.7
120°-130°	1204.9	10.1
130°-140°	1352.5	11.4
140°-150°	1326.3	11.2
150°-160°	1112.6	9.4
160°-170°	737.8	6.2
170°-180°	257.9	2.2
0°-30°	1253.2	10.5
0°-40°	2010.3	16.9
0°-60°	3425.9	28.8
0°-90°	4269.7	35.9
90°-120°	1620.1	13.6
90°-150°	5503.8	46.3
90°-180°	7612.0	64.1
0°-180°	11881.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1675	1675	1675	1675	1675	
5°	1675	1669	1651	1664	1661	159
15°	1595	1585	1564	1570	1562	449
25°	1443	1430	1403	1406	1403	664
35°	1245	1229	1203	1194	1186	778
45°	1013	1002	978	960	954	782
55°	767	757	738	718	710	686
65°	517	507	491	477	469	511
75°	270	267	259	250	253	289
85°	66	64	63	58	56	74
90°	2	30	80	76	78	12
95°	120	143	147	147	143	133
105°	494	501	506	510	510	522
115°	920	932	928	926	920	909
125°	1337	1358	1351	1344	1341	1195
135°	1730	1755	1760	1758	1751	1337
145°	2100	2116	2130	2132	2123	1312
155°	2401	2408	2415	2427	2419	1105
165°	2612	2610	2610	2626	2615	737
175°	2718	2712	2707	2723	2709	258
180°	2723	2723	2723	2723	2723	

TEST NUMBER: P919572

CATALOG NUMBER: DFN2DIP-PN4F0-050D100US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1675.1	1675.1	1675.1	1675.1	1675.1
2.5°	1684.8	1676.8	1659.1	1675.1	1672.1
5°	1675.1	1668.8	1651.0	1663.8	1660.8
7.5°	1663.8	1654.2	1636.5	1649.5	1646.2
10°	1646.2	1634.9	1615.7	1628.4	1623.7
12.5°	1621.9	1612.4	1593.1	1601.1	1597.8
15°	1594.6	1585.0	1564.0	1570.5	1562.5
17.5°	1560.7	1551.2	1530.2	1538.2	1530.2
20°	1523.7	1514.2	1491.6	1496.3	1490.0
22.5°	1486.8	1472.2	1451.2	1451.2	1447.9
25°	1443.2	1430.4	1403.0	1406.1	1403.0
27.5°	1394.8	1383.5	1362.7	1357.9	1349.9
30°	1346.6	1333.7	1309.6	1304.8	1298.3
32.5°	1295.0	1285.5	1259.6	1249.9	1243.5
35°	1245.1	1229.1	1203.2	1193.5	1185.5
37.5°	1188.7	1174.2	1148.4	1137.1	1129.1
40°	1130.8	1117.8	1092.0	1077.6	1071.2
42.5°	1074.4	1061.4	1035.8	1019.5	1010.0
45°	1013.2	1001.9	977.7	960.1	953.6
47.5°	953.6	942.3	916.5	898.7	889.2
50°	890.7	882.7	860.1	837.6	829.5
52.5°	829.5	818.2	797.4	779.6	768.4
55°	766.8	757.1	737.7	718.4	710.4
57.5°	703.9	695.9	674.9	655.6	649.0
60°	641.0	634.7	612.2	594.3	589.6
62.5°	579.9	568.6	552.5	536.4	529.9
65°	517.1	507.4	491.3	476.8	468.7
67.5°	452.7	444.5	430.2	418.9	412.3
70°	393.0	386.6	372.0	360.8	354.5
72.5°	331.9	325.4	317.4	306.1	301.3
75°	270.5	267.4	259.2	249.7	253.0
77.5°	215.9	209.3	206.1	201.3	196.6
80°	161.2	159.5	156.2	151.4	148.2
82.5°	109.5	109.5	108.0	101.5	101.5
85°	66.0	64.4	62.9	57.9	56.4
87.5°	29.0	25.8	22.6	17.7	16.1
90°	2.5	29.5	80.4	75.5	78.0
92.5°	50.9	69.0	71.5	73.9	73.9
95°	119.9	142.8	147.0	147.0	142.8
97.5°	199.5	220.8	229.9	229.9	229.9
100°	291.4	310.3	316.8	316.8	314.4
102.5°	388.3	402.3	411.3	413.7	411.3
105°	494.2	500.8	505.7	509.8	509.8
107.5°	599.3	609.2	609.2	610.8	599.3
110°	701.1	714.2	714.2	714.2	707.7

TEST NUMBER: P919572

CATALOG NUMBER: DFN2DIP-PN4F0-050D100US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	811.1	825.0	822.6	816.0	811.1
115°	919.5	932.5	928.5	926.0	919.5
117.5°	1027.0	1045.1	1033.5	1027.0	1020.4
120°	1135.3	1153.4	1135.3	1135.3	1128.0
122.5°	1233.8	1256.8	1245.3	1238.8	1233.8
125°	1337.3	1357.8	1351.3	1343.8	1341.4
127.5°	1438.3	1463.7	1454.7	1444.8	1438.3
130°	1532.7	1562.2	1558.1	1553.2	1544.2
132.5°	1638.6	1661.6	1663.2	1651.7	1645.1
135°	1729.7	1755.1	1760.1	1757.6	1751.0
137.5°	1831.5	1852.0	1856.1	1854.5	1844.6
140°	1921.0	1941.5	1953.0	1953.0	1944.0
142.5°	2012.9	2033.4	2040.0	2042.5	2033.4
145°	2099.9	2116.3	2129.5	2131.9	2122.9
147.5°	2177.9	2198.5	2208.3	2212.4	2203.4
150°	2258.4	2272.3	2281.4	2288.7	2281.4
152.5°	2329.8	2343.7	2355.3	2364.3	2355.3
155°	2401.2	2407.8	2415.2	2426.6	2419.2
157.5°	2462.8	2467.7	2471.8	2488.2	2476.7
160°	2517.8	2522.7	2525.1	2539.1	2529.3
162.5°	2568.7	2568.7	2571.1	2586.7	2575.2
165°	2612.2	2609.7	2609.7	2626.1	2614.7
167.5°	2651.6	2644.2	2644.2	2660.7	2649.1
170°	2681.1	2674.6	2672.1	2688.6	2674.6
172.5°	2701.6	2695.1	2692.6	2709.0	2695.1
175°	2718.1	2711.5	2706.6	2723.0	2709.0
177.5°	2727.1	2720.6	2715.6	2729.5	2715.6
180°	2723.0	2723.0	2723.0	2723.0	2723.0

TEST NUMBER: P919572

CATALOG NUMBER: DFN2DIP-PN4F0-050D100US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.51	7.26	7.58	8.33	9.79	6.07	6.82	7.14	7.89	9.35
	3H	8.17	8.84	9.25	9.92	11.39	7.68	8.35	8.76	9.43	10.91
	4H	8.75	9.39	9.84	10.47	11.95	8.27	8.90	9.35	9.98	11.47
	6H	9.15	9.73	10.25	10.82	12.31	8.66	9.24	9.76	10.33	11.82
	8H	9.25	9.81	10.35	10.91	12.40	8.76	9.32	9.86	10.42	11.91
	12H	9.30	9.83	10.40	10.92	12.43	8.80	9.33	9.90	10.42	11.93
4H	2H	6.96	7.60	8.06	8.68	10.16	6.61	7.25	7.71	8.33	9.81
	3H	8.82	9.35	9.92	10.46	11.95	8.42	8.95	9.52	10.06	11.55
	4H	9.53	10.02	10.64	11.12	12.63	9.11	9.60	10.22	10.70	12.22
	6H	10.04	10.46	11.16	11.58	13.09	9.62	10.04	10.73	11.16	12.67
	8H	10.19	10.58	11.31	11.69	13.22	9.76	10.15	10.88	11.27	12.79
	12H	10.26	10.61	11.39	11.74	13.27	9.82	10.17	10.95	11.30	12.83
8H	4H	9.72	10.11	10.83	11.22	12.75	9.35	9.74	10.46	10.85	12.38
	6H	10.35	10.67	11.49	11.83	13.35	9.97	10.30	11.11	11.45	12.97
	8H	10.57	10.85	11.71	11.99	13.53	10.19	10.47	11.33	11.60	13.15
	12H	10.70	10.95	11.85	12.08	13.66	10.30	10.54	11.44	11.68	13.26
12H	4H	9.70	10.05	10.83	11.18	12.71	9.34	9.69	10.47	10.82	12.35
	6H	10.38	10.66	11.52	11.80	13.34	10.01	10.30	11.16	11.43	12.97
	8H	10.62	10.86	11.76	12.00	13.58	10.24	10.49	11.39	11.62	13.20

END OF REPORT