

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919596

Luminaire Tested: DFN2DIP-PN4F0-060D070US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919596
REPORT IS A COMBINATION OF REPORTS P899667 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D070US935-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10448.2 lumens
Efficiency: N/A
Efficacy: 97.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 107.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919596

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-FLLFLL

Luminous Intensity Polar Plot

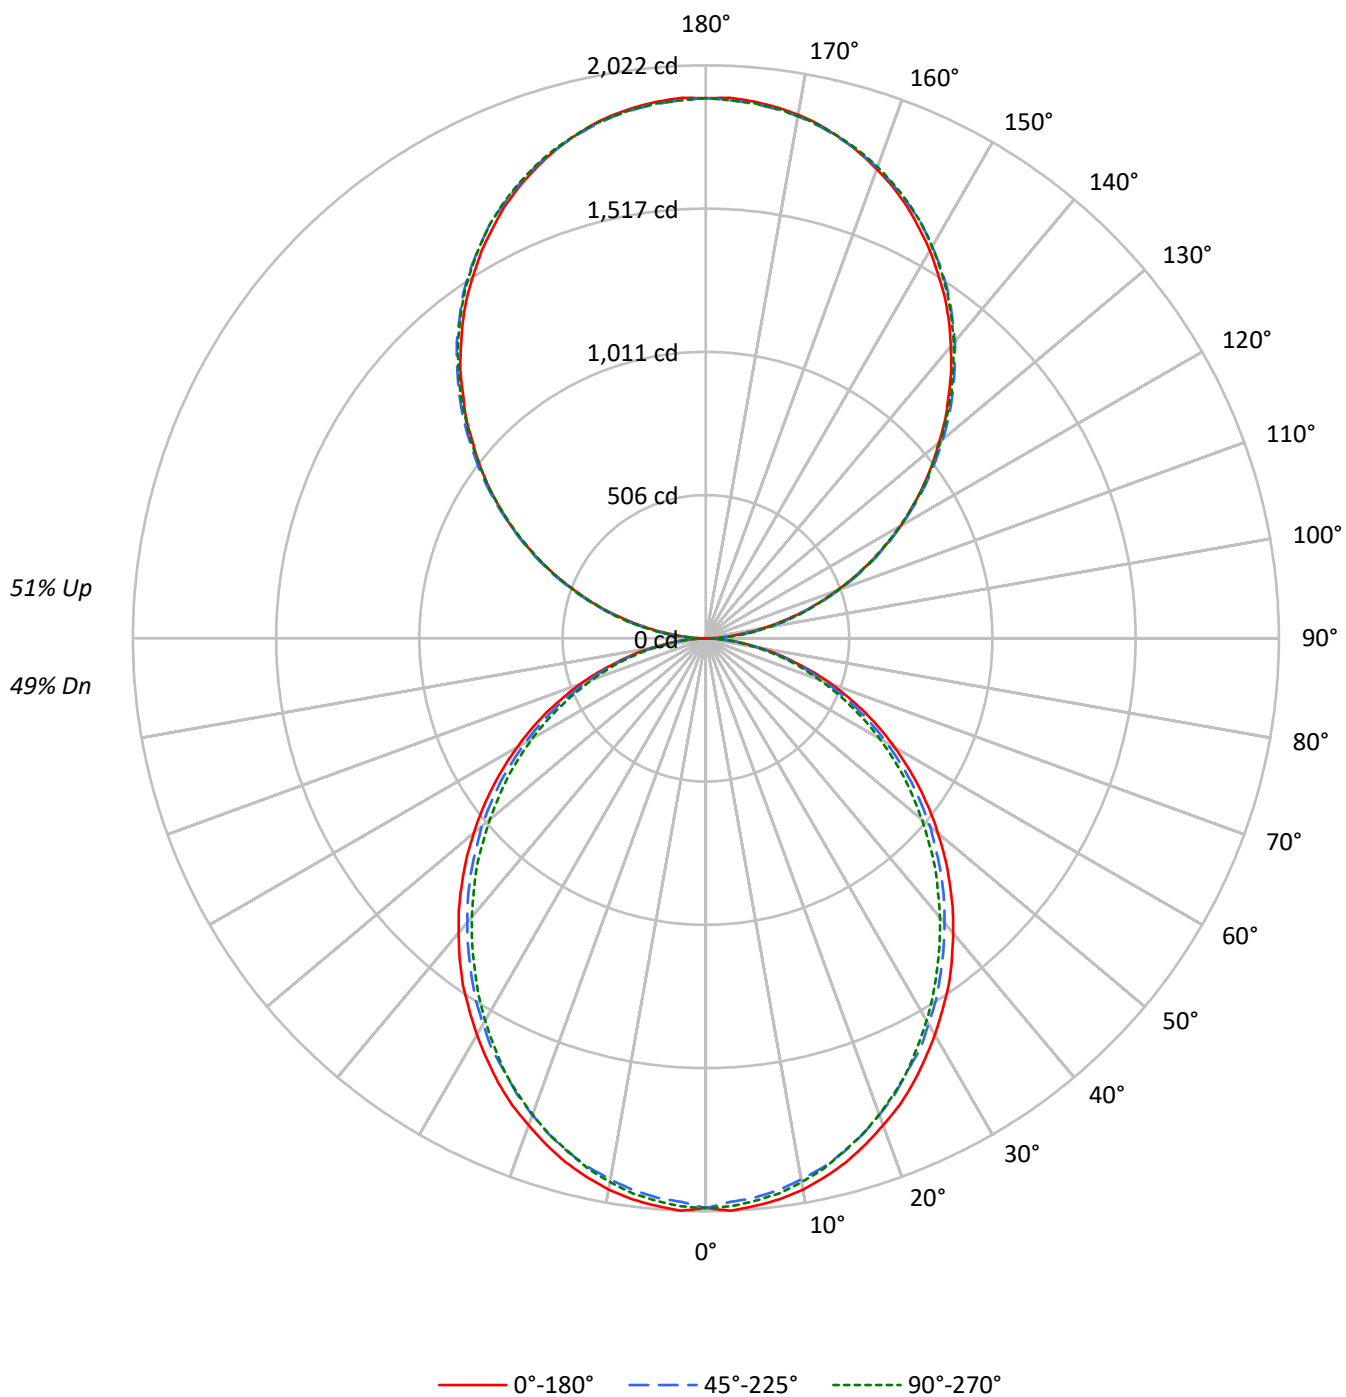

TEST NUMBER: P919596

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55
1	98	93	89	86	90	86	83	80	73	70	68	60	59	57	49	48	47
2	89	81	75	70	82	75	70	65	64	60	56	53	50	48	43	41	39
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	33
4	74	63	55	49	68	59	52	46	50	45	40	42	38	34	34	31	29
5	68	56	48	42	62	52	45	40	45	39	35	37	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	29	26	28	25	22
7	58	46	38	32	53	42	35	30	36	31	27	31	26	23	25	22	20
8	54	41	34	28	49	39	32	27	33	28	24	28	24	21	23	20	18
9	50	38	30	25	46	35	29	24	30	25	21	26	22	19	22	18	16
10	47	35	28	23	43	32	26	22	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1467	1467	1467
5°	1470	1447	1457
10°	1458	1428	1437
15°	1436	1404	1407
20°	1407	1372	1376
25°	1379	1333	1339
30°	1342	1297	1293
35°	1308	1254	1244
40°	1266	1211	1198
45°	1224	1168	1151
50°	1178	1123	1096
55°	1130	1070	1045
60°	1076	1008	987
65°	1016	944	919
70°	941	865	846
75°	836	771	778
80°	711	652	649
85°	513	444	434

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1493 cd/sqm

TEST NUMBER: P919596

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	1.8
10°-20°	532.3	5.1
20°-30°	782.3	7.5
30°-40°	908.6	8.7
40°-50°	907.5	8.7
50°-60°	791.3	7.6
60°-70°	584.9	5.6
70°-80°	330.9	3.2
80°-90°	92.8	0.9
90°-100°	117.9	1.1
100°-110°	374.8	3.6
110°-120°	641.3	6.1
120°-130°	843.5	8.1
130°-140°	946.7	9.1
140°-150°	928.4	8.9
150°-160°	778.8	7.5
160°-170°	516.5	4.9
170°-180°	180.5	1.7
0°-30°	1503.8	14.4
0°-40°	2412.4	23.1
0°-60°	4111.1	39.3
0°-90°	5119.7	49.0
90°-120°	1134.1	10.9
90°-150°	3852.7	36.9
90°-180°	5328.0	51.0
0°-180°	10448.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	2	21	56	53	55	10
95°	84	100	103	103	100	93
105°	346	350	354	357	357	365
115°	644	653	650	648	644	637
125°	936	950	946	941	939	837
135°	1211	1229	1232	1230	1226	936
145°	1470	1481	1491	1492	1486	918
155°	1681	1685	1691	1699	1694	774
165°	1828	1827	1827	1838	1830	516
175°	1903	1898	1895	1906	1896	181
180°	1906	1906	1906	1906	1906	

TEST NUMBER: P919596

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	1.7	20.7	56.3	52.9	54.6
92.5°	35.6	48.3	50.0	51.7	51.7
95°	83.9	100.0	102.9	102.9	100.0
97.5°	139.7	154.5	160.9	160.9	160.9
100°	204.0	217.2	221.8	221.8	220.1
102.5°	271.8	281.5	287.9	289.6	287.9
105°	345.9	350.5	354.0	356.9	356.9
107.5°	419.5	426.4	426.4	427.6	419.5
110°	490.8	500.0	500.0	500.0	495.3

TEST NUMBER: P919596

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	567.7	577.6	575.8	571.2	567.7
115°	643.6	652.8	650.0	648.2	643.6
117.5°	718.8	731.5	723.5	718.8	714.3
120°	794.7	807.4	794.7	794.7	789.5
122.5°	863.7	879.8	871.8	867.1	863.7
125°	936.1	950.5	945.9	940.7	939.0
127.5°	1006.8	1024.6	1018.3	1011.4	1006.8
130°	1072.9	1093.6	1090.7	1087.3	1080.9
132.5°	1147.0	1163.1	1164.2	1156.2	1151.6
135°	1210.8	1228.6	1232.1	1230.3	1225.7
137.5°	1282.0	1296.4	1299.2	1298.1	1291.2
140°	1344.7	1359.1	1367.1	1367.1	1360.8
142.5°	1409.0	1423.4	1428.0	1429.7	1423.4
145°	1470.0	1481.4	1490.6	1492.4	1486.1
147.5°	1524.6	1538.9	1545.8	1548.7	1542.4
150°	1580.9	1590.6	1597.0	1602.1	1597.0
152.5°	1630.8	1640.6	1648.6	1655.0	1648.6
155°	1680.8	1685.4	1690.7	1698.7	1693.5
157.5°	1724.0	1727.4	1730.3	1741.8	1733.7
160°	1762.5	1765.9	1767.6	1777.4	1770.5
162.5°	1798.1	1798.1	1799.8	1810.7	1802.7
165°	1828.5	1826.8	1826.8	1838.3	1830.2
167.5°	1856.1	1851.0	1851.0	1862.4	1854.4
170°	1876.8	1872.2	1870.5	1882.0	1872.2
172.5°	1891.2	1886.5	1884.8	1896.3	1886.5
175°	1902.6	1898.1	1894.6	1906.1	1896.3
177.5°	1909.0	1904.4	1900.9	1910.7	1900.9
180°	1906.1	1906.1	1906.1	1906.1	1906.1

TEST NUMBER: P919596

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.52	9.37	9.48	10.35	11.63	8.08	8.93	9.04	9.91	11.19
	3H	10.18	10.94	11.16	11.93	13.24	9.69	10.46	10.67	11.45	12.76
	4H	10.77	11.49	11.76	12.48	13.80	10.28	11.00	11.27	12.00	13.31
	6H	11.17	11.84	12.17	12.83	14.16	10.68	11.34	11.68	12.34	13.67
	8H	11.28	11.91	12.28	12.93	14.25	10.78	11.42	11.79	12.43	13.76
	12H	11.32	11.93	12.34	12.94	14.29	10.82	11.43	11.84	12.44	13.79
4H	2H	8.98	9.70	9.97	10.69	12.01	8.63	9.35	9.62	10.34	11.66
	3H	10.85	11.45	11.85	12.47	13.80	10.44	11.05	11.45	12.07	13.40
	4H	11.56	12.11	12.57	13.13	14.48	11.14	11.70	12.16	12.71	14.06
	6H	12.08	12.55	13.10	13.59	14.94	11.65	12.13	12.68	13.17	14.52
	8H	12.23	12.67	13.26	13.71	15.07	11.80	12.25	12.83	13.28	14.64
	12H	12.30	12.71	13.35	13.75	15.12	11.86	12.27	12.91	13.31	14.68
8H	4H	11.76	12.20	12.78	13.23	14.60	11.39	11.83	12.41	12.86	14.23
	6H	12.39	12.76	13.44	13.83	15.19	12.02	12.38	13.06	13.46	14.82
	8H	12.61	12.94	13.67	14.00	15.38	12.23	12.55	13.29	13.61	14.99
	12H	12.75	13.03	13.81	14.08	15.51	12.35	12.63	13.41	13.68	15.11
12H	4H	11.74	12.14	12.79	13.19	14.56	11.38	11.78	12.42	12.83	14.20
	6H	12.42	12.75	13.48	13.80	15.18	12.06	12.38	13.11	13.44	14.82
	8H	12.67	12.95	13.73	14.00	15.43	12.29	12.58	13.35	13.63	15.05

END OF REPORT