

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919598

Luminaire Tested: DFN2DIP-PN4F0-060D070US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919598
REPORT IS A COMBINATION OF REPORTS P899668 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D070US935-RLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9725.0 lumens
Efficiency: N/A
Efficacy: 90.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 107.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919598

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-RLLFLL

Luminous Intensity Polar Plot

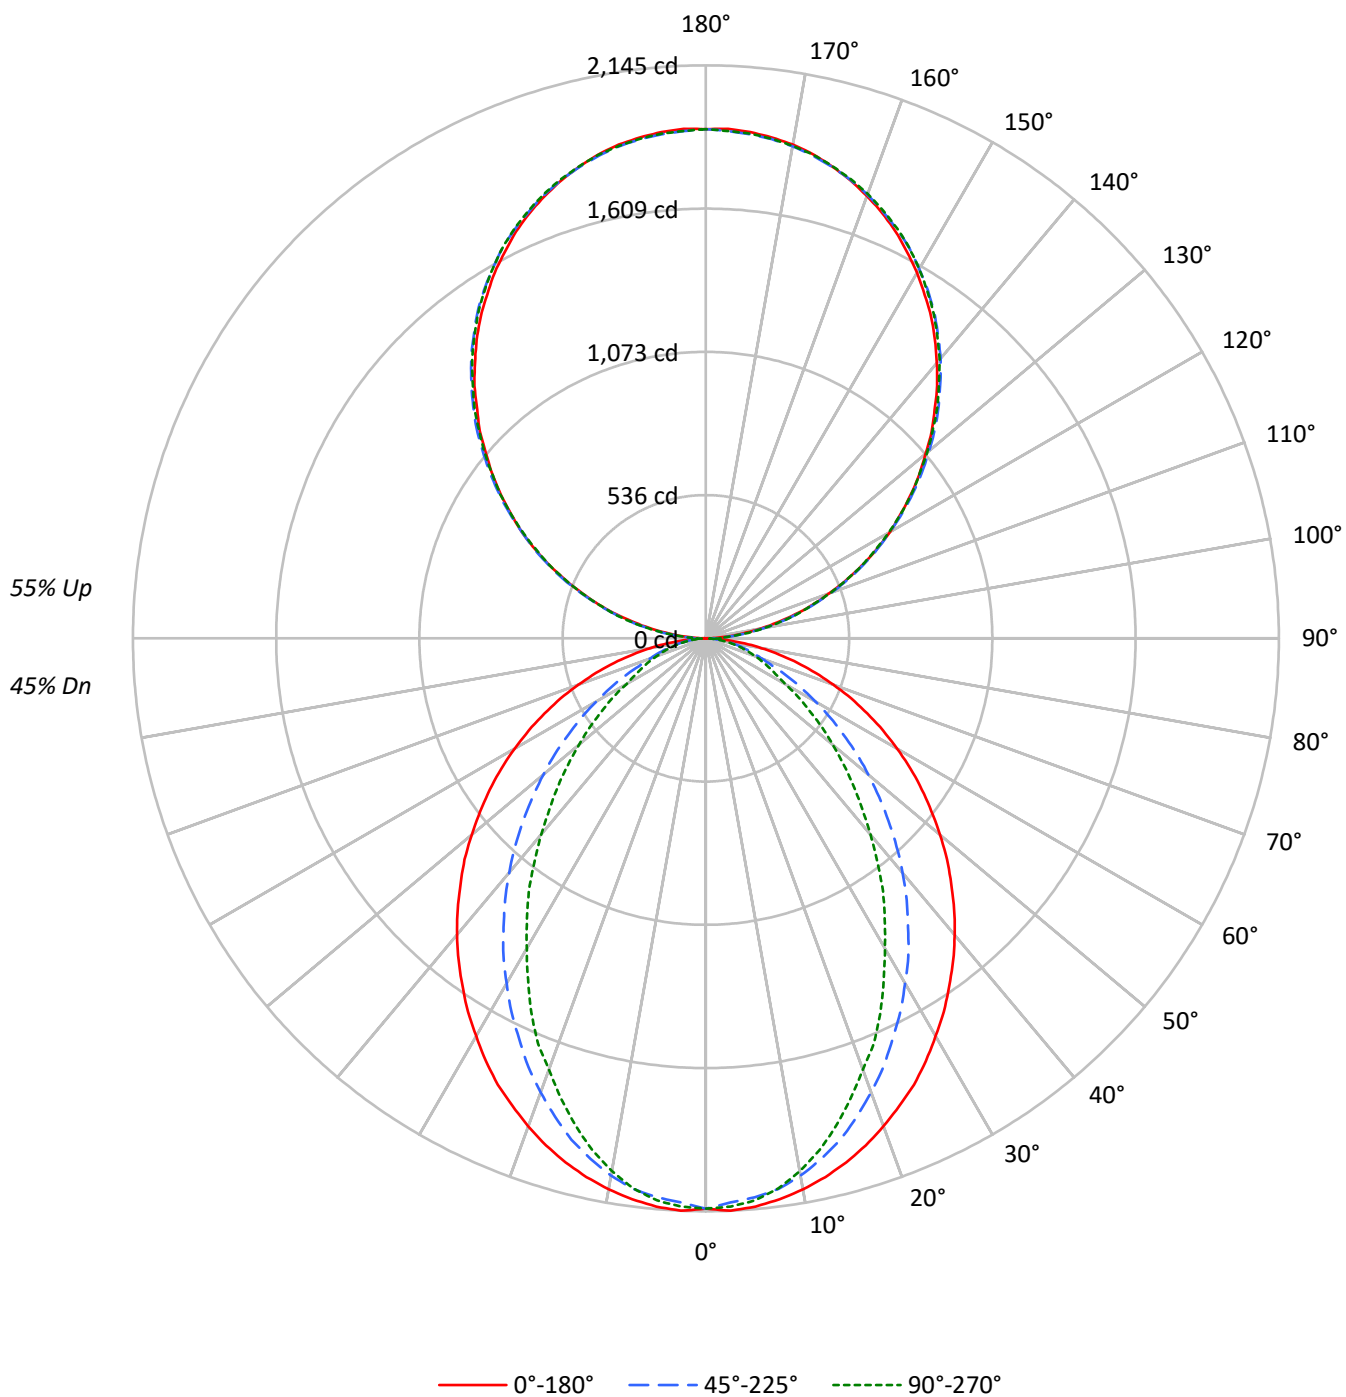

TEST NUMBER: P919598

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	86	89	85	82	79	71	69	67	58	57	55	46	45	44
2	89	82	76	71	81	75	70	66	63	59	56	52	49	47	41	40	38
3	81	72	65	60	74	67	60	56	56	51	48	46	43	40	37	35	33
4	75	64	57	51	68	59	53	47	50	45	41	41	38	35	33	31	29
5	69	57	50	44	63	53	46	41	45	40	36	37	33	30	30	28	25
6	63	52	44	38	58	48	41	36	41	35	31	34	30	27	28	25	23
7	59	47	39	34	54	43	36	32	37	32	28	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18
9	51	39	32	27	47	36	30	25	31	26	22	26	22	19	22	19	17
10	47	36	29	24	44	33	27	23	29	24	20	24	20	18	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1559	1559	1559
5°	1561	1534	1544
10°	1546	1504	1494
15°	1524	1455	1416
20°	1496	1386	1321
25°	1467	1310	1230
30°	1429	1231	1113
35°	1391	1147	1011
40°	1352	1059	893
45°	1307	962	787
50°	1261	864	683
55°	1213	759	583
60°	1156	650	480
65°	1092	538	432
70°	1014	434	392
75°	916	383	357
80°	773	322	311
85°	539	216	235

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1493 cd/sqm

TEST NUMBER: P919598

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.1	2.1
10°-20°	549.3	5.6
20°-30°	771.2	7.9
30°-40°	840.7	8.6
40°-50°	772.7	7.9
50°-60°	606.8	6.2
60°-70°	395.0	4.1
70°-80°	203.3	2.1
80°-90°	57.3	0.6
90°-100°	117.9	1.2
100°-110°	374.8	3.9
110°-120°	641.3	6.6
120°-130°	843.5	8.7
130°-140°	946.7	9.7
140°-150°	928.4	9.5
150°-160°	778.8	8.0
160°-170°	516.5	5.3
170°-180°	180.5	1.9
0°-30°	1520.7	15.6
0°-40°	2361.4	24.3
0°-60°	3740.9	38.5
0°-90°	4396.5	45.2
90°-120°	1134.1	11.7
90°-150°	3852.7	39.6
90°-180°	5328.0	54.8
0°-180°	9725.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2135	2135	2135	2135	2135	
5°	2135	2126	2100	2118	2112	202
15°	2031	2009	1944	1907	1888	572
25°	1843	1782	1654	1575	1546	848
35°	1588	1490	1320	1198	1155	994
45°	1298	1169	966	829	782	1003
55°	987	837	628	512	475	882
65°	667	510	336	271	265	661
75°	356	220	154	141	139	376
85°	83	42	37	37	37	95
90°	2	21	56	53	55	10
95°	84	100	103	103	100	93
105°	346	350	354	357	357	365
115°	644	653	650	648	644	637
125°	936	950	946	941	939	837
135°	1211	1229	1232	1230	1226	936
145°	1470	1481	1491	1492	1486	918
155°	1681	1685	1691	1699	1694	774
165°	1828	1827	1827	1838	1830	516
175°	1903	1898	1895	1906	1896	181
180°	1906	1906	1906	1906	1906	

TEST NUMBER: P919598

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2135.1	2135.1	2135.1	2135.1	2135.1
2.5°	2144.7	2135.1	2113.7	2133.2	2129.3
5°	2135.1	2125.5	2100.2	2117.7	2111.9
7.5°	2117.7	2106.2	2079.1	2086.7	2077.1
10°	2094.5	2080.9	2042.5	2036.5	2025.0
12.5°	2065.6	2048.1	1995.9	1984.4	1963.1
15°	2030.7	2009.4	1943.8	1907.1	1887.8
17.5°	1990.2	1959.2	1878.0	1835.6	1804.7
20°	1943.8	1905.0	1808.5	1760.3	1717.7
22.5°	1893.6	1849.1	1737.0	1671.4	1642.4
25°	1843.4	1781.5	1654.0	1574.9	1545.7
27.5°	1783.6	1717.7	1576.7	1485.8	1441.4
30°	1719.8	1646.1	1491.6	1393.2	1340.9
32.5°	1657.9	1568.9	1410.7	1294.6	1246.2
35°	1588.4	1489.8	1319.8	1198.0	1155.4
37.5°	1520.7	1414.3	1234.8	1101.3	1053.1
40°	1449.1	1333.3	1145.7	1008.6	958.4
42.5°	1375.8	1252.1	1057.0	913.9	865.7
45°	1298.5	1168.9	966.2	828.8	782.5
47.5°	1225.1	1088.0	879.3	741.9	699.5
50°	1143.9	1006.8	794.2	660.7	620.3
52.5°	1064.5	919.6	713.0	585.5	548.8
55°	987.3	836.6	627.9	512.1	475.4
57.5°	908.2	753.5	552.7	444.4	413.5
60°	827.0	672.4	473.4	375.0	344.0
62.5°	747.9	593.3	405.7	313.1	297.6
65°	666.7	510.1	336.2	270.6	264.7
67.5°	589.4	432.7	270.6	237.6	231.9
70°	508.2	357.5	224.0	204.8	197.0
72.5°	430.9	287.8	187.4	172.0	168.1
75°	355.5	220.2	154.5	141.0	139.2
77.5°	280.3	156.4	121.7	114.0	110.1
80°	210.5	112.1	92.6	85.1	85.1
82.5°	146.8	75.4	63.7	59.8	59.8
85°	83.0	42.4	36.7	36.7	36.7
87.5°	31.0	15.4	15.4	13.5	13.5
90°	1.7	20.7	56.3	52.9	54.6
92.5°	35.6	48.3	50.0	51.7	51.7
95°	83.9	100.0	102.9	102.9	100.0
97.5°	139.7	154.5	160.9	160.9	160.9
100°	204.0	217.2	221.8	221.8	220.1
102.5°	271.8	281.5	287.9	289.6	287.9
105°	345.9	350.5	354.0	356.9	356.9
107.5°	419.5	426.4	426.4	427.6	419.5
110°	490.8	500.0	500.0	500.0	495.3



TEST NUMBER: P919598

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	567.7	577.6	575.8	571.2	567.7
115°	643.6	652.8	650.0	648.2	643.6
117.5°	718.8	731.5	723.5	718.8	714.3
120°	794.7	807.4	794.7	794.7	789.5
122.5°	863.7	879.8	871.8	867.1	863.7
125°	936.1	950.5	945.9	940.7	939.0
127.5°	1006.8	1024.6	1018.3	1011.4	1006.8
130°	1072.9	1093.6	1090.7	1087.3	1080.9
132.5°	1147.0	1163.1	1164.2	1156.2	1151.6
135°	1210.8	1228.6	1232.1	1230.3	1225.7
137.5°	1282.0	1296.4	1299.2	1298.1	1291.2
140°	1344.7	1359.1	1367.1	1367.1	1360.8
142.5°	1409.0	1423.4	1428.0	1429.7	1423.4
145°	1470.0	1481.4	1490.6	1492.4	1486.1
147.5°	1524.6	1538.9	1545.8	1548.7	1542.4
150°	1580.9	1590.6	1597.0	1602.1	1597.0
152.5°	1630.8	1640.6	1648.6	1655.0	1648.6
155°	1680.8	1685.4	1690.7	1698.7	1693.5
157.5°	1724.0	1727.4	1730.3	1741.8	1733.7
160°	1762.5	1765.9	1767.6	1777.4	1770.5
162.5°	1798.1	1798.1	1799.8	1810.7	1802.7
165°	1828.5	1826.8	1826.8	1838.3	1830.2
167.5°	1856.1	1851.0	1851.0	1862.4	1854.4
170°	1876.8	1872.2	1870.5	1882.0	1872.2
172.5°	1891.2	1886.5	1884.8	1896.3	1886.5
175°	1902.6	1898.1	1894.6	1906.1	1896.3
177.5°	1909.0	1904.4	1900.9	1910.7	1900.9
180°	1906.1	1906.1	1906.1	1906.1	1906.1

TEST NUMBER: P919598

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.23	9.02	9.23	10.03	11.37	4.19	4.99	5.20	6.00	7.34
	3H	9.91	10.61	10.92	11.63	13.00	5.38	6.09	6.39	7.11	8.47
	4H	10.52	11.19	11.54	12.21	13.58	5.83	6.50	6.86	7.52	8.89
	6H	10.94	11.55	11.97	12.58	13.96	6.15	6.77	7.19	7.79	9.17
	8H	11.06	11.65	12.11	12.69	14.07	6.24	6.83	7.28	7.87	9.25
	12H	11.13	11.68	12.17	12.72	14.12	6.28	6.84	7.33	7.88	9.28
4H	2H	8.24	8.91	9.28	9.93	11.30	4.79	5.46	5.82	6.48	7.85
	3H	10.07	10.63	11.11	11.68	13.06	6.13	6.69	7.18	7.74	9.12
	4H	10.76	11.27	11.81	12.32	13.72	6.68	7.19	7.73	8.23	9.64
	6H	11.28	11.72	12.34	12.78	14.18	7.10	7.54	8.16	8.60	10.00
	8H	11.46	11.87	12.51	12.92	14.34	7.23	7.64	8.29	8.69	10.11
	12H	11.55	11.92	12.63	12.99	14.41	7.29	7.66	8.37	8.73	10.15
8H	4H	10.73	11.14	11.79	12.20	13.61	6.96	7.37	8.02	8.43	9.84
	6H	11.30	11.63	12.38	12.73	14.15	7.48	7.82	8.56	8.92	10.33
	8H	11.52	11.81	12.60	12.90	14.33	7.67	7.97	8.76	9.05	10.48
	12H	11.65	11.92	12.75	12.99	14.47	7.79	8.05	8.88	9.13	10.60
12H	4H	10.68	11.05	11.76	12.12	13.54	6.96	7.33	8.04	8.40	9.82
	6H	11.27	11.57	12.36	12.65	14.08	7.53	7.82	8.62	8.91	10.34
	8H	11.49	11.75	12.58	12.83	14.30	7.74	8.00	8.83	9.08	10.55

END OF REPORT