

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919627

Luminaire Tested: DFN2DIP-PN4F0-070D050US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919627
REPORT IS A COMBINATION OF REPORTS P901154 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-070D050US935-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9384.9 lumens
Efficiency: N/A
Efficacy: 90.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 104.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919627

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US935-RLLONL

Luminous Intensity Polar Plot

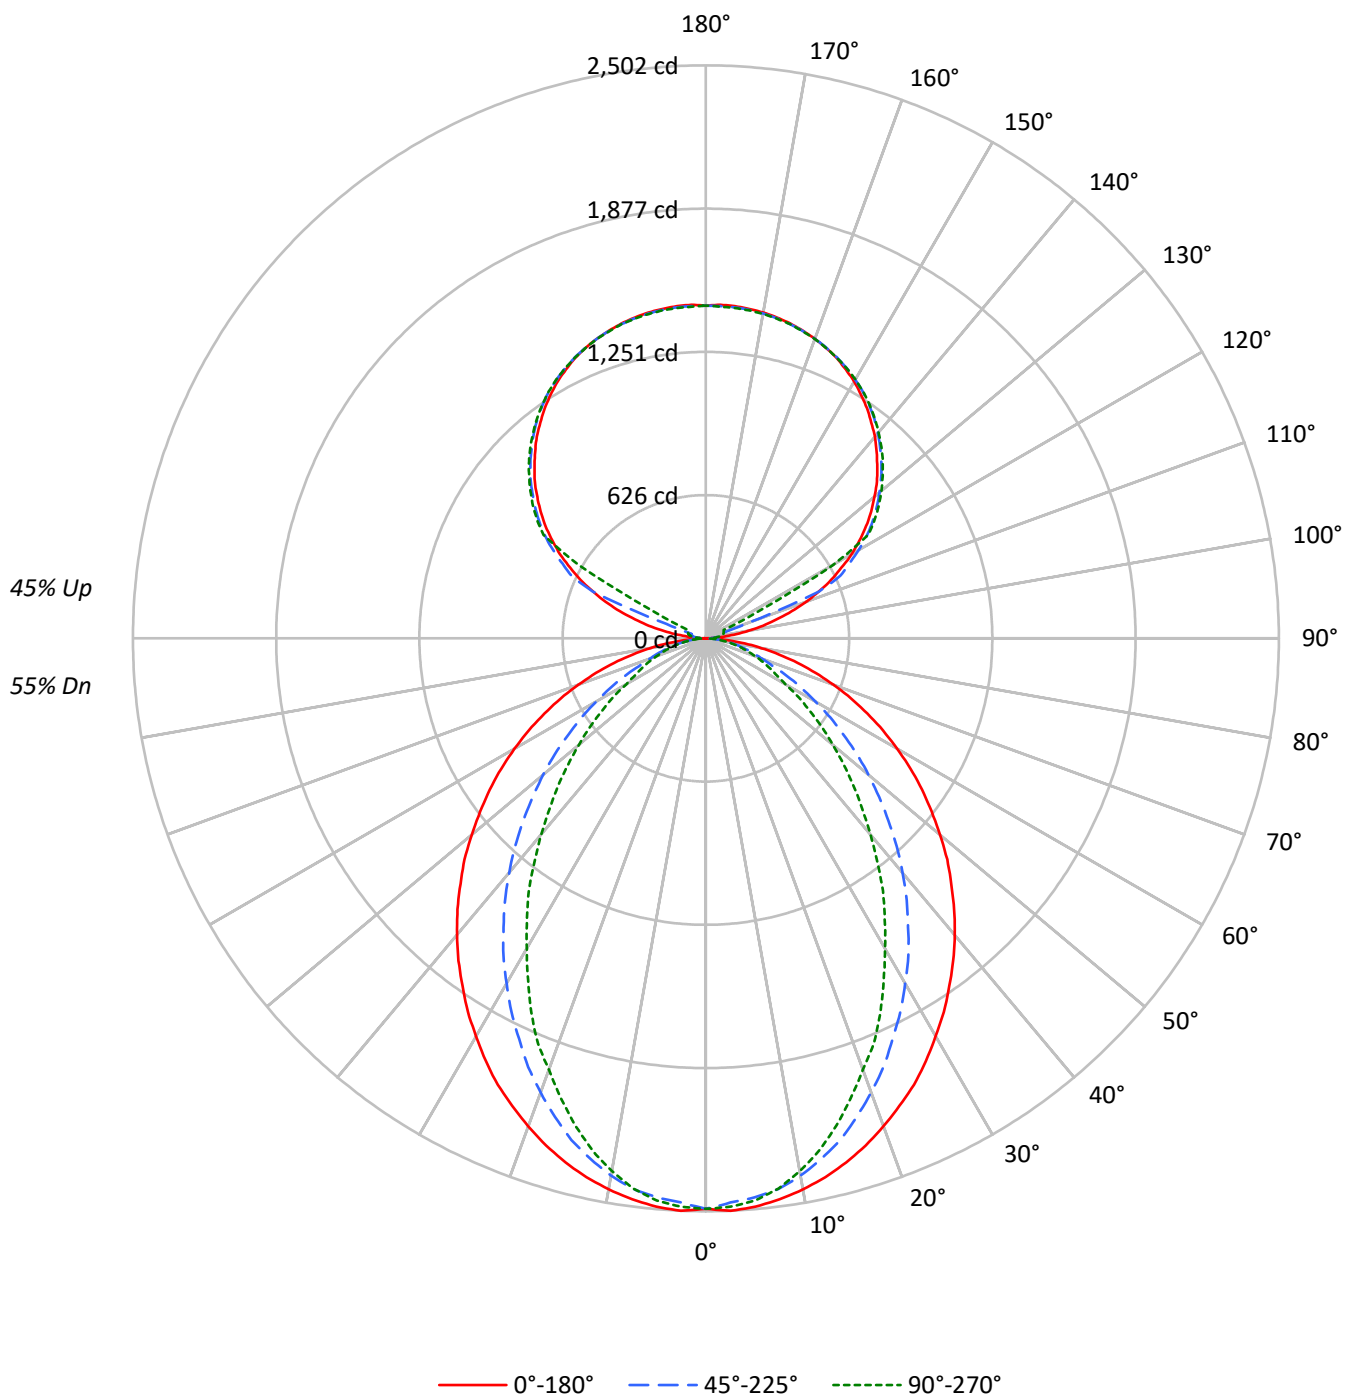

TEST NUMBER: P919627

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	95	91	88	92	89	85	82	76	74	72	65	63	62	54	53	52
2	91	84	78	73	84	78	73	69	67	63	60	57	55	52	48	46	45
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	43	41	39
4	76	66	58	52	71	62	55	50	54	48	44	46	42	39	39	36	34
5	70	59	51	45	65	55	48	43	48	43	38	42	37	34	35	32	30
6	65	53	45	40	60	50	43	38	44	38	34	38	33	30	32	29	26
7	60	48	40	35	56	45	38	33	40	34	30	35	30	27	30	26	24
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21
9	52	40	33	28	49	38	31	27	34	28	24	29	25	22	25	22	19
10	49	37	30	25	46	35	28	24	31	26	22	27	23	20	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1818	1818	1818
5°	1821	1790	1801
10°	1803	1755	1743
15°	1778	1697	1653
20°	1746	1617	1542
25°	1712	1528	1435
30°	1667	1436	1299
35°	1622	1338	1179
40°	1577	1236	1042
45°	1525	1122	918
50°	1471	1008	797
55°	1415	886	680
60°	1349	758	560
65°	1274	628	504
70°	1183	507	457
75°	1068	447	417
80°	902	376	363
85°	629	252	275

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1525 cd/sqm

TEST NUMBER: P919627

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US935-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	233.5	2.5
10°-20°	640.9	6.8
20°-30°	899.8	9.6
30°-40°	980.8	10.5
40°-50°	901.5	9.6
50°-60°	708.0	7.5
60°-70°	460.8	4.9
70°-80°	237.2	2.5
80°-90°	63.1	0.7
90°-100°	47.9	0.5
100°-110°	178.6	1.9
110°-120°	473.7	5.0
120°-130°	785.6	8.4
130°-140°	834.5	8.9
140°-150°	775.6	8.3
150°-160°	623.5	6.6
160°-170°	401.8	4.3
170°-180°	138.3	1.5
0°-30°	1774.1	18.9
0°-40°	2754.9	29.4
0°-60°	4364.3	46.5
0°-90°	5125.5	54.6
90°-120°	700.2	7.5
90°-150°	3095.8	33.0
90°-180°	4259.0	45.4
0°-180°	9384.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2491	2491	2491	2491	2491	
5°	2491	2480	2450	2471	2464	236
15°	2369	2344	2268	2225	2202	668
25°	2151	2078	1930	1837	1803	989
35°	1853	1738	1540	1398	1348	1160
45°	1515	1364	1127	967	913	1170
55°	1152	976	732	597	555	1029
65°	778	595	392	316	309	771
75°	415	257	180	164	162	439
85°	97	50	43	43	43	111
90°	1	13	21	26	28	9
95°	68	34	41	46	45	81
105°	320	351	64	76	80	342
115°	604	622	649	162	86	595
125°	855	868	888	896	899	762
135°	1058	1074	1084	1094	1092	817
145°	1227	1226	1244	1251	1246	767
155°	1351	1342	1354	1360	1352	622
165°	1423	1417	1420	1428	1420	402
175°	1456	1449	1451	1458	1448	139
180°	1453	1453	1453	1453	1453	

TEST NUMBER: P919627

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2491.0	2491.0	2491.0	2491.0	2491.0
2.5°	2502.1	2491.0	2466.1	2488.8	2484.2
5°	2491.0	2479.7	2450.3	2470.6	2463.9
7.5°	2470.6	2457.2	2425.7	2434.5	2423.3
10°	2443.6	2427.8	2382.8	2375.9	2362.5
12.5°	2409.8	2389.5	2328.6	2315.1	2290.3
15°	2369.2	2344.3	2267.8	2225.0	2202.5
17.5°	2321.9	2285.8	2191.1	2141.5	2105.4
20°	2267.8	2222.6	2110.0	2053.7	2004.0
22.5°	2209.2	2157.3	2026.4	1949.9	1916.2
25°	2150.6	2078.4	1929.6	1837.3	1803.4
27.5°	2080.8	2004.0	1839.4	1733.5	1681.6
30°	2006.4	1920.5	1740.2	1625.4	1564.4
32.5°	1934.1	1830.4	1645.7	1510.4	1453.9
35°	1853.0	1738.0	1539.8	1397.7	1348.0
37.5°	1774.2	1650.0	1440.5	1284.8	1228.6
40°	1690.7	1555.6	1336.7	1176.7	1118.1
42.5°	1605.1	1460.9	1233.1	1066.2	1010.0
45°	1514.9	1363.7	1127.2	967.0	912.9
47.5°	1429.3	1269.3	1025.8	865.6	816.1
50°	1334.5	1174.6	926.5	770.9	723.8
52.5°	1242.0	1072.9	831.8	683.0	640.2
55°	1151.8	976.0	732.5	597.4	554.7
57.5°	1059.5	879.2	644.8	518.5	482.4
60°	964.8	784.5	552.2	437.5	401.3
62.5°	872.4	692.2	473.3	365.2	347.2
65°	777.7	595.0	392.3	315.7	308.8
67.5°	687.6	504.9	315.7	277.2	270.5
70°	592.9	417.1	261.4	238.9	229.8
72.5°	502.7	335.8	218.6	200.7	196.1
75°	414.7	256.8	180.3	164.5	162.4
77.5°	326.9	182.4	142.1	132.9	128.5
80°	245.6	130.8	108.1	99.3	99.3
82.5°	171.3	88.0	74.4	69.8	69.8
85°	96.9	49.5	42.8	42.8	42.8
87.5°	36.1	17.9	17.9	15.8	15.8
90°	1.0	12.6	21.0	26.3	28.3
92.5°	26.3	22.1	25.2	27.4	28.3
95°	68.3	33.6	41.0	46.3	45.2
97.5°	123.0	36.9	53.6	56.8	57.8
100°	186.1	42.1	59.9	68.3	70.4
102.5°	255.5	253.4	62.1	73.5	76.8
105°	319.6	351.2	64.1	75.7	79.9
107.5°	394.3	420.4	66.3	77.7	82.1
110°	465.8	487.8	184.0	78.9	83.0

TEST NUMBER: P919627

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	533.0	551.9	534.1	80.9	84.1
115°	604.5	622.3	648.7	162.0	86.3
117.5°	666.5	687.5	705.5	555.0	279.7
120°	735.9	751.7	770.6	783.2	641.3
122.5°	794.7	811.6	832.7	839.0	840.1
125°	854.6	868.4	888.4	895.7	898.9
127.5°	909.3	924.0	940.0	950.4	951.4
130°	960.9	977.7	989.2	1000.8	999.9
132.5°	1013.5	1027.2	1038.6	1048.2	1047.1
135°	1057.6	1074.5	1083.8	1094.5	1092.3
137.5°	1103.8	1116.5	1127.0	1137.6	1134.5
140°	1149.0	1157.5	1169.0	1178.4	1173.3
142.5°	1187.0	1194.4	1208.0	1216.3	1211.1
145°	1226.9	1225.8	1243.6	1251.0	1245.8
147.5°	1261.5	1258.3	1276.3	1281.5	1277.4
150°	1295.2	1287.9	1304.7	1311.0	1305.7
152.5°	1323.5	1315.2	1330.9	1337.3	1329.9
155°	1350.9	1341.5	1354.1	1360.4	1352.0
157.5°	1372.9	1364.6	1374.1	1381.5	1372.9
160°	1392.0	1385.6	1392.0	1398.2	1390.9
162.5°	1408.7	1402.5	1407.6	1415.0	1405.6
165°	1423.4	1417.2	1420.3	1427.6	1420.3
167.5°	1435.0	1428.7	1431.9	1439.2	1429.8
170°	1444.5	1438.1	1440.3	1447.6	1438.1
172.5°	1450.8	1444.5	1446.6	1454.0	1444.5
175°	1456.0	1448.6	1450.8	1458.1	1447.6
177.5°	1458.1	1450.8	1451.9	1459.2	1449.7
180°	1452.8	1452.8	1452.8	1452.8	1452.8

TEST NUMBER: P919627

CATALOG NUMBER: DFN2DIP-PN4F0-070D050US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.65	10.52	10.58	11.46	12.66	5.62	6.49	6.54	7.42	8.63
	3H	11.34	12.11	12.27	13.06	14.29	6.81	7.59	7.74	8.53	9.76
	4H	11.95	12.68	12.90	13.63	14.87	7.26	8.00	8.21	8.95	10.19
	6H	12.37	13.05	13.33	14.01	15.26	7.59	8.26	8.55	9.22	10.47
	8H	12.50	13.15	13.47	14.12	15.37	7.68	8.32	8.65	9.29	10.54
	12H	12.57	13.18	13.54	14.15	15.42	7.72	8.33	8.70	9.30	10.58
4H	2H	9.68	10.41	10.63	11.36	12.60	6.22	6.95	7.17	7.90	9.14
	3H	11.51	12.12	12.48	13.10	14.36	7.57	8.18	8.54	9.16	10.42
	4H	12.21	12.76	13.18	13.74	15.02	8.12	8.68	9.10	9.66	10.93
	6H	12.73	13.21	13.71	14.20	15.48	8.55	9.02	9.53	10.02	11.30
	8H	12.90	13.35	13.89	14.34	15.63	8.68	9.12	9.66	10.12	11.41
	12H	13.00	13.41	14.01	14.41	15.71	8.74	9.15	9.75	10.15	11.45
8H	4H	12.18	12.62	13.17	13.62	14.91	8.41	8.86	9.40	9.85	11.14
	6H	12.75	13.12	13.76	14.15	15.44	8.93	9.30	9.94	10.33	11.62
	8H	12.97	13.29	13.99	14.31	15.62	9.12	9.45	10.14	10.47	11.78
	12H	13.11	13.40	14.13	14.41	15.76	9.24	9.53	10.27	10.54	11.90
12H	4H	12.13	12.53	13.14	13.54	14.84	8.42	8.82	9.42	9.83	11.12
	6H	12.72	13.05	13.75	14.07	15.38	8.98	9.31	10.00	10.33	11.63
	8H	12.95	13.23	13.97	14.25	15.60	9.19	9.48	10.22	10.49	11.85

END OF REPORT