

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919682

Luminaire Tested: DFN2DIP-PN4F0-080D100US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919682
REPORT IS A COMBINATION OF REPORTS P899726 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-080D100US935-RLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13474.7 lumens
Efficiency: N/A
Efficacy: 88.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 152.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919682

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US935-RLLFLL

Luminous Intensity Polar Plot

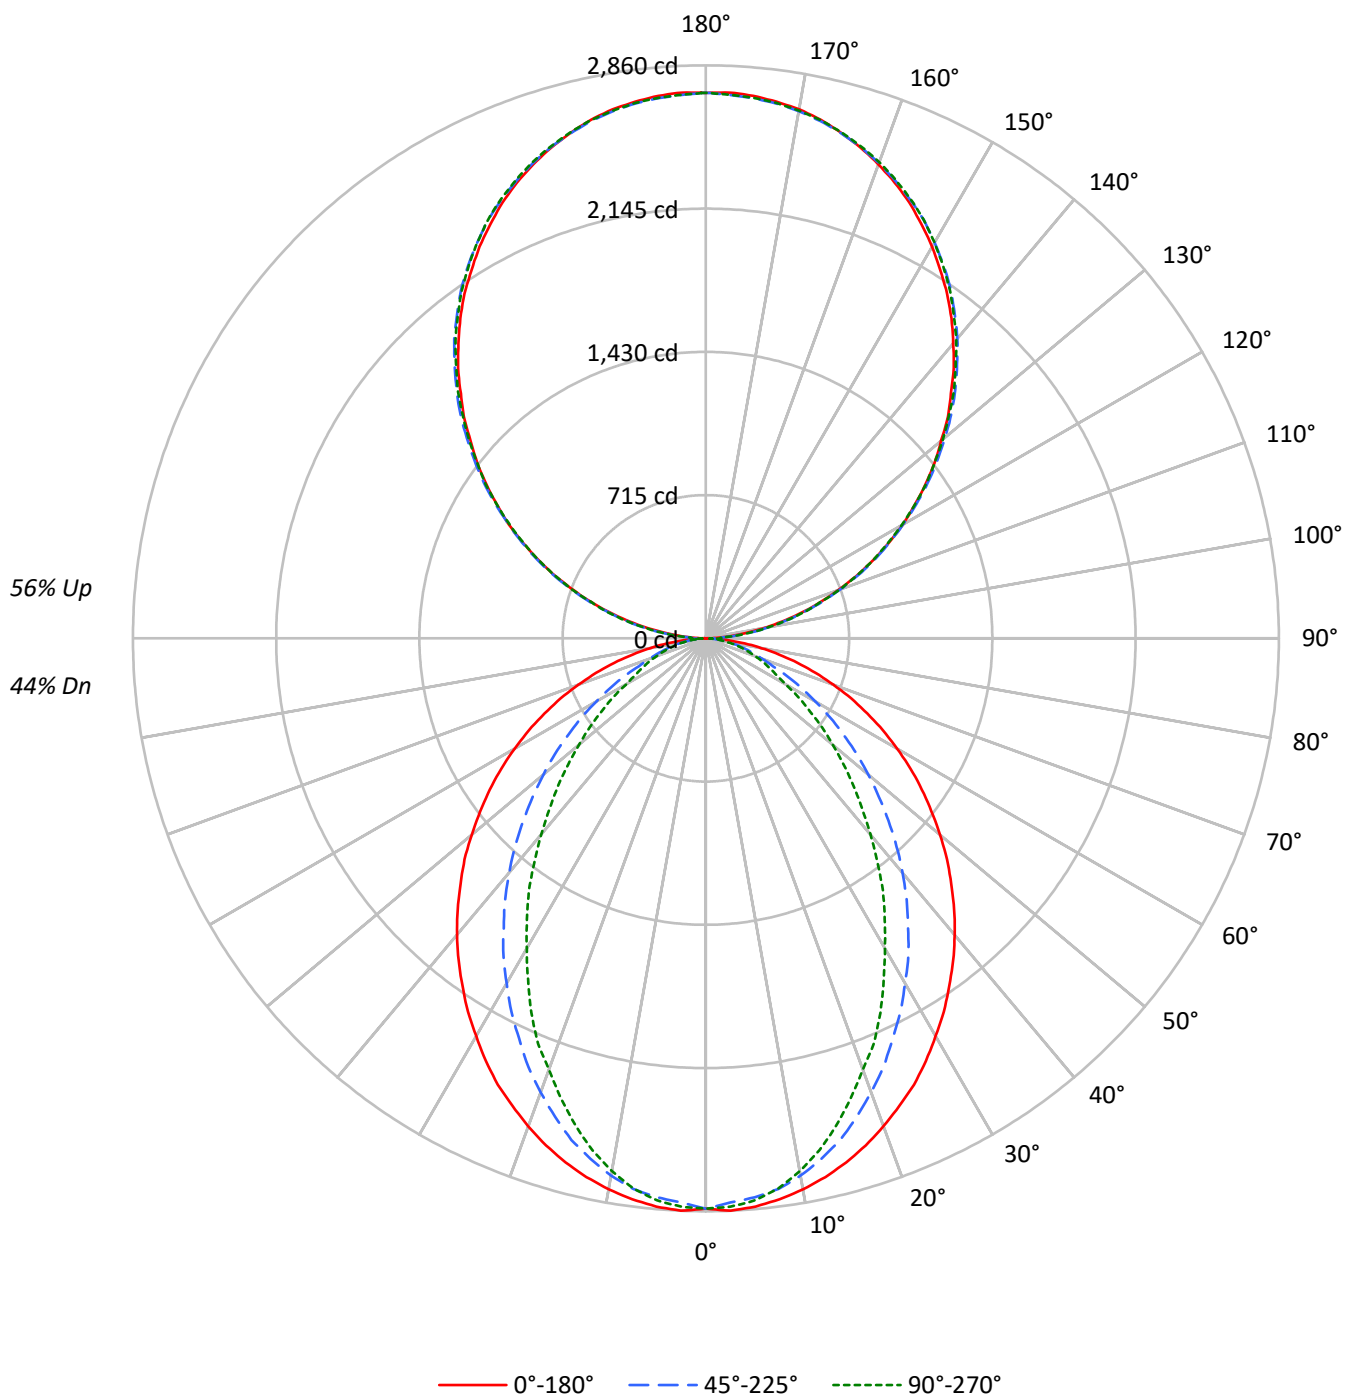

TEST NUMBER: P919682

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	70	68	66	57	56	54	45	44	43
2	88	81	75	71	81	75	70	65	62	59	55	51	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	40	41	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	37	33	30	29	27	25
6	63	51	43	38	57	47	41	35	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	25	22	20
8	54	42	35	30	50	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2078	2078	2078
5°	2081	2045	2059
10°	2061	2006	1992
15°	2032	1939	1889
20°	1995	1848	1762
25°	1956	1746	1640
30°	1905	1641	1484
35°	1854	1529	1348
40°	1803	1412	1191
45°	1743	1283	1049
50°	1681	1152	910
55°	1617	1012	777
60°	1542	866	640
65°	1456	717	576
70°	1352	579	522
75°	1221	511	476
80°	1031	430	414
85°	719	288	314

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2132 cd/sqm

TEST NUMBER: P919682

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	266.8	2.0
10°-20°	732.4	5.4
20°-30°	1028.3	7.6
30°-40°	1120.9	8.3
40°-50°	1030.3	7.6
50°-60°	809.1	6.0
60°-70°	526.6	3.9
70°-80°	271.1	2.0
80°-90°	76.9	0.6
90°-100°	168.5	1.3
100°-110°	535.4	4.0
110°-120°	916.2	6.8
120°-130°	1204.9	8.9
130°-140°	1352.5	10.0
140°-150°	1326.3	9.8
150°-160°	1112.6	8.3
160°-170°	737.8	5.5
170°-180°	257.9	1.9
0°-30°	2027.6	15.0
0°-40°	3148.5	23.4
0°-60°	4987.8	37.0
0°-90°	5862.5	43.5
90°-120°	1620.1	12.0
90°-150°	5503.8	40.8
90°-180°	7612.0	56.5
0°-180°	13474.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2847	2847	2847	2847	2847	
5°	2847	2834	2800	2824	2816	270
15°	2708	2679	2592	2543	2517	763
25°	2458	2375	2205	2100	2061	1130
35°	2118	1986	1760	1597	1540	1326
45°	1731	1559	1288	1105	1043	1337
55°	1316	1116	837	683	634	1176
65°	889	680	448	361	353	881
75°	474	294	206	188	186	501
85°	111	57	49	49	49	127
90°	2	30	80	76	78	13
95°	120	143	147	147	143	133
105°	494	501	506	510	510	522
115°	920	932	928	926	920	909
125°	1337	1358	1351	1344	1341	1195
135°	1730	1755	1760	1758	1751	1337
145°	2100	2116	2130	2132	2123	1312
155°	2401	2408	2415	2427	2419	1105
165°	2612	2610	2610	2626	2615	737
175°	2718	2712	2707	2723	2709	258
180°	2723	2723	2723	2723	2723	

TEST NUMBER: P919682

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2846.8	2846.8	2846.8	2846.8	2846.8
2.5°	2859.6	2846.8	2818.4	2844.3	2839.1
5°	2846.8	2834.0	2800.3	2823.6	2815.9
7.5°	2823.6	2808.2	2772.2	2782.3	2769.4
10°	2792.6	2774.7	2723.3	2715.3	2700.0
12.5°	2754.2	2730.9	2661.2	2645.8	2617.4
15°	2707.7	2679.3	2591.8	2542.9	2517.1
17.5°	2653.5	2612.3	2504.0	2447.5	2406.1
20°	2591.8	2540.1	2411.4	2347.2	2290.3
22.5°	2524.8	2465.5	2316.0	2228.5	2189.9
25°	2457.8	2375.3	2205.3	2099.8	2061.0
27.5°	2378.0	2290.3	2102.2	1981.2	1921.8
30°	2293.0	2194.9	1988.8	1857.6	1787.9
32.5°	2210.4	2091.9	1880.8	1726.1	1661.6
35°	2117.8	1986.3	1759.7	1597.4	1540.5
37.5°	2027.6	1885.8	1646.3	1468.3	1404.1
40°	1932.3	1777.8	1527.7	1344.8	1277.8
42.5°	1834.4	1669.6	1409.3	1218.6	1154.3
45°	1731.3	1558.6	1288.2	1105.1	1043.4
47.5°	1633.5	1450.6	1172.3	989.2	932.6
50°	1525.2	1342.4	1058.9	881.0	827.1
52.5°	1419.4	1226.1	950.6	780.7	731.8
55°	1316.4	1115.5	837.2	682.8	633.9
57.5°	1210.9	1004.8	736.9	592.6	551.3
60°	1102.6	896.6	631.1	499.9	458.7
62.5°	997.1	791.0	541.0	417.4	396.9
65°	888.9	680.0	448.2	360.8	352.8
67.5°	785.8	577.0	360.8	316.8	309.2
70°	677.6	476.7	298.8	273.0	262.7
72.5°	574.5	383.7	249.9	229.4	224.1
75°	474.0	293.6	206.1	188.0	185.6
77.5°	373.7	208.5	162.4	152.0	146.8
80°	280.7	149.6	123.6	113.4	113.4
82.5°	195.7	100.6	85.0	79.8	79.8
85°	110.7	56.6	48.9	48.9	48.9
87.5°	41.2	20.5	20.5	18.1	18.1
90°	2.5	29.5	80.4	75.5	78.0
92.5°	50.9	69.0	71.5	73.9	73.9
95°	119.9	142.8	147.0	147.0	142.8
97.5°	199.5	220.8	229.9	229.9	229.9
100°	291.4	310.3	316.8	316.8	314.4
102.5°	388.3	402.3	411.3	413.7	411.3
105°	494.2	500.8	505.7	509.8	509.8
107.5°	599.3	609.2	609.2	610.8	599.3
110°	701.1	714.2	714.2	714.2	707.7

TEST NUMBER: P919682

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	811.1	825.0	822.6	816.0	811.1
115°	919.5	932.5	928.5	926.0	919.5
117.5°	1027.0	1045.1	1033.5	1027.0	1020.4
120°	1135.3	1153.4	1135.3	1135.3	1128.0
122.5°	1233.8	1256.8	1245.3	1238.8	1233.8
125°	1337.3	1357.8	1351.3	1343.8	1341.4
127.5°	1438.3	1463.7	1454.7	1444.8	1438.3
130°	1532.7	1562.2	1558.1	1553.2	1544.2
132.5°	1638.6	1661.6	1663.2	1651.7	1645.1
135°	1729.7	1755.1	1760.1	1757.6	1751.0
137.5°	1831.5	1852.0	1856.1	1854.5	1844.6
140°	1921.0	1941.5	1953.0	1953.0	1944.0
142.5°	2012.9	2033.4	2040.0	2042.5	2033.4
145°	2099.9	2116.3	2129.5	2131.9	2122.9
147.5°	2177.9	2198.5	2208.3	2212.4	2203.4
150°	2258.4	2272.3	2281.4	2288.7	2281.4
152.5°	2329.8	2343.7	2355.3	2364.3	2355.3
155°	2401.2	2407.8	2415.2	2426.6	2419.2
157.5°	2462.8	2467.7	2471.8	2488.2	2476.7
160°	2517.8	2522.7	2525.1	2539.1	2529.3
162.5°	2568.7	2568.7	2571.1	2586.7	2575.2
165°	2612.2	2609.7	2609.7	2626.1	2614.7
167.5°	2651.6	2644.2	2644.2	2660.7	2649.1
170°	2681.1	2674.6	2672.1	2688.6	2674.6
172.5°	2701.6	2695.1	2692.6	2709.0	2695.1
175°	2718.1	2711.5	2706.6	2723.0	2709.0
177.5°	2727.1	2720.6	2715.6	2729.5	2715.6
180°	2723.0	2723.0	2723.0	2723.0	2723.0

TEST NUMBER: P919682

CATALOG NUMBER: DFN2DIP-PN4F0-080D100US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.06	9.84	10.07	10.86	12.22	5.02	5.80	6.04	6.82	8.19
	3H	10.73	11.43	11.76	12.46	13.84	6.21	6.90	7.23	7.93	9.32
	4H	11.34	12.00	12.38	13.03	14.42	6.65	7.31	7.69	8.35	9.74
	6H	11.76	12.37	12.81	13.41	14.81	6.97	7.58	8.02	8.62	10.02
	8H	11.89	12.47	12.94	13.52	14.92	7.06	7.64	8.12	8.69	10.09
	12H	11.95	12.50	13.01	13.55	14.97	7.11	7.65	8.16	8.70	10.12
4H	2H	9.07	9.73	10.11	10.76	12.15	5.61	6.27	6.66	7.30	8.70
	3H	10.90	11.44	11.95	12.51	13.91	6.96	7.51	8.01	8.57	9.97
	4H	11.59	12.09	12.65	13.14	14.57	7.50	8.01	8.56	9.06	10.49
	6H	12.10	12.53	13.17	13.61	15.03	7.92	8.35	8.99	9.43	10.85
	8H	12.28	12.68	13.35	13.75	15.19	8.05	8.45	9.12	9.52	10.96
	12H	12.37	12.74	13.46	13.82	15.26	8.11	8.48	9.20	9.56	11.00
8H	4H	11.55	11.95	12.62	13.02	14.46	7.78	8.18	8.85	9.25	10.69
	6H	12.12	12.45	13.21	13.56	15.00	8.30	8.63	9.39	9.74	11.18
	8H	12.34	12.63	13.44	13.72	15.18	8.49	8.78	9.59	9.88	11.33
	12H	12.48	12.73	13.58	13.82	15.31	8.61	8.87	9.71	9.95	11.45
12H	4H	11.50	11.87	12.59	12.95	14.39	7.79	8.15	8.87	9.23	10.67
	6H	12.09	12.39	13.19	13.48	14.93	8.35	8.64	9.45	9.74	11.19
	8H	12.32	12.57	13.42	13.66	15.15	8.56	8.82	9.66	9.90	11.40