

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919692

Luminaire Tested: DFN2DIP-PN4F0-090D040US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919692
REPORT IS A COMBINATION OF REPORTS P899619 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-090D040US935-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10719.5 lumens
Efficiency: N/A
Efficacy: 90.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 118.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919692

CATALOG NUMBER: DFN2DIP-PN4F0-090D040US935-FLLFLL

Luminous Intensity Polar Plot

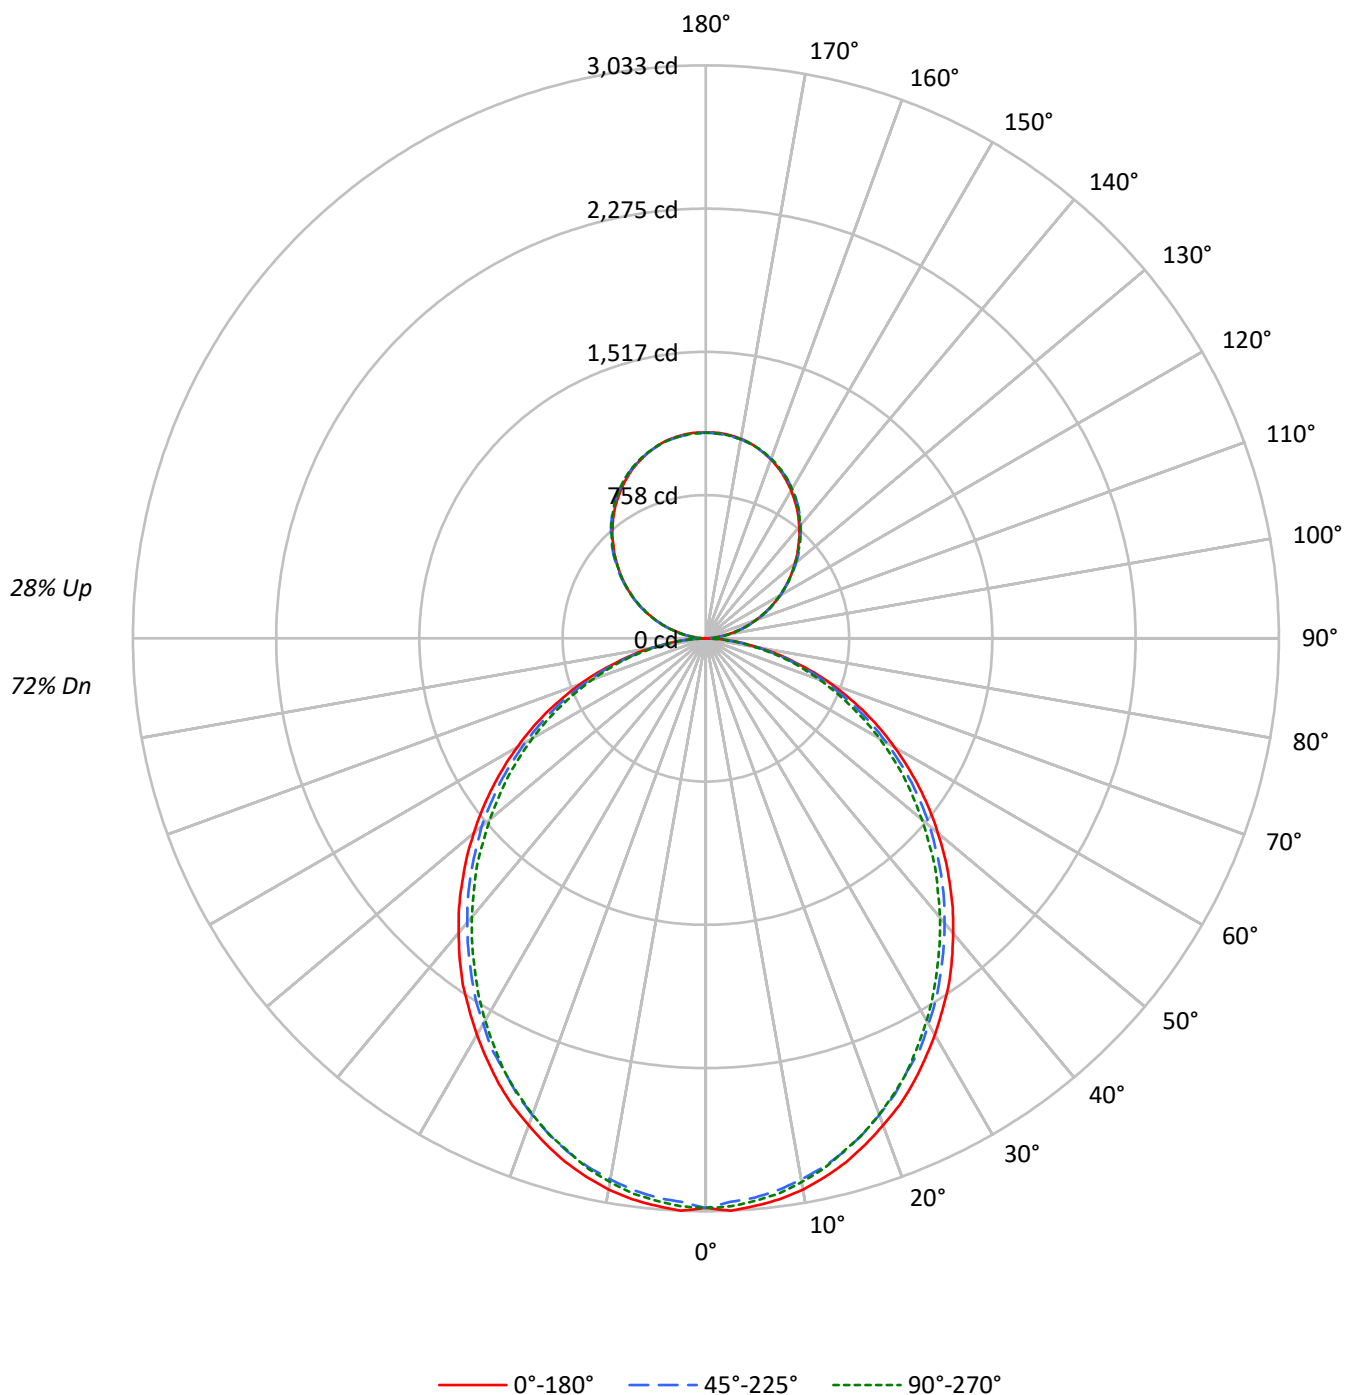

TEST NUMBER: P919692

CATALOG NUMBER: DFN2DIP-PN4F0-090D040US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95	85	85	85	76	76	76
1	103	98	94	91	97	93	90	86	84	81	79	75	73	71	67	66	64
2	93	86	79	74	88	81	76	71	73	69	65	66	63	59	59	56	54
3	85	75	68	62	81	72	65	59	65	59	55	58	54	50	52	49	46
4	78	67	59	52	74	64	56	51	58	52	47	52	47	43	47	43	40
5	72	60	51	45	68	57	49	44	52	45	41	47	42	38	42	38	35
6	66	54	45	39	63	51	44	38	47	40	35	42	37	33	38	34	31
7	61	49	40	35	58	47	39	34	42	36	31	39	33	29	35	31	27
8	57	44	36	31	54	42	35	30	39	33	28	35	30	26	32	28	24
9	53	41	33	28	50	39	32	27	36	30	25	33	27	24	30	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	28	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2201	2201	2201
5°	2204	2171	2185
10°	2187	2142	2156
15°	2154	2107	2110
20°	2111	2058	2063
25°	2068	2000	2009
30°	2014	1945	1940
35°	1962	1881	1867
40°	1899	1817	1797
45°	1836	1752	1726
50°	1767	1684	1643
55°	1695	1605	1568
60°	1613	1512	1481
65°	1525	1416	1378
70°	1411	1298	1269
75°	1255	1157	1168
80°	1066	977	974
85°	770	667	651

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1836 cd/sqm

TEST NUMBER: P919692

CATALOG NUMBER: DFN2DIP-PN4F0-090D040US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	2.6
10°-20°	798.5	7.4
20°-30°	1173.4	10.9
30°-40°	1362.9	12.7
40°-50°	1361.2	12.7
50°-60°	1186.9	11.1
60°-70°	877.4	8.2
70°-80°	496.4	4.6
80°-90°	134.1	1.3
90°-100°	67.4	0.6
100°-110°	214.2	2.0
110°-120°	366.5	3.4
120°-130°	482.0	4.5
130°-140°	541.0	5.0
140°-150°	530.5	4.9
150°-160°	445.0	4.2
160°-170°	295.1	2.8
170°-180°	103.2	1.0
0°-30°	2255.7	21.0
0°-40°	3618.6	33.8
0°-60°	6166.7	57.5
0°-90°	7674.6	71.6
90°-120°	648.0	6.0
90°-150°	2201.5	20.5
90°-180°	3045.0	28.4
0°-180°	10719.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	1	12	32	30	31	10
95°	48	57	59	59	57	53
105°	198	200	202	204	204	209
115°	368	373	371	370	368	364
125°	535	543	540	538	537	478
135°	692	702	704	703	700	535
145°	840	846	852	853	849	525
155°	960	963	966	971	968	442
165°	1045	1044	1044	1050	1046	295
175°	1087	1085	1083	1089	1084	103
180°	1089	1089	1089	1089	1089	

TEST NUMBER: P919692

CATALOG NUMBER: DFN2DIP-PN4F0-090D040US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.6	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.4
17.5°	2809.3	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.5	2357.2	2348.5	2336.9
32.5°	2331.1	2313.8	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.8	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	0.9	11.8	32.2	30.2	31.2
92.5°	20.3	27.6	28.6	29.5	29.5
95°	48.0	57.2	58.8	58.8	57.2
97.5°	79.8	88.3	92.0	92.0	92.0
100°	116.6	124.2	126.7	126.7	125.8
102.5°	155.3	160.9	164.5	165.5	164.5
105°	197.7	200.3	202.2	203.9	203.9
107.5°	239.7	243.7	243.7	244.3	239.7
110°	280.4	285.7	285.7	285.7	283.1



TEST NUMBER: P919692

CATALOG NUMBER: DFN2DIP-PN4F0-090D040US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	324.4	330.0	329.0	326.4	324.4
115°	367.7	373.1	371.3	370.4	367.7
117.5°	410.8	418.0	413.5	410.8	408.2
120°	454.2	461.3	454.2	454.2	451.2
122.5°	493.5	502.7	498.2	495.5	493.5
125°	534.9	543.1	540.5	537.5	536.6
127.5°	575.3	585.5	581.9	577.9	575.3
130°	613.0	624.9	623.3	621.3	617.7
132.5°	655.4	664.6	665.3	660.6	658.1
135°	691.9	702.1	704.0	703.0	700.4
137.5°	732.6	740.8	742.4	741.7	737.9
140°	768.4	776.6	781.2	781.2	777.6
142.5°	805.2	813.4	816.0	817.0	813.4
145°	840.0	846.5	851.8	852.8	849.2
147.5°	871.2	879.3	883.3	884.9	881.3
150°	903.4	909.0	912.6	915.5	912.6
152.5°	931.9	937.5	942.1	945.7	942.1
155°	960.4	963.1	966.0	970.7	967.7
157.5°	985.2	987.0	988.7	995.3	990.7
160°	1007.1	1009.1	1010.0	1015.6	1011.7
162.5°	1027.4	1027.4	1028.5	1034.7	1030.1
165°	1044.9	1043.9	1043.9	1050.4	1045.9
167.5°	1060.7	1057.6	1057.6	1064.3	1059.6
170°	1072.5	1069.8	1068.8	1075.4	1069.8
172.5°	1080.6	1078.1	1077.0	1083.7	1078.1
175°	1087.3	1084.6	1082.6	1089.2	1083.7
177.5°	1090.9	1088.2	1086.2	1091.8	1086.2
180°	1089.2	1089.2	1089.2	1089.2	1089.2

TEST NUMBER: P919692

CATALOG NUMBER: DFN2DIP-PN4F0-090D040US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.81	12.91	12.56	13.67	14.60	11.37	12.47	12.12	13.23	14.16
	3H	13.49	14.48	14.25	15.25	16.21	13.01	13.99	13.77	14.77	15.73
	4H	14.09	15.02	14.87	15.81	16.77	13.60	14.53	14.38	15.32	16.29
	6H	14.50	15.36	15.30	16.16	17.14	14.01	14.87	14.80	15.67	16.65
	8H	14.62	15.43	15.42	16.25	17.23	14.12	14.94	14.92	15.76	16.74
	12H	14.67	15.45	15.48	16.26	17.27	14.17	14.95	14.98	15.76	16.77
4H	2H	12.30	13.23	13.08	14.02	14.98	11.95	12.88	12.73	13.66	14.63
	3H	14.19	14.97	14.98	15.79	16.77	13.79	14.56	14.58	15.38	16.37
	4H	14.92	15.62	15.72	16.44	17.46	14.50	15.20	15.31	16.03	17.04
	6H	15.45	16.06	16.27	16.90	17.92	15.02	15.63	15.85	16.48	17.50
	8H	15.60	16.17	16.43	17.02	18.05	15.17	15.75	16.00	16.59	17.62
	12H	15.69	16.20	16.54	17.07	18.10	15.25	15.76	16.10	16.63	17.66
8H	4H	15.13	15.70	15.96	16.54	17.57	14.76	15.33	15.59	16.17	17.20
	6H	15.78	16.25	16.63	17.13	18.16	15.40	15.87	16.26	16.76	17.79
	8H	16.00	16.42	16.87	17.30	18.35	15.62	16.04	16.48	16.92	17.96
	12H	16.14	16.52	17.02	17.39	18.49	15.74	16.11	16.61	16.98	18.09
12H	4H	15.13	15.64	15.98	16.50	17.54	14.77	15.28	15.61	16.14	17.18
	6H	15.81	16.23	16.68	17.11	18.16	15.44	15.86	16.31	16.74	17.79
	8H	16.06	16.43	16.93	17.30	18.41	15.69	16.06	16.56	16.93	18.03