

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919713

Luminaire Tested: DFN2DIP-PN4F0-090D090US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919713
REPORT IS A COMBINATION OF REPORTS P901229 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-090D090US935-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15343.0 lumens
Efficiency: N/A
Efficacy: 99.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 155
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919713

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US935-FLLONL

Luminous Intensity Polar Plot

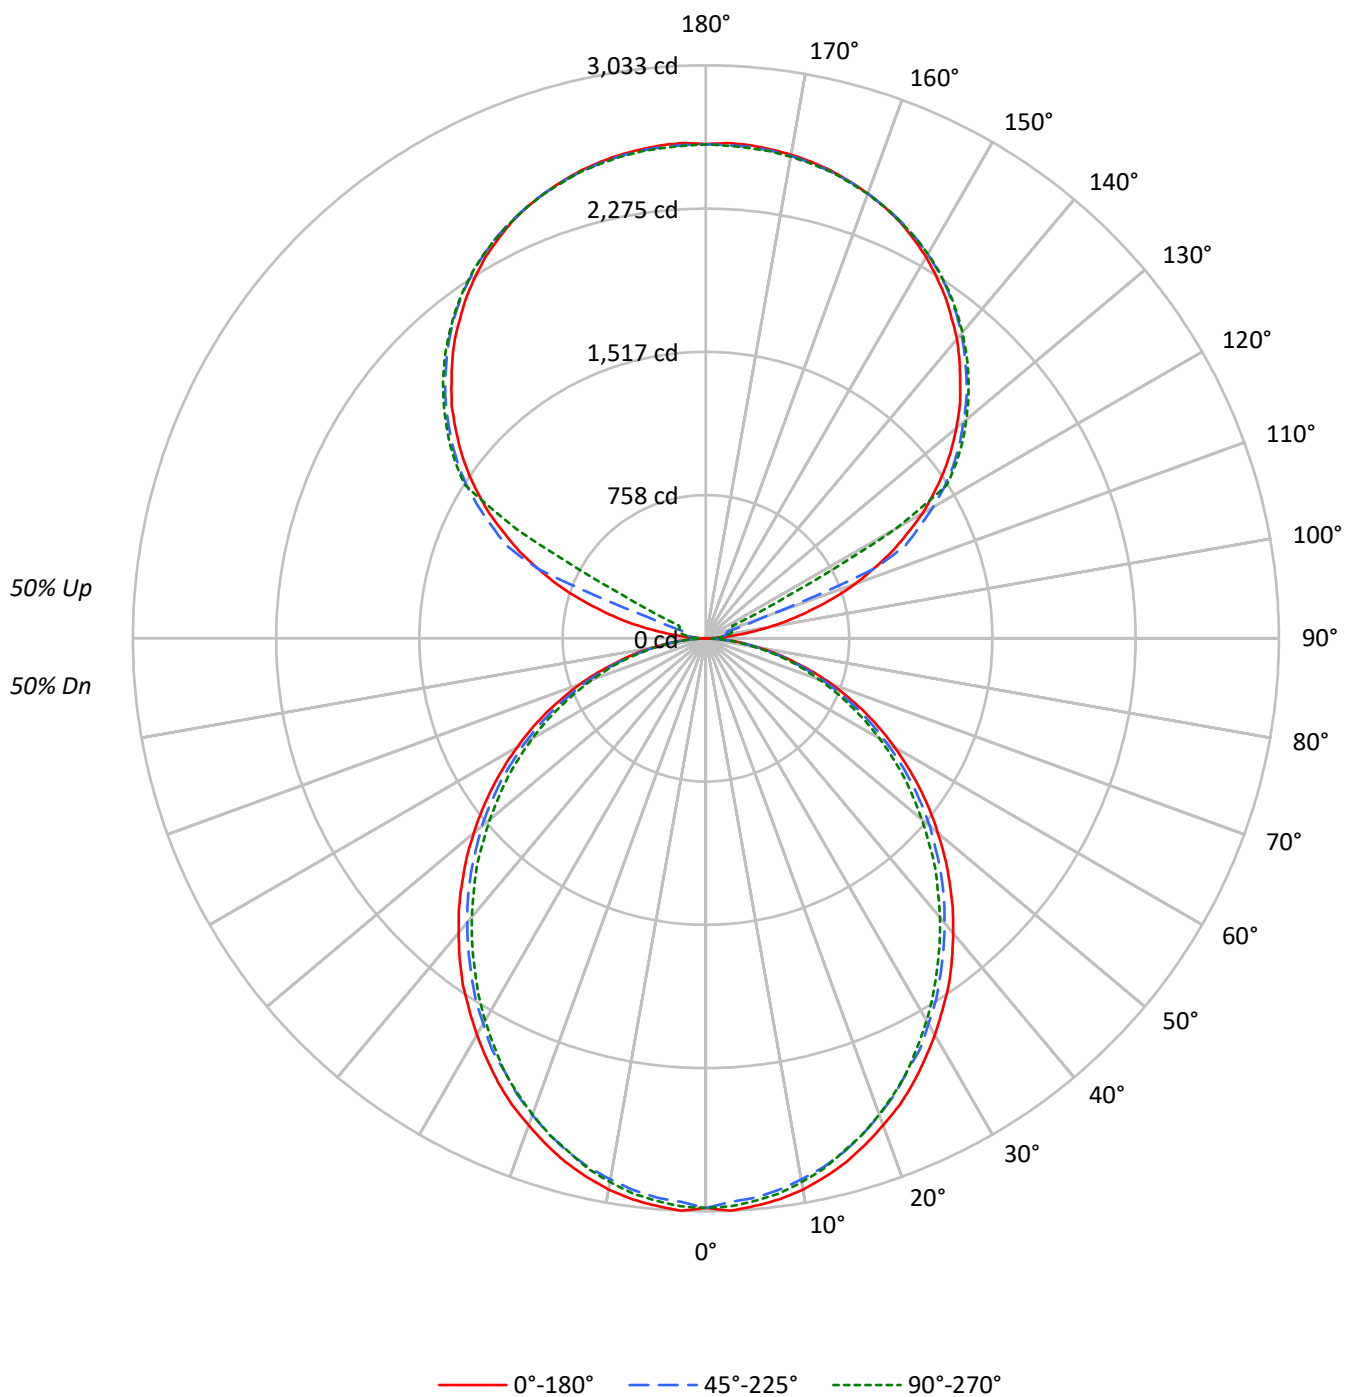

TEST NUMBER: P919713

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2201	2201	2201
5°	2204	2171	2185
10°	2187	2142	2156
15°	2154	2107	2110
20°	2111	2058	2063
25°	2068	2000	2009
30°	2014	1945	1940
35°	1962	1881	1867
40°	1899	1817	1797
45°	1836	1752	1726
50°	1767	1684	1643
55°	1695	1605	1568
60°	1613	1512	1481
65°	1525	1416	1378
70°	1411	1298	1269
75°	1255	1157	1168
80°	1066	977	974
85°	770	667	651

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1836 cd/sqm

TEST NUMBER: P919713

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	1.8
10°-20°	798.5	5.2
20°-30°	1173.4	7.6
30°-40°	1362.9	8.9
40°-50°	1361.2	8.9
50°-60°	1186.9	7.7
60°-70°	877.4	5.7
70°-80°	496.4	3.2
80°-90°	135.6	0.9
90°-100°	86.2	0.6
100°-110°	321.5	2.1
110°-120°	852.6	5.6
120°-130°	1414.1	9.2
130°-140°	1502.1	9.8
140°-150°	1396.0	9.1
150°-160°	1122.4	7.3
160°-170°	723.2	4.7
170°-180°	248.9	1.6
0°-30°	2255.7	14.7
0°-40°	3618.6	23.6
0°-60°	6166.7	40.2
0°-90°	7676.1	50.0
90°-120°	1260.3	8.2
90°-150°	5572.4	36.3
90°-180°	7667.0	50.0
0°-180°	15343.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	2	23	38	47	51	14
95°	123	60	74	83	81	146
105°	575	632	116	136	144	615
115°	1088	1120	1168	291	155	1071
125°	1538	1563	1599	1612	1618	1372
135°	1904	1934	1951	1970	1966	1471
145°	2208	2206	2239	2252	2242	1381
155°	2432	2415	2437	2449	2434	1121
165°	2562	2551	2557	2570	2557	724
175°	2621	2608	2611	2625	2606	249
180°	2615	2615	2615	2615	2615	

TEST NUMBER: P919713

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.6	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.4
17.5°	2809.3	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.5	2357.2	2348.5	2336.9
32.5°	2331.1	2313.8	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.8	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	1.8	22.7	37.7	47.4	51.0
92.5°	47.4	39.8	45.4	49.2	51.0
95°	123.0	60.4	73.7	83.3	81.4
97.5°	221.4	66.3	96.4	102.2	104.0
100°	335.0	75.8	107.9	123.0	126.7
102.5°	459.8	456.2	111.7	132.3	138.2
105°	575.2	632.1	115.5	136.2	143.8
107.5°	709.6	756.8	119.3	140.0	147.7
110°	838.4	878.0	331.2	142.0	149.5



TEST NUMBER: P919713

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	959.5	993.4	961.3	145.6	151.4
115°	1088.0	1120.2	1167.6	291.4	155.2
117.5°	1199.7	1237.5	1269.8	999.1	503.3
120°	1324.6	1353.0	1387.2	1409.8	1154.3
122.5°	1430.5	1460.9	1498.8	1510.0	1512.1
125°	1538.3	1563.1	1599.0	1612.3	1617.9
127.5°	1636.8	1663.3	1691.9	1710.7	1712.5
130°	1729.6	1760.0	1780.6	1801.5	1799.7
132.5°	1824.2	1848.9	1869.6	1886.7	1884.9
135°	1903.8	1934.1	1950.9	1970.0	1966.3
137.5°	1986.9	2009.6	2028.7	2047.5	2041.9
140°	2068.2	2083.5	2104.2	2121.2	2111.9
142.5°	2136.6	2149.8	2174.3	2189.3	2180.0
145°	2208.5	2206.4	2238.6	2251.9	2242.4
147.5°	2270.7	2265.1	2297.2	2306.7	2299.2
150°	2331.4	2318.2	2348.5	2359.7	2350.3
152.5°	2382.4	2367.3	2395.6	2407.1	2393.8
155°	2431.6	2414.8	2437.4	2448.7	2433.6
157.5°	2471.4	2456.3	2473.4	2486.6	2471.4
160°	2505.5	2494.1	2505.5	2516.8	2503.5
162.5°	2535.6	2524.4	2533.8	2547.1	2530.0
165°	2562.2	2550.9	2556.6	2569.8	2556.6
167.5°	2583.1	2571.6	2577.4	2590.7	2573.6
170°	2600.1	2588.7	2592.5	2605.7	2588.7
172.5°	2611.4	2600.1	2603.9	2617.2	2600.1
175°	2620.8	2607.5	2611.4	2624.6	2605.7
177.5°	2624.6	2611.4	2613.4	2626.6	2609.6
180°	2615.2	2615.2	2615.2	2615.2	2615.2

TEST NUMBER: P919713

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.02	10.88	10.98	11.86	13.13	9.58	10.44	10.54	11.42	12.69
	3H	11.69	12.46	12.65	13.44	14.73	11.20	11.97	12.17	12.96	14.25
	4H	12.28	13.01	13.26	13.99	15.29	11.79	12.52	12.77	13.51	14.81
	6H	12.68	13.35	13.67	14.34	15.66	12.19	12.86	13.18	13.85	15.16
	8H	12.78	13.43	13.78	14.43	15.74	12.29	12.93	13.29	13.94	15.25
	12H	12.83	13.44	13.84	14.44	15.78	12.33	12.94	13.34	13.94	15.28
4H	2H	10.48	11.22	11.47	12.20	13.50	10.13	10.86	11.12	11.85	13.15
	3H	12.35	12.96	13.35	13.98	15.29	11.95	12.56	12.95	13.58	14.89
	4H	13.07	13.63	14.08	14.64	15.97	12.65	13.21	13.66	14.22	15.56
	6H	13.59	14.07	14.60	15.10	16.44	13.16	13.64	14.18	14.68	16.01
	8H	13.74	14.19	14.76	15.21	16.56	13.31	13.76	14.33	14.78	16.13
	12H	13.81	14.22	14.85	15.26	16.62	13.37	13.78	14.41	14.82	16.18
8H	4H	13.27	13.72	14.29	14.74	16.09	12.90	13.35	13.91	14.37	15.72
	6H	13.90	14.27	14.94	15.34	16.69	13.53	13.90	14.57	14.96	16.31
	8H	14.12	14.45	15.17	15.50	16.87	13.74	14.07	14.79	15.12	16.49
	12H	14.26	14.55	15.31	15.59	17.00	13.86	14.14	14.91	15.19	16.60
12H	4H	13.25	13.66	14.29	14.70	16.05	12.89	13.30	13.93	14.34	15.69
	6H	13.93	14.26	14.98	15.31	16.68	13.57	13.89	14.62	14.95	16.31
	8H	14.18	14.46	15.23	15.51	16.92	13.80	14.09	14.86	15.14	16.55