

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919756

Luminaire Tested: DFN2DIP-PN4F0-100D110US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919756
REPORT IS A COMBINATION OF REPORTS P899747 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-100D110US935-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16905.7 lumens
Efficiency: N/A
Efficacy: 87.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 192.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919756

CATALOG NUMBER: DFN2DIP-PN4F0-100D110US935-FLLFLL

Luminous Intensity Polar Plot

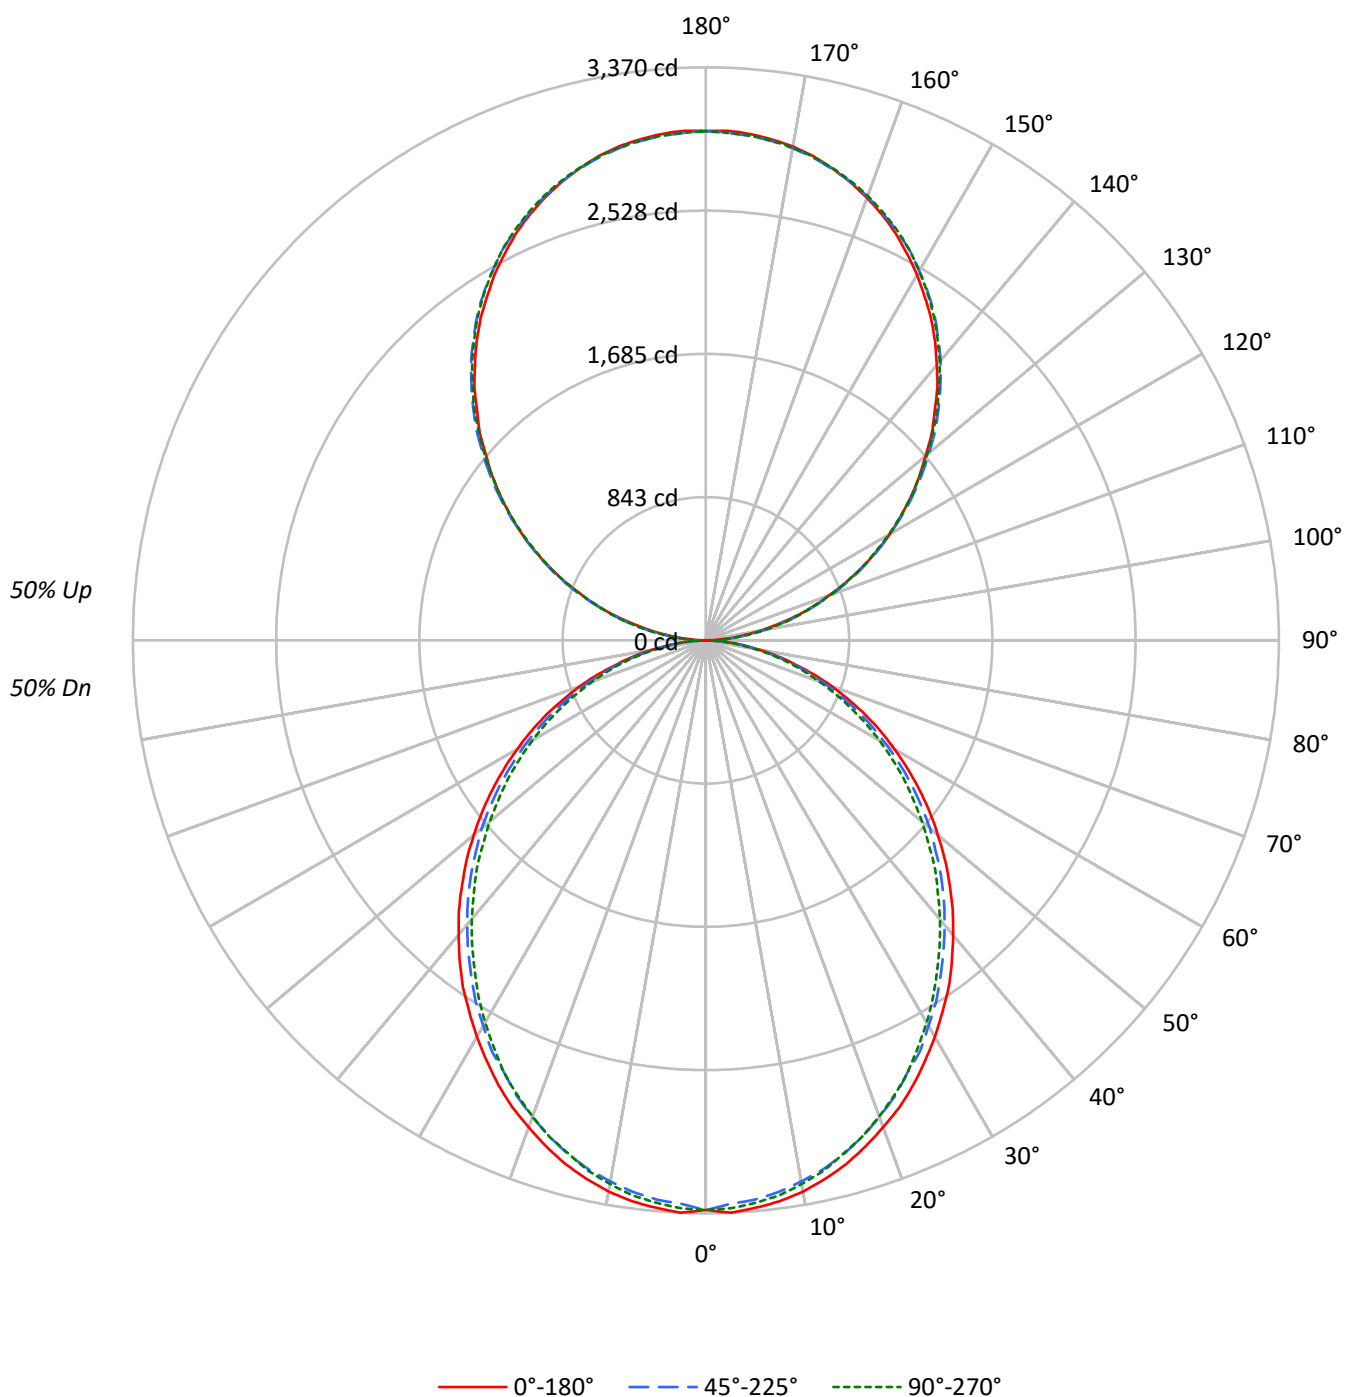

TEST NUMBER: P919756

CATALOG NUMBER: DFN2DIP-PN4F0-100D110US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	69	69	69	57	57	57
1	98	94	90	86	90	86	83	80	73	71	69	61	59	58	50	49	48
2	89	82	76	70	82	76	70	66	64	60	57	54	51	48	44	42	40
3	81	72	64	59	75	67	60	55	57	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	30
5	68	57	49	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	41	35	31	34	30	27	29	25	23
7	58	46	38	32	54	43	36	31	37	31	27	31	27	24	26	23	20
8	54	42	34	29	50	39	32	27	34	28	24	29	24	21	24	21	18
9	50	38	31	25	46	36	29	24	31	25	22	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2446	2446	2446
5°	2449	2412	2428
10°	2430	2380	2396
15°	2394	2341	2345
20°	2345	2287	2293
25°	2298	2222	2232
30°	2237	2162	2155
35°	2180	2091	2074
40°	2110	2019	1997
45°	2040	1947	1918
50°	1964	1871	1826
55°	1883	1784	1742
60°	1793	1680	1645
65°	1694	1573	1532
70°	1568	1442	1410
75°	1394	1286	1297
80°	1184	1086	1082
85°	856	741	724

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2346 cd/sqm

TEST NUMBER: P919756

CATALOG NUMBER: DFN2DIP-PN4F0-100D110US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	315.3	1.9
10°-20°	887.2	5.2
20°-30°	1303.8	7.7
30°-40°	1514.3	9.0
40°-50°	1512.4	8.9
50°-60°	1318.8	7.8
60°-70°	974.9	5.8
70°-80°	551.6	3.3
80°-90°	154.1	0.9
90°-100°	185.3	1.1
100°-110°	588.9	3.5
110°-120°	1007.8	6.0
120°-130°	1325.4	7.8
130°-140°	1487.7	8.8
140°-150°	1458.9	8.6
150°-160°	1223.8	7.2
160°-170°	811.6	4.8
170°-180°	283.7	1.7
0°-30°	2506.3	14.8
0°-40°	4020.6	23.8
0°-60°	6851.8	40.5
0°-90°	8532.4	50.5
90°-120°	1782.1	10.5
90°-150°	6054.2	35.8
90°-180°	8373.0	49.5
0°-180°	16905.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3350	3350	3350	3350	3350	
5°	3350	3338	3302	3328	3322	318
15°	3189	3170	3128	3141	3125	898
25°	2886	2861	2806	2812	2806	1328
35°	2490	2458	2406	2387	2371	1555
45°	2026	2004	1955	1920	1907	1564
55°	1534	1514	1476	1437	1421	1371
65°	1034	1015	983	954	938	1023
75°	541	535	518	499	506	578
85°	132	129	126	116	113	147
90°	3	32	88	83	86	16
95°	132	157	162	162	157	147
105°	544	551	556	561	561	574
115°	1011	1026	1021	1019	1011	1000
125°	1471	1494	1486	1478	1476	1315
135°	1903	1931	1936	1933	1926	1471
145°	2310	2328	2342	2345	2335	1443
155°	2641	2648	2657	2669	2661	1216
165°	2873	2871	2871	2889	2876	811
175°	2990	2983	2977	2995	2980	284
180°	2995	2995	2995	2995	2995	

TEST NUMBER: P919756

CATALOG NUMBER: DFN2DIP-PN4F0-100D110US935-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3350.2	3350.2	3350.2	3350.2	3350.2
2.5°	3369.7	3353.6	3318.0	3350.2	3344.0
5°	3350.2	3337.6	3302.0	3327.7	3321.5
7.5°	3327.7	3308.5	3272.9	3298.9	3292.5
10°	3292.5	3269.9	3231.2	3256.9	3247.3
12.5°	3243.9	3224.8	3186.1	3202.2	3195.7
15°	3189.2	3170.1	3128.0	3141.0	3125.0
17.5°	3121.5	3102.4	3060.3	3076.4	3060.3
20°	3047.3	3028.2	2983.1	2992.7	2980.0
22.5°	2973.5	2944.5	2902.4	2902.4	2896.0
25°	2886.4	2860.8	2806.1	2812.2	2806.1
27.5°	2789.6	2767.1	2725.4	2715.8	2699.7
30°	2693.3	2667.3	2619.1	2609.5	2596.5
32.5°	2590.1	2570.9	2519.3	2499.8	2486.8
35°	2490.3	2458.1	2406.5	2387.0	2370.9
37.5°	2377.5	2348.4	2296.8	2274.2	2258.1
40°	2261.6	2235.6	2184.0	2155.3	2142.3
42.5°	2148.8	2122.8	2071.6	2039.1	2020.0
45°	2026.4	2003.9	1955.3	1920.1	1907.2
47.5°	1907.2	1884.6	1833.0	1797.4	1778.3
50°	1781.4	1765.3	1720.2	1675.1	1659.1
52.5°	1659.1	1636.5	1594.7	1559.3	1536.7
55°	1533.6	1514.2	1475.5	1436.8	1420.8
57.5°	1407.8	1391.7	1349.7	1311.1	1298.1
60°	1282.0	1269.4	1224.3	1188.7	1179.1
62.5°	1159.7	1137.1	1105.0	1072.9	1059.9
65°	1034.2	1014.8	982.7	953.6	937.5
67.5°	905.4	889.0	860.3	837.8	824.7
70°	786.1	773.1	744.1	721.5	708.9
72.5°	663.7	650.7	634.7	612.2	602.5
75°	541.1	534.9	518.5	499.4	505.8
77.5°	431.7	418.7	412.2	402.6	393.0
80°	322.3	318.9	312.4	302.8	296.4
82.5°	219.1	219.1	216.0	203.0	203.0
85°	131.9	128.9	125.8	115.9	112.8
87.5°	58.1	51.6	45.1	35.6	32.1
90°	2.7	32.5	88.5	83.1	85.8
92.5°	56.0	75.9	78.5	81.3	81.3
95°	131.8	157.1	161.6	161.6	157.1
97.5°	219.5	242.9	252.9	252.9	252.9
100°	320.5	341.3	348.5	348.5	345.9
102.5°	427.1	442.5	452.5	455.1	452.5
105°	543.6	550.9	556.3	560.8	560.8
107.5°	659.2	670.0	670.0	671.8	659.2
110°	771.2	785.7	785.7	785.7	778.4



TEST NUMBER: P919756

CATALOG NUMBER: DFN2DIP-PN4F0-100D110US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	892.2	907.5	904.8	897.6	892.2
115°	1011.4	1025.8	1021.3	1018.6	1011.4
117.5°	1129.7	1149.5	1136.9	1129.7	1122.5
120°	1248.9	1268.8	1248.9	1248.9	1240.8
122.5°	1357.3	1382.5	1369.8	1362.6	1357.3
125°	1471.0	1493.6	1486.3	1478.2	1475.5
127.5°	1582.1	1610.1	1600.2	1589.3	1582.1
130°	1685.9	1718.5	1713.9	1708.5	1698.6
132.5°	1802.4	1827.7	1829.5	1816.9	1809.6
135°	1902.6	1930.6	1936.0	1933.4	1926.1
137.5°	2014.6	2037.2	2041.7	2039.9	2029.1
140°	2113.1	2135.6	2148.3	2148.3	2138.4
142.5°	2214.2	2236.8	2244.0	2246.7	2236.8
145°	2309.9	2328.0	2342.4	2345.1	2335.2
147.5°	2395.7	2418.3	2429.1	2433.6	2423.7
150°	2484.2	2499.6	2509.5	2517.6	2509.5
152.5°	2562.8	2578.1	2590.7	2600.7	2590.7
155°	2641.4	2648.5	2656.7	2669.4	2661.2
157.5°	2709.0	2714.5	2718.9	2737.0	2724.4
160°	2769.6	2775.0	2777.7	2793.1	2782.2
162.5°	2825.5	2825.5	2828.3	2845.4	2832.8
165°	2873.4	2870.7	2870.7	2888.7	2876.1
167.5°	2916.7	2908.6	2908.6	2926.7	2914.0
170°	2949.3	2942.0	2939.4	2957.4	2942.0
172.5°	2971.8	2964.6	2961.9	2980.0	2964.6
175°	2989.9	2982.7	2977.2	2995.3	2980.0
177.5°	2999.8	2992.6	2987.1	3002.6	2987.1
180°	2995.3	2995.3	2995.3	2995.3	2995.3

TEST NUMBER: P919756

CATALOG NUMBER: DFN2DIP-PN4F0-100D110US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.43	11.29	11.38	12.26	13.53	9.99	10.85	10.94	11.82	13.09
	3H	12.09	12.87	13.06	13.85	15.13	11.61	12.38	12.57	13.36	14.65
	4H	12.68	13.42	13.66	14.40	15.69	12.19	12.93	13.17	13.91	15.21
	6H	13.08	13.76	14.07	14.75	16.06	12.59	13.27	13.58	14.26	15.56
	8H	13.19	13.83	14.18	14.84	16.14	12.70	13.34	13.69	14.35	15.65
	12H	13.24	13.85	14.24	14.85	16.18	12.74	13.35	13.74	14.35	15.68
4H	2H	10.89	11.62	11.87	12.61	13.90	10.54	11.27	11.52	12.26	13.55
	3H	12.76	13.37	13.75	14.38	15.69	12.36	12.97	13.35	13.98	15.29
	4H	13.48	14.04	14.48	15.04	16.37	13.06	13.62	14.06	14.62	15.96
	6H	13.99	14.48	15.01	15.51	16.84	13.57	14.05	14.58	15.08	16.41
	8H	14.15	14.60	15.16	15.62	16.96	13.72	14.17	14.73	15.19	16.53
	12H	14.22	14.63	15.25	15.66	17.01	13.78	14.19	14.81	15.22	16.57
8H	4H	13.67	14.12	14.69	15.15	16.49	13.30	13.75	14.32	14.77	16.12
	6H	14.31	14.68	15.35	15.74	17.09	13.93	14.31	14.97	15.37	16.71
	8H	14.53	14.86	15.58	15.91	17.27	14.15	14.48	15.19	15.52	16.89
	12H	14.66	14.95	15.72	16.00	17.40	14.26	14.55	15.31	15.60	17.00
12H	4H	13.66	14.07	14.69	15.10	16.45	13.30	13.70	14.33	14.74	16.09
	6H	14.34	14.67	15.39	15.72	17.08	13.97	14.30	15.02	15.35	16.71
	8H	14.58	14.87	15.63	15.92	17.32	14.21	14.50	15.26	15.54	16.95

END OF REPORT