

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919762

Luminaire Tested: DFN2DIP-PN4F0-100D120US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919762
REPORT IS A COMBINATION OF REPORTS P899766 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-100D120US935-RLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16462.3 lumens
Efficiency: N/A
Efficacy: 80.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 204.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919762

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US935-RLLFLL

Luminous Intensity Polar Plot

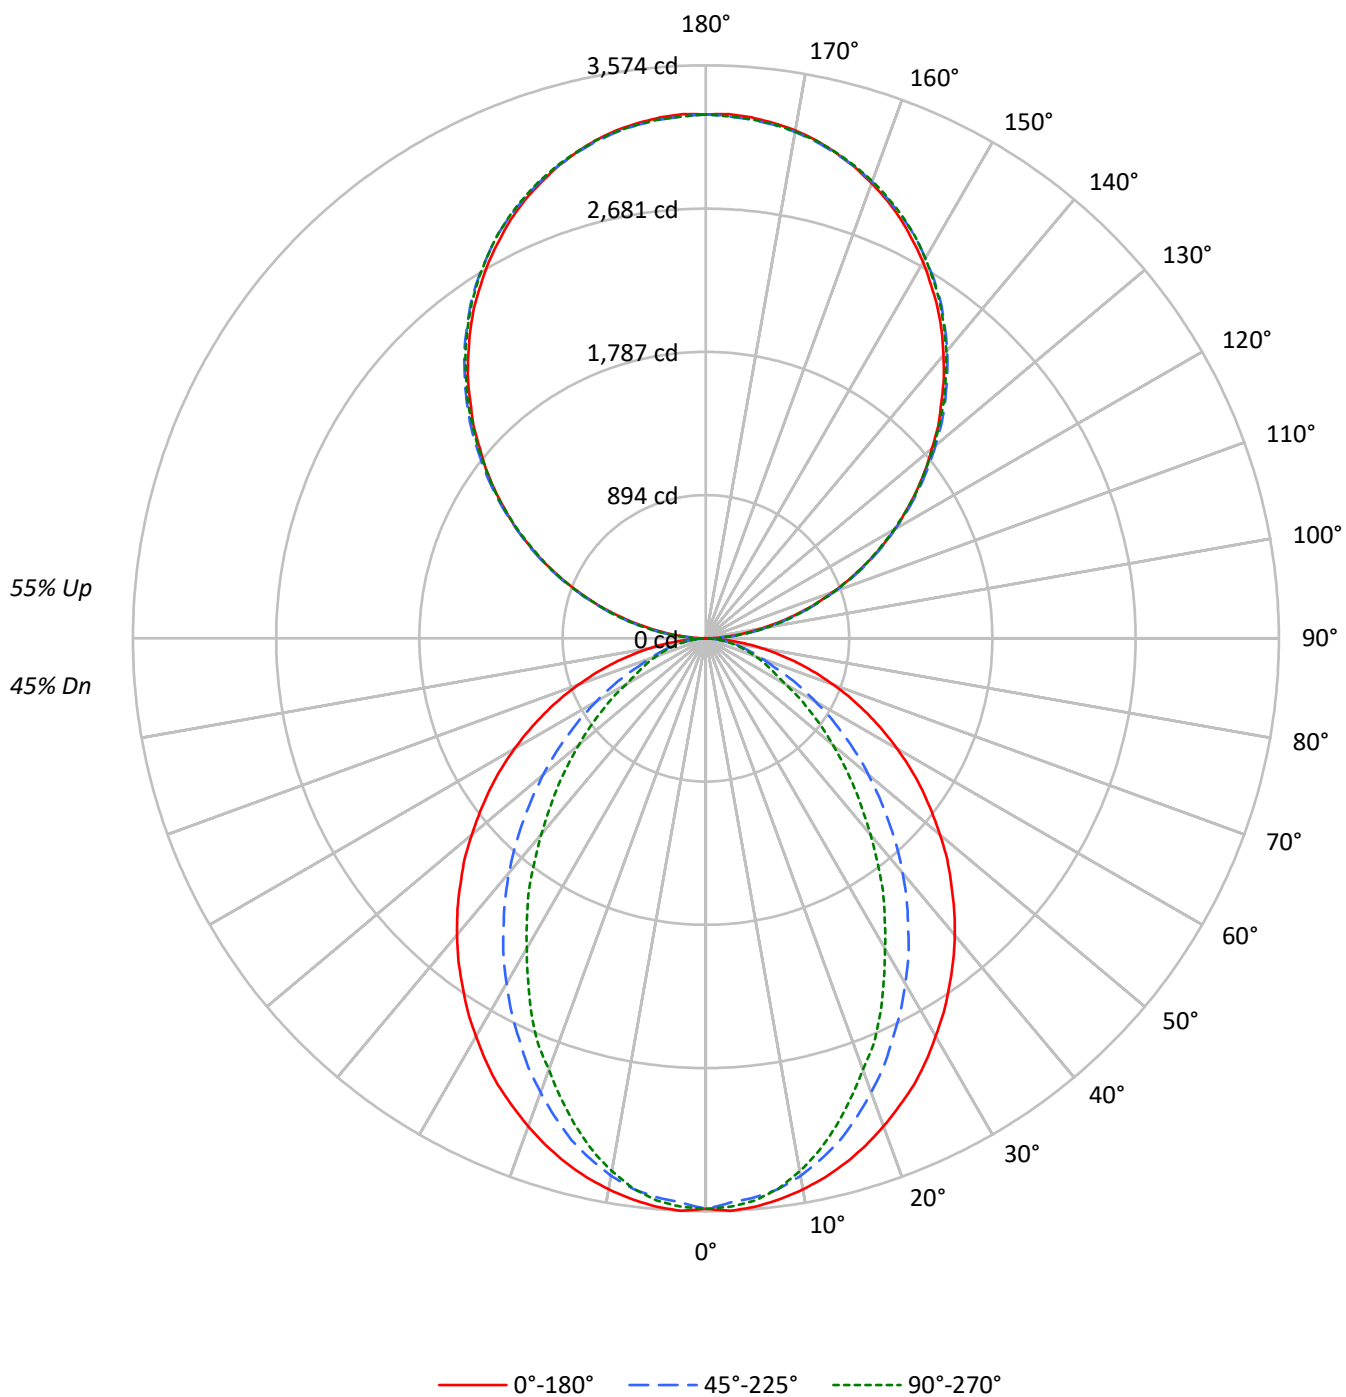

TEST NUMBER: P919762

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	93	89	86	89	85	82	79	71	69	67	58	56	55	46	45	44
2	89	82	76	71	81	75	70	66	63	59	56	51	49	47	41	39	38
3	81	72	65	59	74	66	60	55	56	51	47	46	43	40	37	34	33
4	74	64	56	51	68	59	52	47	50	45	41	41	37	35	33	30	28
5	68	57	49	44	63	53	46	41	45	39	35	37	33	30	30	27	25
6	63	51	44	38	58	48	41	36	40	35	31	34	30	27	27	24	22
7	58	47	39	33	54	43	36	31	37	31	28	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18
9	51	39	31	27	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	36	29	24	43	33	27	23	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2598	2598	2598
5°	2602	2557	2573
10°	2576	2507	2490
15°	2540	2424	2361
20°	2494	2310	2202
25°	2446	2183	2049
30°	2381	2052	1855
35°	2318	1911	1684
40°	2253	1765	1489
45°	2179	1603	1311
50°	2101	1440	1138
55°	2021	1265	971
60°	1927	1083	800
65°	1820	897	721
70°	1690	724	653
75°	1526	639	595
80°	1289	537	518
85°	898	360	392

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2559 cd/sqm

TEST NUMBER: P919762

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	333.5	2.0
10°-20°	915.5	5.6
20°-30°	1285.4	7.8
30°-40°	1401.2	8.5
40°-50°	1287.8	7.8
50°-60°	1011.4	6.1
60°-70°	658.3	4.0
70°-80°	338.9	2.1
80°-90°	95.8	0.6
90°-100°	202.2	1.2
100°-110°	642.4	3.9
110°-120°	1099.4	6.7
120°-130°	1445.9	8.8
130°-140°	1623.0	9.9
140°-150°	1591.6	9.7
150°-160°	1335.1	8.1
160°-170°	885.4	5.4
170°-180°	309.5	1.9
0°-30°	2534.4	15.4
0°-40°	3935.6	23.9
0°-60°	6234.8	37.9
0°-90°	7327.8	44.5
90°-120°	1944.1	11.8
90°-150°	6604.6	40.1
90°-180°	9134.0	55.5
0°-180°	16462.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3558	3558	3558	3558	3558	
5°	3558	3542	3500	3530	3520	337
15°	3385	3349	3240	3178	3146	954
25°	3072	2969	2757	2625	2576	1413
35°	2647	2483	2200	1997	1926	1657
45°	2164	1948	1610	1381	1304	1671
55°	1646	1394	1046	854	792	1470
65°	1111	850	560	451	441	1102
75°	592	367	258	235	232	627
85°	138	71	61	61	61	159
90°	3	36	96	91	94	16
95°	144	171	176	176	171	160
105°	593	601	607	612	612	626
115°	1103	1119	1114	1111	1103	1091
125°	1605	1629	1622	1613	1610	1434
135°	2076	2106	2112	2109	2101	1604
145°	2520	2540	2555	2558	2548	1574
155°	2881	2889	2898	2912	2903	1326
165°	3135	3132	3132	3151	3138	884
175°	3262	3254	3248	3268	3251	310
180°	3268	3268	3268	3268	3268	

TEST NUMBER: P919762

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3558.5	3558.5	3558.5	3558.5	3558.5
2.5°	3574.5	3558.5	3522.9	3555.4	3548.9
5°	3558.5	3542.4	3500.4	3529.5	3519.8
7.5°	3529.5	3510.3	3465.2	3477.8	3461.8
10°	3490.8	3468.3	3404.0	3394.1	3375.0
12.5°	3442.7	3413.6	3326.5	3307.4	3271.8
15°	3384.6	3349.0	3239.7	3178.5	3146.4
17.5°	3316.9	3265.3	3130.1	3059.3	3007.7
20°	3239.7	3175.1	3014.2	2933.9	2862.8
22.5°	3156.0	3081.9	2894.9	2785.7	2737.5
25°	3072.3	2969.2	2756.6	2624.7	2576.2
27.5°	2972.5	2862.8	2627.8	2476.4	2402.3
30°	2866.3	2743.6	2486.0	2322.0	2234.9
32.5°	2763.1	2614.8	2351.0	2157.7	2077.0
35°	2647.2	2482.9	2199.7	1996.7	1925.6
37.5°	2534.5	2357.2	2057.9	1835.5	1755.1
40°	2415.3	2222.2	1909.6	1681.0	1597.3
42.5°	2292.9	2086.9	1761.7	1523.2	1442.9
45°	2164.1	1948.2	1610.3	1381.4	1304.2
47.5°	2041.9	1813.3	1465.4	1236.5	1165.8
50°	1906.5	1677.9	1323.6	1101.2	1033.9
52.5°	1774.3	1532.7	1188.3	975.8	914.6
55°	1645.5	1394.4	1046.5	853.5	792.3
57.5°	1513.6	1255.9	921.2	740.7	689.1
60°	1378.3	1120.7	788.9	624.9	573.3
62.5°	1246.4	988.8	676.1	521.8	496.1
65°	1111.1	850.1	560.3	451.0	441.1
67.5°	982.3	721.3	451.0	396.0	386.4
70°	847.0	595.9	373.4	341.3	328.4
72.5°	718.2	479.7	312.3	286.6	280.2
75°	592.5	367.0	257.6	235.1	232.0
77.5°	467.1	260.7	202.9	189.9	183.5
80°	350.9	186.9	154.5	141.8	141.8
82.5°	244.6	125.7	106.2	99.8	99.8
85°	138.4	70.7	61.1	61.1	61.1
87.5°	51.6	25.7	25.7	22.6	22.6
90°	2.9	35.5	96.5	90.7	93.6
92.5°	61.0	82.7	85.7	88.7	88.7
95°	143.8	171.4	176.3	176.3	171.4
97.5°	239.4	265.0	275.9	275.9	275.9
100°	349.7	372.4	380.2	380.2	377.3
102.5°	466.0	482.7	493.5	496.5	493.5
105°	593.1	600.9	606.8	611.7	611.7
107.5°	719.1	731.0	731.0	732.9	719.1
110°	841.3	857.0	857.0	857.0	849.2

TEST NUMBER: P919762

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	973.3	990.1	987.0	979.2	973.3
115°	1103.3	1119.1	1114.1	1111.2	1103.3
117.5°	1232.3	1254.0	1240.3	1232.3	1224.5
120°	1362.4	1384.1	1362.4	1362.4	1353.6
122.5°	1480.7	1508.2	1494.4	1486.5	1480.7
125°	1604.7	1629.4	1621.5	1612.6	1609.6
127.5°	1726.0	1756.4	1745.6	1733.8	1726.0
130°	1839.2	1874.7	1869.7	1863.8	1853.0
132.5°	1966.3	1993.9	1995.8	1982.0	1974.2
135°	2075.6	2106.2	2112.1	2109.1	2101.3
137.5°	2197.8	2222.4	2227.3	2225.3	2213.5
140°	2305.1	2329.8	2343.6	2343.6	2332.7
142.5°	2415.5	2440.2	2448.0	2450.9	2440.2
145°	2519.9	2539.6	2555.4	2558.4	2547.5
147.5°	2613.5	2638.1	2650.0	2654.9	2644.0
150°	2710.1	2726.8	2737.6	2746.5	2737.6
152.5°	2795.7	2812.4	2826.3	2837.2	2826.3
155°	2881.4	2889.3	2898.2	2912.0	2903.1
157.5°	2955.4	2961.2	2966.1	2985.9	2972.1
160°	3021.3	3027.3	3030.2	3047.0	3035.1
162.5°	3082.4	3082.4	3085.4	3104.1	3090.3
165°	3134.6	3131.7	3131.7	3151.3	3137.6
167.5°	3181.9	3173.0	3173.0	3192.8	3179.0
170°	3217.4	3209.5	3206.5	3226.2	3209.5
172.5°	3242.0	3234.1	3231.2	3250.9	3234.1
175°	3261.7	3253.8	3247.9	3267.6	3250.9
177.5°	3272.6	3264.6	3258.7	3275.5	3258.7
180°	3267.6	3267.6	3267.6	3267.6	3267.6

TEST NUMBER: P919762

CATALOG NUMBER: DFN2DIP-PN4F0-100D120US935-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.93	10.72	10.94	11.74	13.09	5.90	6.69	6.91	7.70	9.05
	3H	11.61	12.31	12.63	13.34	14.71	7.08	7.79	8.10	8.81	10.18
	4H	12.22	12.89	13.25	13.91	15.29	7.53	8.20	8.57	9.23	10.60
	6H	12.64	13.25	13.68	14.29	15.68	7.85	8.47	8.90	9.50	10.89
	8H	12.77	13.35	13.81	14.40	15.78	7.94	8.53	8.99	9.57	10.96
	12H	12.83	13.38	13.88	14.42	15.83	7.99	8.54	9.04	9.58	10.99
4H	2H	9.95	10.61	10.98	11.64	13.02	6.49	7.16	7.53	8.18	9.56
	3H	11.77	12.33	12.82	13.38	14.77	7.84	8.39	8.88	9.45	10.84
	4H	12.47	12.97	13.52	14.02	15.43	8.38	8.89	9.44	9.94	11.35
	6H	12.98	13.42	14.05	14.49	15.90	8.80	9.24	9.86	10.31	11.72
	8H	13.16	13.57	14.22	14.63	16.05	8.93	9.34	9.99	10.40	11.82
	12H	13.25	13.62	14.33	14.70	16.13	8.99	9.36	10.07	10.44	11.87
8H	4H	12.43	12.84	13.50	13.90	15.32	8.66	9.07	9.73	10.13	11.56
	6H	13.00	13.34	14.09	14.44	15.86	9.18	9.52	10.27	10.62	12.04
	8H	13.22	13.51	14.31	14.60	16.04	9.37	9.67	10.47	10.75	12.20
	12H	13.36	13.62	14.45	14.70	16.18	9.49	9.75	10.59	10.83	12.31
12H	4H	12.38	12.75	13.46	13.83	15.25	8.67	9.03	9.75	10.11	11.54
	6H	12.98	13.27	14.07	14.36	15.80	9.23	9.53	10.32	10.61	12.05
	8H	13.20	13.46	14.29	14.54	16.02	9.44	9.70	10.54	10.78	12.26

END OF REPORT