

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919805

Luminaire Tested: DFN2DIP-PN4F0-120D050US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919805
REPORT IS A COMBINATION OF REPORTS P901163 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-120D050US935-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14490.6 lumens
Efficiency: N/A
Efficacy: 88.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 163.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919805

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US935-FLLONL

Luminous Intensity Polar Plot

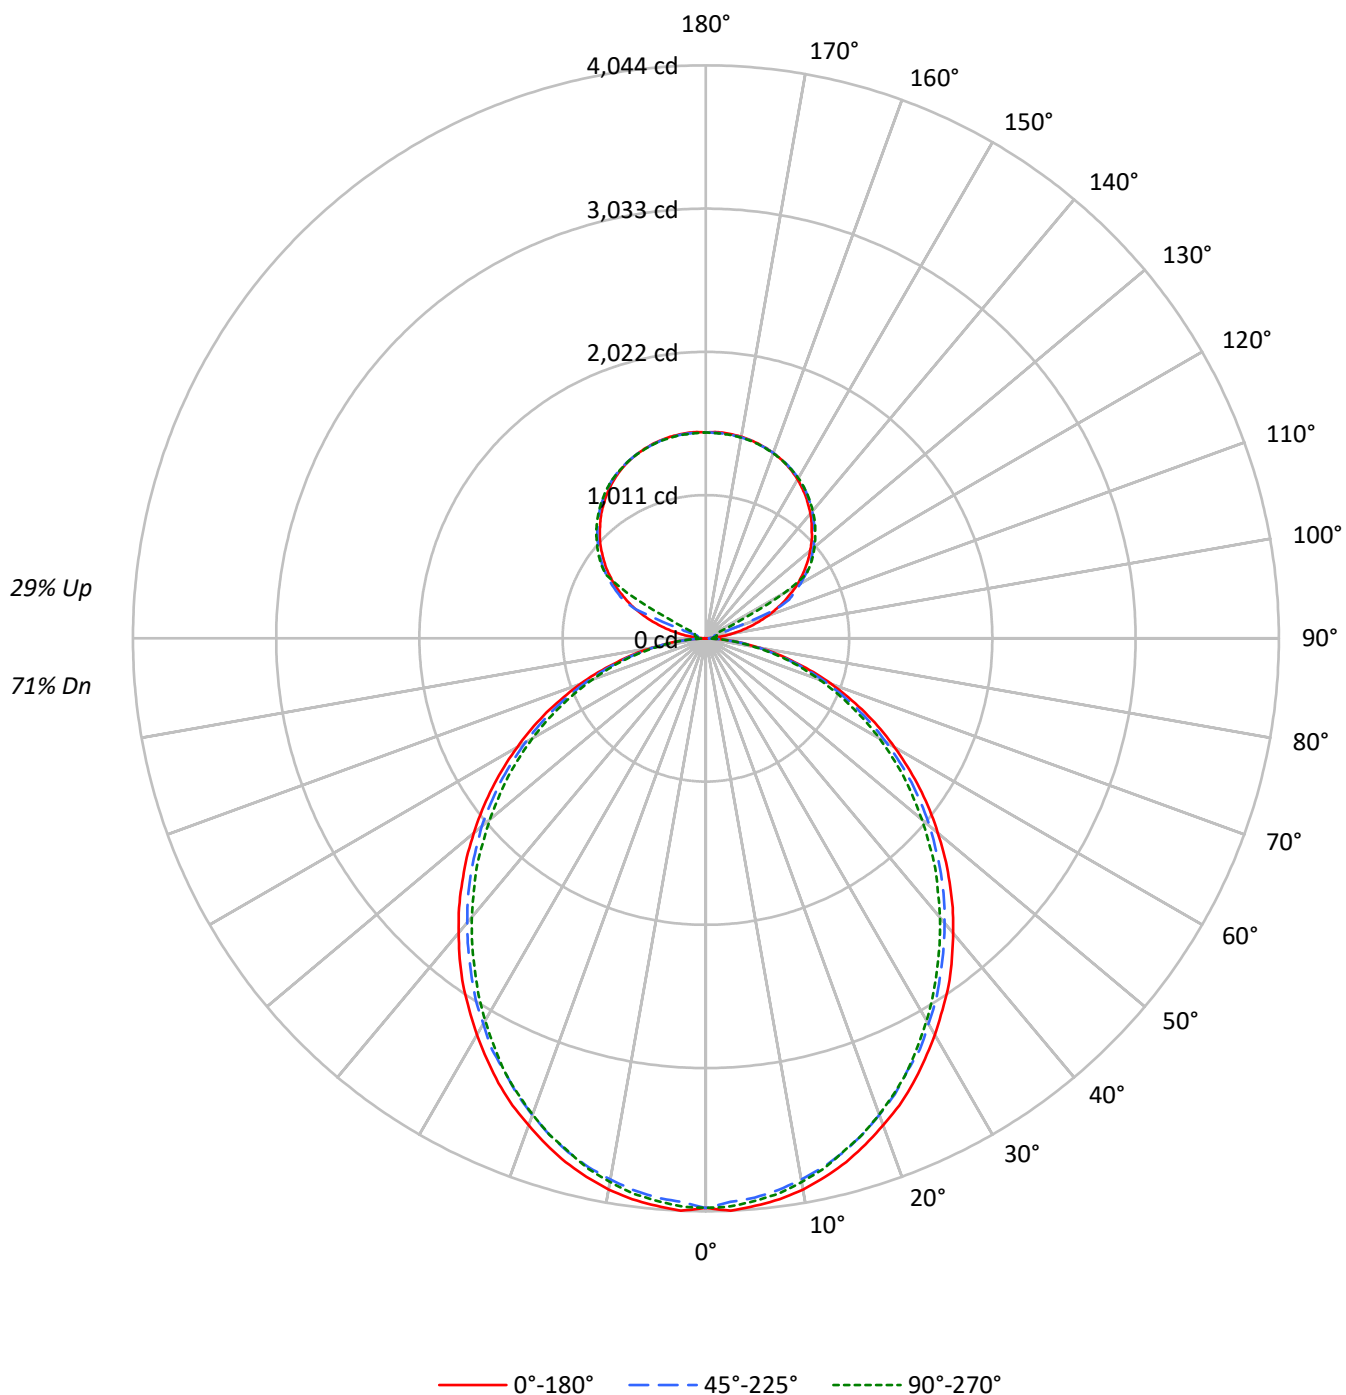

TEST NUMBER: P919805

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95	84	84	84	75	75	75
1	102	98	94	90	97	93	89	86	83	81	78	74	72	71	66	65	63
2	93	86	79	74	88	81	76	71	73	69	65	65	62	59	58	56	53
3	85	75	68	62	80	72	65	59	64	59	54	58	54	50	52	48	46
4	78	67	59	52	73	64	56	50	57	51	47	52	47	43	46	42	39
5	72	60	51	45	68	57	49	43	51	45	40	46	41	37	42	38	34
6	66	54	45	39	62	51	43	38	46	40	35	42	37	33	38	34	30
7	61	49	40	35	58	46	39	33	42	36	31	38	33	29	35	30	27
8	57	44	36	31	54	42	35	30	39	32	28	35	30	26	32	27	24
9	53	40	33	28	50	39	32	27	35	29	25	32	27	23	29	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2935	2935	2935
5°	2939	2894	2914
10°	2915	2856	2875
15°	2873	2809	2814
20°	2815	2744	2751
25°	2757	2666	2679
30°	2685	2594	2586
35°	2616	2509	2489
40°	2532	2422	2396
45°	2448	2336	2301
50°	2356	2246	2191
55°	2260	2141	2090
60°	2151	2016	1974
65°	2033	1887	1838
70°	1882	1731	1692
75°	1673	1543	1557
80°	1421	1304	1298
85°	1028	889	868

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2448 cd/sqm

TEST NUMBER: P919805

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	378.4	2.6
10°-20°	1064.6	7.3
20°-30°	1564.6	10.8
30°-40°	1817.2	12.5
40°-50°	1814.9	12.5
50°-60°	1582.5	10.9
60°-70°	1169.9	8.1
70°-80°	661.9	4.6
80°-90°	177.3	1.2
90°-100°	47.9	0.3
100°-110°	178.6	1.2
110°-120°	473.7	3.3
120°-130°	785.6	5.4
130°-140°	834.5	5.8
140°-150°	775.6	5.4
150°-160°	623.5	4.3
160°-170°	401.8	2.8
170°-180°	138.3	1.0
0°-30°	3007.6	20.8
0°-40°	4824.8	33.3
0°-60°	8222.2	56.7
0°-90°	10231.2	70.6
90°-120°	700.2	4.8
90°-150°	3095.8	21.4
90°-180°	4259.0	29.4
0°-180°	14490.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4020	4020	4020	4020	4020	
5°	4020	4005	3962	3993	3986	382
15°	3827	3804	3754	3769	3750	1078
25°	3464	3433	3367	3375	3367	1594
35°	2988	2950	2888	2864	2845	1866
45°	2432	2405	2346	2304	2289	1877
55°	1840	1817	1771	1724	1705	1645
65°	1241	1218	1179	1144	1125	1227
75°	649	642	622	599	607	693
85°	158	155	151	139	135	177
90°	1	13	21	26	28	13
95°	68	34	41	46	45	81
105°	320	351	64	76	80	342
115°	604	622	649	162	86	595
125°	855	868	888	896	899	762
135°	1058	1074	1084	1094	1092	817
145°	1227	1226	1244	1251	1246	767
155°	1351	1342	1354	1360	1352	622
165°	1423	1417	1420	1428	1420	402
175°	1456	1449	1451	1458	1448	139
180°	1453	1453	1453	1453	1453	

TEST NUMBER: P919805

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4020.3	4020.3	4020.3	4020.3	4020.3
2.5°	4043.6	4024.3	3981.7	4020.3	4012.9
5°	4020.3	4005.0	3962.4	3993.1	3985.7
7.5°	3993.1	3970.1	3927.5	3958.7	3950.9
10°	3950.9	3923.8	3877.5	3908.2	3896.8
12.5°	3892.7	3869.7	3823.3	3842.6	3834.8
15°	3827.0	3804.1	3753.6	3769.2	3749.9
17.5°	3745.9	3722.9	3672.4	3691.7	3672.4
20°	3656.8	3633.8	3579.8	3591.2	3576.1
22.5°	3568.2	3533.4	3482.9	3482.9	3475.2
25°	3463.6	3432.9	3367.3	3374.7	3367.3
27.5°	3347.6	3320.5	3270.5	3259.0	3239.8
30°	3231.9	3200.8	3142.9	3131.4	3115.9
32.5°	3108.0	3085.1	3023.1	2999.8	2984.2
35°	2988.3	2949.8	2887.8	2864.5	2845.2
37.5°	2852.9	2818.1	2756.1	2729.1	2709.8
40°	2714.0	2682.8	2620.8	2586.4	2570.8
42.5°	2578.6	2547.4	2485.9	2447.0	2424.0
45°	2431.7	2404.7	2346.4	2304.2	2288.6
47.5°	2288.6	2261.5	2199.6	2157.0	2134.0
50°	2137.7	2118.4	2064.2	2010.1	1990.8
52.5°	1990.8	1963.8	1913.7	1871.0	1844.0
55°	1840.3	1817.0	1770.6	1724.2	1704.9
57.5°	1689.4	1670.1	1619.6	1573.3	1557.7
60°	1538.4	1523.3	1469.1	1426.5	1415.0
62.5°	1391.6	1364.5	1326.0	1287.5	1271.9
65°	1241.1	1217.7	1179.1	1144.3	1125.1
67.5°	1086.5	1066.8	1032.3	1005.3	989.7
70°	943.3	927.7	892.9	865.8	850.7
72.5°	796.5	780.9	761.6	734.6	723.1
75°	649.3	641.9	622.2	599.3	607.0
77.5°	518.0	502.4	494.6	483.1	471.7
80°	386.8	382.6	374.9	363.4	355.6
82.5°	262.9	262.9	259.2	243.7	243.7
85°	158.3	154.6	150.9	139.1	135.3
87.5°	69.7	61.9	54.2	42.6	38.6
90°	1.0	12.6	21.0	26.3	28.3
92.5°	26.3	22.1	25.2	27.4	28.3
95°	68.3	33.6	41.0	46.3	45.2
97.5°	123.0	36.9	53.6	56.8	57.8
100°	186.1	42.1	59.9	68.3	70.4
102.5°	255.5	253.4	62.1	73.5	76.8
105°	319.6	351.2	64.1	75.7	79.9
107.5°	394.3	420.4	66.3	77.7	82.1
110°	465.8	487.8	184.0	78.9	83.0



TEST NUMBER: P919805

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	533.0	551.9	534.1	80.9	84.1
115°	604.5	622.3	648.7	162.0	86.3
117.5°	666.5	687.5	705.5	555.0	279.7
120°	735.9	751.7	770.6	783.2	641.3
122.5°	794.7	811.6	832.7	839.0	840.1
125°	854.6	868.4	888.4	895.7	898.9
127.5°	909.3	924.0	940.0	950.4	951.4
130°	960.9	977.7	989.2	1000.8	999.9
132.5°	1013.5	1027.2	1038.6	1048.2	1047.1
135°	1057.6	1074.5	1083.8	1094.5	1092.3
137.5°	1103.8	1116.5	1127.0	1137.6	1134.5
140°	1149.0	1157.5	1169.0	1178.4	1173.3
142.5°	1187.0	1194.4	1208.0	1216.3	1211.1
145°	1226.9	1225.8	1243.6	1251.0	1245.8
147.5°	1261.5	1258.3	1276.3	1281.5	1277.4
150°	1295.2	1287.9	1304.7	1311.0	1305.7
152.5°	1323.5	1315.2	1330.9	1337.3	1329.9
155°	1350.9	1341.5	1354.1	1360.4	1352.0
157.5°	1372.9	1364.6	1374.1	1381.5	1372.9
160°	1392.0	1385.6	1392.0	1398.2	1390.9
162.5°	1408.7	1402.5	1407.6	1415.0	1405.6
165°	1423.4	1417.2	1420.3	1427.6	1420.3
167.5°	1435.0	1428.7	1431.9	1439.2	1429.8
170°	1444.5	1438.1	1440.3	1447.6	1438.1
172.5°	1450.8	1444.5	1446.6	1454.0	1444.5
175°	1456.0	1448.6	1450.8	1458.1	1447.6
177.5°	1458.1	1450.8	1451.9	1459.2	1449.7
180°	1452.8	1452.8	1452.8	1452.8	1452.8

TEST NUMBER: P919805

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US935-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.73	13.82	13.49	14.60	15.54	12.29	13.38	13.05	14.16	15.10
	3H	14.41	15.39	15.19	16.18	17.15	13.93	14.90	14.70	15.69	16.67
	4H	15.01	15.93	15.80	16.73	17.72	14.53	15.45	15.32	16.24	17.23
	6H	15.43	16.28	16.23	17.08	18.08	14.94	15.78	15.74	16.59	17.59
	8H	15.54	16.35	16.35	17.17	18.17	15.05	15.85	15.86	16.68	17.68
	12H	15.60	16.37	16.41	17.19	18.21	15.10	15.87	15.91	16.69	17.71
4H	2H	13.22	14.14	14.02	14.94	15.92	12.87	13.79	13.66	14.59	15.57
	3H	15.11	15.88	15.92	16.71	17.71	14.71	15.48	15.51	16.31	17.31
	4H	15.84	16.54	16.66	17.37	18.40	15.42	16.12	16.24	16.95	17.98
	6H	16.37	16.97	17.20	17.83	18.86	15.94	16.55	16.78	17.40	18.44
	8H	16.52	17.09	17.36	17.94	18.99	16.10	16.66	16.93	17.51	18.56
	12H	16.61	17.12	17.47	17.99	19.04	16.17	16.68	17.03	17.55	18.60
8H	4H	16.05	16.62	16.89	17.47	18.51	15.68	16.25	16.52	17.10	18.14
	6H	16.70	17.16	17.56	18.06	19.10	16.32	16.79	17.19	17.68	18.73
	8H	16.92	17.34	17.80	18.22	19.29	16.54	16.95	17.41	17.84	18.90
	12H	17.06	17.43	17.95	18.31	19.43	16.66	17.03	17.54	17.91	19.03
12H	4H	16.05	16.56	16.91	17.43	18.48	15.69	16.19	16.54	17.07	18.12
	6H	16.73	17.14	17.61	18.03	19.10	16.36	16.78	17.24	17.67	18.73
	8H	16.98	17.35	17.86	18.23	19.35	16.61	16.98	17.49	17.86	18.97

END OF REPORT