

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922241

Luminaire Tested: DFN2DIP-PN4F0-040D040US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922241
REPORT IS A COMBINATION OF REPORTS P901129 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-040D040US940-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7062.4 lumens
Efficiency: N/A
Efficacy: 110.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 63.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922241

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US940-FLLONL

Luminous Intensity Polar Plot

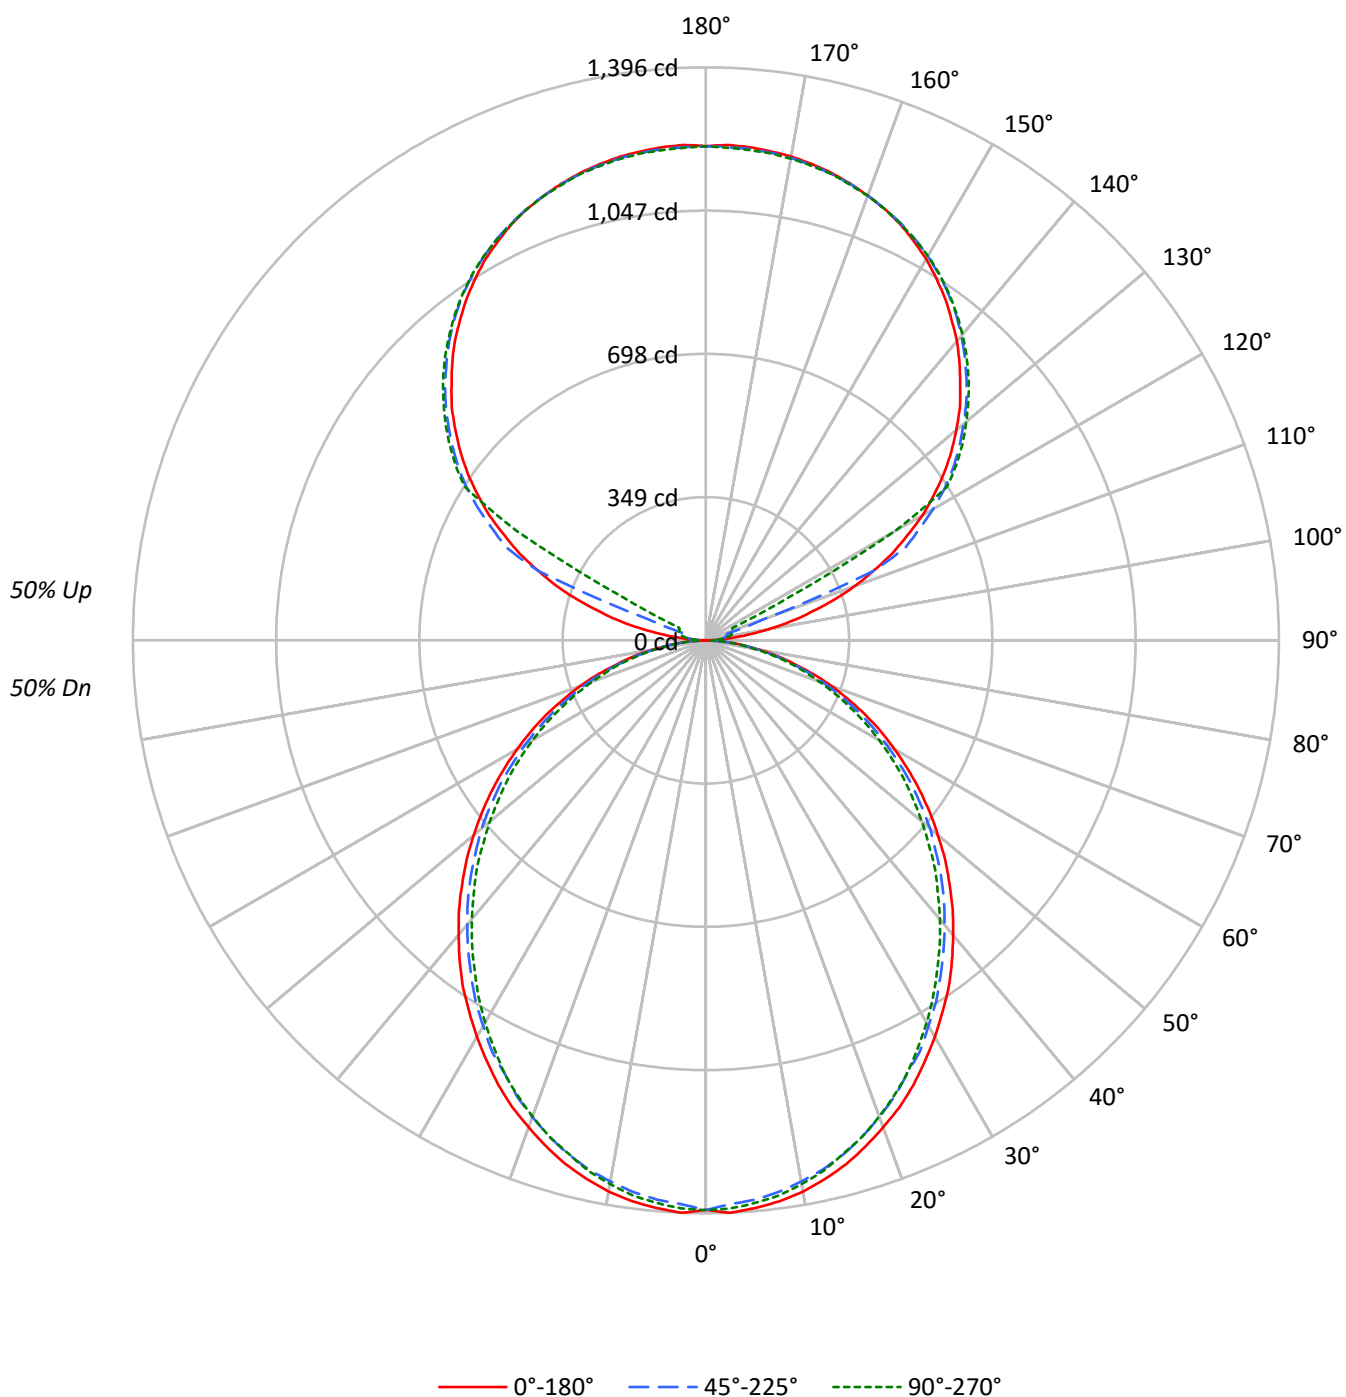

TEST NUMBER: P922241

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1013	1013	1013
5°	1015	999	1006
10°	1007	986	992
15°	992	970	971
20°	972	947	950
25°	952	920	925
30°	927	895	893
35°	903	866	859
40°	874	836	827
45°	845	806	794
50°	813	775	756
55°	780	739	722
60°	743	696	682
65°	702	652	635
70°	650	598	584
75°	578	533	538
80°	491	450	448
85°	355	307	300

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 845 cd/sqm

TEST NUMBER: P922241

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	130.6	1.8
10°-20°	367.5	5.2
20°-30°	540.1	7.6
30°-40°	627.3	8.9
40°-50°	626.6	8.9
50°-60°	546.3	7.7
60°-70°	403.9	5.7
70°-80°	228.5	3.2
80°-90°	62.4	0.9
90°-100°	39.7	0.6
100°-110°	148.0	2.1
110°-120°	392.4	5.6
120°-130°	650.9	9.2
130°-140°	691.4	9.8
140°-150°	642.6	9.1
150°-160°	516.6	7.3
160°-170°	332.9	4.7
170°-180°	114.6	1.6
0°-30°	1038.3	14.7
0°-40°	1665.6	23.6
0°-60°	2838.5	40.2
0°-90°	3533.3	50.0
90°-120°	580.1	8.2
90°-150°	2565.0	36.3
90°-180°	3529.0	50.0
0°-180°	7062.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1388	1388	1388	1388	1388	
5°	1388	1383	1368	1378	1376	132
15°	1321	1313	1296	1301	1295	372
25°	1196	1185	1162	1165	1162	550
35°	1032	1018	997	989	982	644
45°	840	830	810	796	790	648
55°	635	627	611	595	589	568
65°	428	420	407	395	388	424
75°	224	222	215	207	210	239
85°	55	53	52	48	47	61
90°	1	10	17	22	24	7
95°	56	28	34	38	38	67
105°	265	291	53	63	66	283
115°	501	516	537	134	72	493
125°	708	720	736	742	745	632
135°	876	890	898	907	905	677
145°	1016	1016	1030	1036	1032	636
155°	1119	1112	1122	1127	1120	516
165°	1179	1174	1177	1183	1177	333
175°	1206	1200	1202	1208	1199	115
180°	1204	1204	1204	1204	1204	

TEST NUMBER: P922241

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1387.9	1387.9	1387.9	1387.9	1387.9
2.5°	1396.0	1389.3	1374.6	1387.9	1385.4
5°	1387.9	1382.6	1367.9	1378.5	1376.0
7.5°	1378.5	1370.6	1355.8	1366.6	1364.0
10°	1364.0	1354.6	1338.6	1349.2	1345.2
12.5°	1343.8	1335.9	1319.9	1326.6	1323.8
15°	1321.2	1313.2	1295.8	1301.2	1294.6
17.5°	1293.2	1285.2	1267.8	1274.4	1267.8
20°	1262.4	1254.5	1235.8	1239.7	1234.6
22.5°	1231.8	1219.8	1202.4	1202.4	1199.7
25°	1195.7	1185.1	1162.4	1165.0	1162.4
27.5°	1155.7	1146.3	1129.1	1125.1	1118.5
30°	1115.7	1105.0	1085.0	1081.0	1075.7
32.5°	1073.0	1065.1	1043.7	1035.6	1030.2
35°	1031.6	1018.3	996.9	988.9	982.2
37.5°	984.9	972.9	951.5	942.2	935.5
40°	936.9	926.1	904.7	892.9	887.5
42.5°	890.2	879.4	858.2	844.7	836.8
45°	839.5	830.2	810.0	795.5	790.1
47.5°	790.1	780.7	759.4	744.7	736.7
50°	738.0	731.3	712.7	693.9	687.2
52.5°	687.2	678.0	660.7	646.0	636.6
55°	635.3	627.2	611.3	595.2	588.6
57.5°	583.2	576.6	559.1	543.1	537.8
60°	531.1	525.8	507.2	492.5	488.5
62.5°	480.5	471.1	457.8	444.4	439.1
65°	428.5	420.4	407.1	395.0	388.4
67.5°	375.1	368.3	356.4	347.1	341.7
70°	325.7	320.3	308.3	298.9	293.6
72.5°	275.0	269.6	263.0	253.6	249.6
75°	224.2	221.6	214.8	206.9	209.6
77.5°	178.8	173.4	170.8	166.7	162.8
80°	133.5	132.1	129.4	125.5	122.8
82.5°	90.8	90.8	89.5	84.1	84.1
85°	54.7	53.4	52.1	48.0	46.7
87.5°	24.1	21.4	18.7	14.7	13.3
90°	0.8	10.4	17.4	21.8	23.5
92.5°	21.8	18.3	20.9	22.6	23.5
95°	56.5	27.8	33.9	38.3	37.5
97.5°	101.9	30.5	44.4	47.1	47.9
100°	154.2	34.9	49.7	56.5	58.3
102.5°	211.6	210.0	51.4	60.9	63.6
105°	264.7	291.0	53.1	62.7	66.2
107.5°	326.6	348.4	54.9	64.5	67.9
110°	385.9	404.1	152.5	65.4	68.8

TEST NUMBER: P922241

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	441.7	457.3	442.5	67.1	69.7
115°	500.8	515.6	537.4	134.1	71.5
117.5°	552.2	569.6	584.5	459.9	231.7
120°	609.8	622.8	638.5	649.0	531.4
122.5°	658.4	672.4	689.9	695.1	696.0
125°	708.1	719.5	736.0	742.2	744.8
127.5°	753.4	765.6	778.7	787.5	788.3
130°	796.1	810.1	819.6	829.2	828.4
132.5°	839.6	851.0	860.6	868.4	867.6
135°	876.3	890.3	898.0	906.8	905.1
137.5°	914.5	925.0	933.8	942.4	939.9
140°	952.0	959.0	968.6	976.4	972.1
142.5°	983.5	989.5	1000.9	1007.7	1003.4
145°	1016.5	1015.7	1030.4	1036.5	1032.2
147.5°	1045.2	1042.6	1057.4	1061.8	1058.4
150°	1073.1	1067.0	1081.0	1086.2	1081.8
152.5°	1096.6	1089.7	1102.7	1108.0	1101.9
155°	1119.3	1111.5	1121.9	1127.1	1120.2
157.5°	1137.6	1130.6	1138.5	1144.6	1137.6
160°	1153.2	1148.0	1153.2	1158.4	1152.4
162.5°	1167.2	1162.0	1166.4	1172.4	1164.6
165°	1179.4	1174.2	1176.8	1182.9	1176.8
167.5°	1189.0	1183.7	1186.4	1192.5	1184.6
170°	1196.9	1191.6	1193.3	1199.4	1191.6
172.5°	1202.0	1196.9	1198.6	1204.7	1196.9
175°	1206.3	1200.2	1202.0	1208.1	1199.4
177.5°	1208.1	1202.0	1202.9	1209.1	1201.2
180°	1203.8	1203.8	1203.8	1203.8	1203.8



TEST NUMBER: P922241

CATALOG NUMBER: DFN2DIP-PN4F0-040D040US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.33	8.19	8.28	9.16	10.43	6.89	7.75	7.84	8.72	9.99
	3H	8.99	9.76	9.96	10.74	12.04	8.51	9.28	9.47	10.26	11.55
	4H	9.58	10.31	10.56	11.30	12.60	9.09	9.82	10.07	10.81	12.11
	6H	9.98	10.66	10.97	11.65	12.96	9.49	10.16	10.48	11.15	12.47
	8H	10.09	10.73	11.09	11.74	13.05	9.60	10.24	10.59	11.24	12.56
	12H	10.14	10.75	11.14	11.75	13.09	9.64	10.25	10.64	11.25	12.58
4H	2H	7.79	8.52	8.78	9.51	10.81	7.44	8.17	8.42	9.15	10.46
	3H	9.66	10.27	10.66	11.28	12.60	9.26	9.87	10.25	10.88	12.20
	4H	10.37	10.93	11.38	11.94	13.28	9.96	10.52	10.96	11.52	12.86
	6H	10.89	11.37	11.91	12.40	13.74	10.47	10.95	11.48	11.98	13.32
	8H	11.04	11.49	12.06	12.52	13.87	10.62	11.06	11.63	12.09	13.44
	12H	11.12	11.52	12.16	12.56	13.92	10.68	11.08	11.71	12.12	13.48
8H	4H	10.57	11.02	11.59	12.04	13.40	10.20	10.65	11.22	11.67	13.02
	6H	11.21	11.58	12.25	12.64	13.99	10.83	11.20	11.87	12.27	13.62
	8H	11.43	11.76	12.48	12.81	14.17	11.04	11.37	12.09	12.42	13.79
	12H	11.56	11.85	12.62	12.90	14.31	11.16	11.45	12.21	12.49	13.90
12H	4H	10.56	10.96	11.59	12.00	13.36	10.19	10.60	11.23	11.64	13.00
	6H	11.24	11.56	12.29	12.61	13.98	10.87	11.20	11.92	12.25	13.62
	8H	11.48	11.77	12.53	12.81	14.22	11.11	11.40	12.16	12.44	13.85

END OF REPORT