

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922292

Luminaire Tested: DFN2DIP-PN4F0-050D080US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922292
REPORT IS A COMBINATION OF REPORTS P899683 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-050D080US940-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10727.3 lumens
Efficiency: N/A
Efficacy: 105.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922292

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US940-FLLFLL

Luminous Intensity Polar Plot

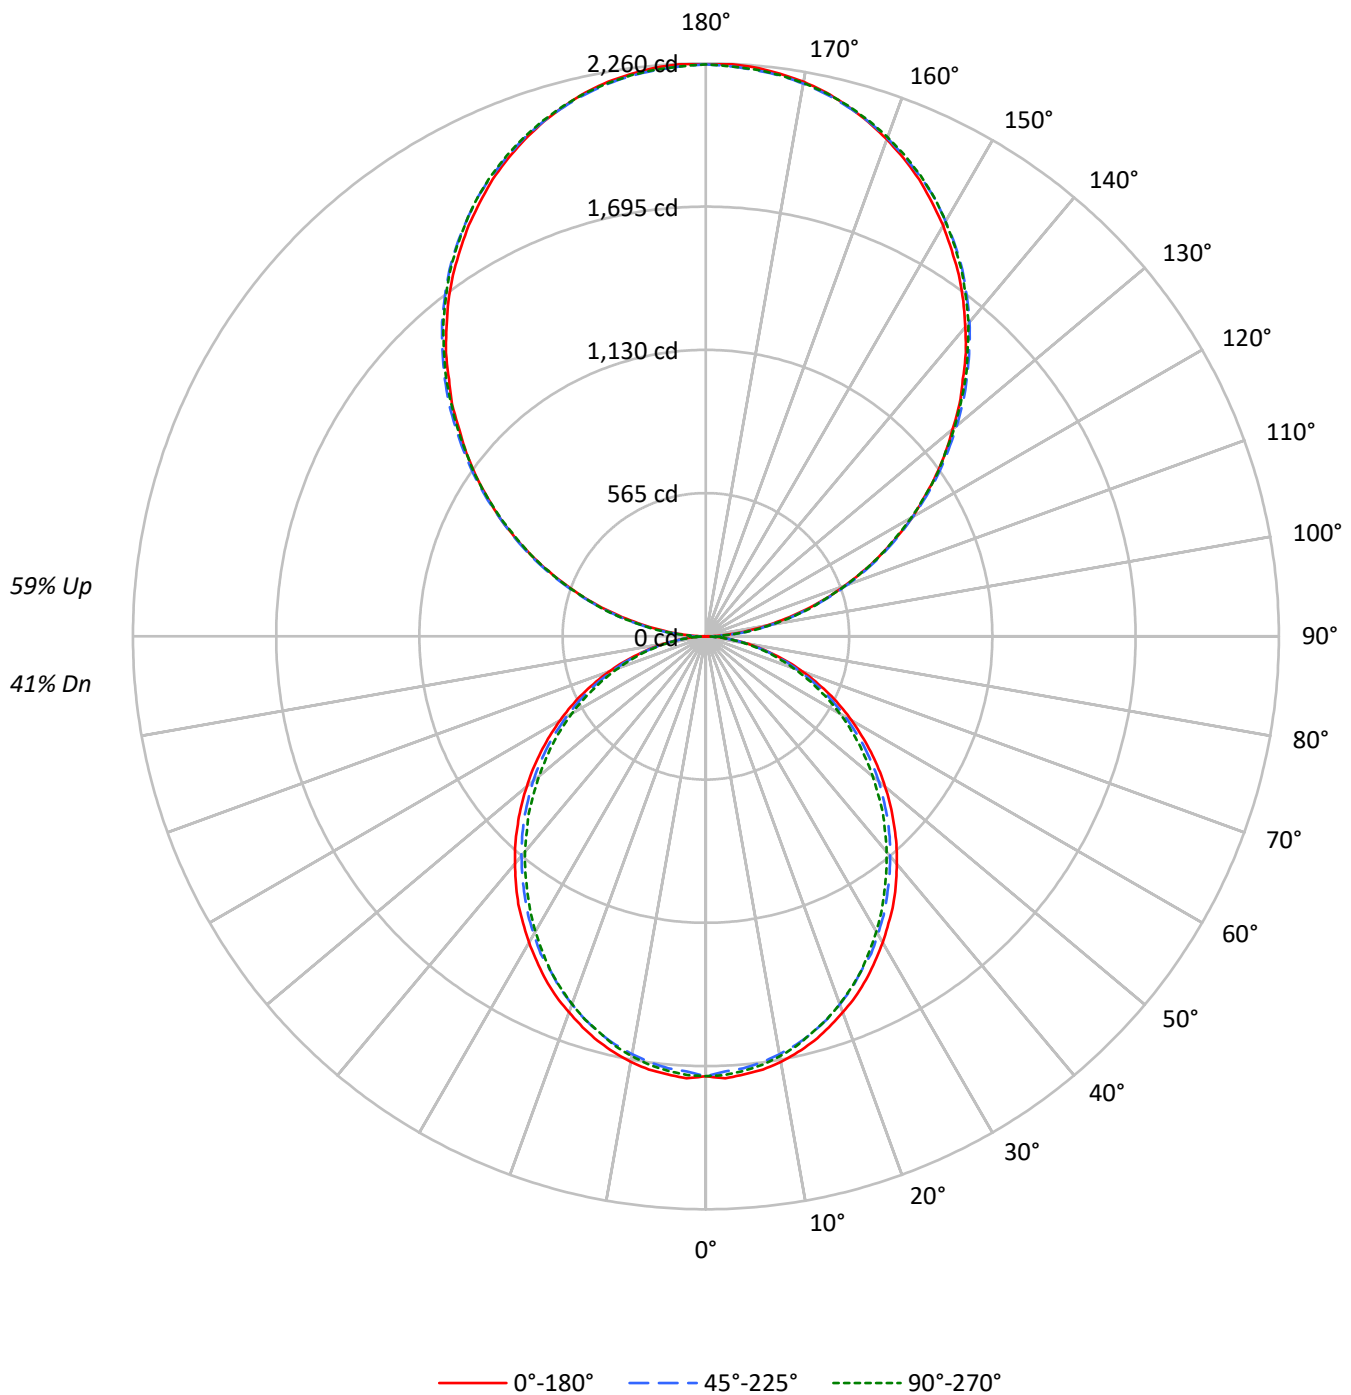

TEST NUMBER: P922292

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	63	63	63	48	48	48
1	96	92	88	84	87	84	80	77	69	66	64	55	53	52	42	41	41
2	87	80	74	69	79	73	68	63	60	56	53	48	46	43	37	36	34
3	80	70	63	57	72	64	58	53	53	48	45	43	39	37	33	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	34	31	30	27	25
5	67	55	47	41	61	51	44	38	42	37	33	34	30	27	27	24	22
6	61	50	42	36	56	46	38	33	38	33	29	31	27	24	24	21	19
7	57	45	37	31	52	41	34	29	34	29	25	28	24	21	22	19	17
8	53	40	33	28	48	37	31	26	31	26	22	26	22	19	20	17	15
9	49	37	30	25	45	34	27	23	29	23	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1266	1266	1266
5°	1268	1249	1257
10°	1258	1232	1241
15°	1240	1212	1214
20°	1215	1184	1187
25°	1190	1151	1156
30°	1158	1119	1116
35°	1129	1083	1074
40°	1093	1045	1034
45°	1056	1008	993
50°	1017	969	946
55°	975	924	902
60°	928	870	852
65°	877	814	793
70°	812	747	730
75°	722	666	672
80°	613	563	560
85°	443	384	375

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1766 cd/sqm

TEST NUMBER: P922292

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	163.3	1.5
10°-20°	459.4	4.3
20°-30°	675.2	6.3
30°-40°	784.2	7.3
40°-50°	783.2	7.3
50°-60°	682.9	6.4
60°-70°	504.8	4.7
70°-80°	285.6	2.7
80°-90°	81.8	0.8
90°-100°	139.6	1.3
100°-110°	443.6	4.1
110°-120°	759.1	7.1
120°-130°	998.3	9.3
130°-140°	1120.6	10.4
140°-150°	1098.9	10.2
150°-160°	921.8	8.6
160°-170°	611.3	5.7
170°-180°	213.7	2.0
0°-30°	1297.9	12.1
0°-40°	2082.0	19.4
0°-60°	3548.1	33.1
0°-90°	4420.4	41.2
90°-120°	1342.3	12.5
90°-150°	4560.1	42.5
90°-180°	6307.0	58.8
0°-180°	10727.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1735	1735	1735	1735	1735	
5°	1735	1728	1710	1723	1720	165
15°	1651	1642	1620	1627	1618	465
25°	1495	1481	1453	1456	1453	688
35°	1290	1273	1246	1236	1228	805
45°	1049	1038	1012	994	988	810
55°	794	784	764	744	736	710
65°	536	526	509	494	485	530
75°	280	277	268	259	262	299
85°	68	67	65	60	58	76
90°	2	24	67	63	65	10
95°	99	118	122	122	118	111
105°	410	415	419	422	422	432
115°	762	773	769	767	762	753
125°	1108	1125	1120	1113	1111	990
135°	1433	1454	1458	1456	1451	1108
145°	1740	1754	1764	1766	1759	1087
155°	1990	1995	2001	2010	2004	916
165°	2164	2162	2162	2176	2166	611
175°	2252	2247	2242	2256	2244	214
180°	2256	2256	2256	2256	2256	

TEST NUMBER: P922292

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1734.8	1734.8	1734.8	1734.8	1734.8
2.5°	1744.9	1736.6	1718.2	1734.8	1731.7
5°	1734.8	1728.3	1709.9	1723.1	1720.0
7.5°	1723.1	1713.2	1694.9	1708.3	1705.0
10°	1705.0	1693.3	1673.3	1686.5	1681.6
12.5°	1679.8	1669.9	1649.9	1658.2	1654.8
15°	1651.4	1641.5	1619.8	1626.6	1618.2
17.5°	1616.4	1606.5	1584.7	1593.0	1584.7
20°	1578.1	1568.2	1544.8	1549.7	1543.2
22.5°	1539.8	1524.7	1503.0	1503.0	1499.6
25°	1494.7	1481.4	1453.0	1456.3	1453.0
27.5°	1444.6	1432.9	1411.3	1406.3	1398.0
30°	1394.6	1381.3	1356.3	1351.3	1344.6
32.5°	1341.2	1331.3	1304.6	1294.5	1287.8
35°	1289.5	1272.9	1246.2	1236.1	1227.8
37.5°	1231.1	1216.1	1189.4	1177.7	1169.4
40°	1171.2	1157.7	1131.0	1116.1	1109.4
42.5°	1112.8	1099.3	1072.7	1055.9	1046.0
45°	1049.4	1037.7	1012.5	994.3	987.6
47.5°	987.6	975.9	949.2	930.8	920.9
50°	922.5	914.2	890.8	867.5	859.1
52.5°	859.1	847.4	825.8	807.4	795.8
55°	794.2	784.1	764.0	744.0	735.8
57.5°	729.0	720.7	698.9	678.9	672.2
60°	663.9	657.4	634.0	615.5	610.6
62.5°	600.6	588.9	572.2	555.5	548.8
65°	535.6	525.5	508.8	493.8	485.4
67.5°	468.9	460.4	445.5	433.8	427.0
70°	407.1	400.4	385.3	373.6	367.1
72.5°	343.8	337.0	328.7	317.0	312.0
75°	280.2	277.0	268.5	258.6	262.0
77.5°	223.6	216.8	213.5	208.5	203.6
80°	166.9	165.1	161.8	156.9	153.5
82.5°	113.4	113.4	111.8	105.1	105.1
85°	68.3	66.7	65.1	60.0	58.4
87.5°	30.1	26.8	23.4	18.4	16.7
90°	2.1	24.5	66.7	62.6	64.6
92.5°	42.2	57.2	59.2	61.2	61.2
95°	99.3	118.3	121.7	121.7	118.3
97.5°	165.3	183.0	190.5	190.5	190.5
100°	241.5	257.1	262.5	262.5	260.5
102.5°	321.7	333.3	340.7	342.8	340.7
105°	409.5	414.9	419.0	422.4	422.4
107.5°	496.5	504.7	504.7	506.0	496.5
110°	580.9	591.7	591.7	591.7	586.3

TEST NUMBER: P922292

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	672.0	683.6	681.5	676.1	672.0
115°	761.8	772.7	769.3	767.2	761.8
117.5°	850.9	865.9	856.3	850.9	845.4
120°	940.7	955.6	940.7	940.7	934.5
122.5°	1022.3	1041.3	1031.8	1026.4	1022.3
125°	1108.0	1125.0	1119.5	1113.4	1111.4
127.5°	1191.7	1212.7	1205.2	1197.1	1191.7
130°	1269.9	1294.3	1290.9	1286.9	1279.4
132.5°	1357.6	1376.6	1378.0	1368.5	1363.1
135°	1433.1	1454.2	1458.3	1456.3	1450.8
137.5°	1517.4	1534.5	1537.8	1536.5	1528.3
140°	1591.6	1608.6	1618.1	1618.1	1610.6
142.5°	1667.8	1684.8	1690.2	1692.3	1684.8
145°	1739.9	1753.5	1764.3	1766.4	1758.9
147.5°	1804.5	1821.5	1829.6	1833.1	1825.6
150°	1871.2	1882.7	1890.2	1896.3	1890.2
152.5°	1930.3	1941.9	1951.4	1958.9	1951.4
155°	1989.5	1994.9	2001.1	2010.5	2004.5
157.5°	2040.5	2044.6	2048.0	2061.5	2052.1
160°	2086.1	2090.2	2092.2	2103.7	2095.6
162.5°	2128.2	2128.2	2130.3	2143.2	2133.7
165°	2164.3	2162.2	2162.2	2175.9	2166.3
167.5°	2196.9	2190.8	2190.8	2204.4	2194.9
170°	2221.4	2216.0	2213.9	2227.6	2216.0
172.5°	2238.5	2233.0	2231.0	2244.5	2233.0
175°	2252.0	2246.6	2242.5	2256.1	2244.5
177.5°	2259.5	2254.1	2250.0	2261.6	2250.0
180°	2256.1	2256.1	2256.1	2256.1	2256.1



TEST NUMBER: P922292

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.23	8.01	8.25	9.05	10.44	6.79	7.57	7.81	8.61	10.00
	3H	8.88	9.59	9.92	10.64	12.05	8.40	9.10	9.44	10.15	11.56
	4H	9.47	10.14	10.52	11.19	12.60	8.98	9.65	10.03	10.70	12.12
	6H	9.87	10.48	10.93	11.54	12.97	9.38	9.99	10.44	11.04	12.47
	8H	9.97	10.56	11.04	11.63	13.05	9.48	10.07	10.54	11.13	12.56
	12H	10.02	10.58	11.09	11.64	13.09	9.52	10.08	10.59	11.14	12.59
4H	2H	7.68	8.35	8.74	9.40	10.81	7.33	8.00	8.38	9.04	10.46
	3H	9.54	10.10	10.61	11.17	12.61	9.14	9.70	10.20	10.77	12.20
	4H	10.25	10.77	11.33	11.83	13.29	9.84	10.35	10.91	11.41	12.87
	6H	10.77	11.21	11.85	12.30	13.74	10.34	10.78	11.42	11.87	13.32
	8H	10.92	11.33	12.00	12.41	13.87	10.49	10.90	11.57	11.98	13.44
	12H	10.99	11.36	12.09	12.46	13.92	10.55	10.92	11.65	12.02	13.48
8H	4H	10.45	10.86	11.53	11.94	13.40	10.07	10.48	11.15	11.57	13.03
	6H	11.08	11.42	12.18	12.54	14.00	10.70	11.04	11.80	12.16	13.62
	8H	11.30	11.60	12.41	12.70	14.18	10.91	11.21	12.02	12.32	13.80
	12H	11.43	11.69	12.54	12.79	14.31	11.03	11.29	12.14	12.39	13.91
12H	4H	10.43	10.80	11.53	11.89	13.36	10.06	10.44	11.16	11.53	13.00
	6H	11.11	11.40	12.22	12.51	13.99	10.74	11.04	11.85	12.15	13.63
	8H	11.35	11.61	12.46	12.71	14.23	10.97	11.24	12.09	12.34	13.86

END OF REPORT