

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922318

Luminaire Tested: DFN2DIP-PN4F0-060D050US940-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922318
REPORT IS A COMBINATION OF REPORTS P899632 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D050US940-RLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8493.6 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 92.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922318

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US940-RLLFLL

Luminous Intensity Polar Plot

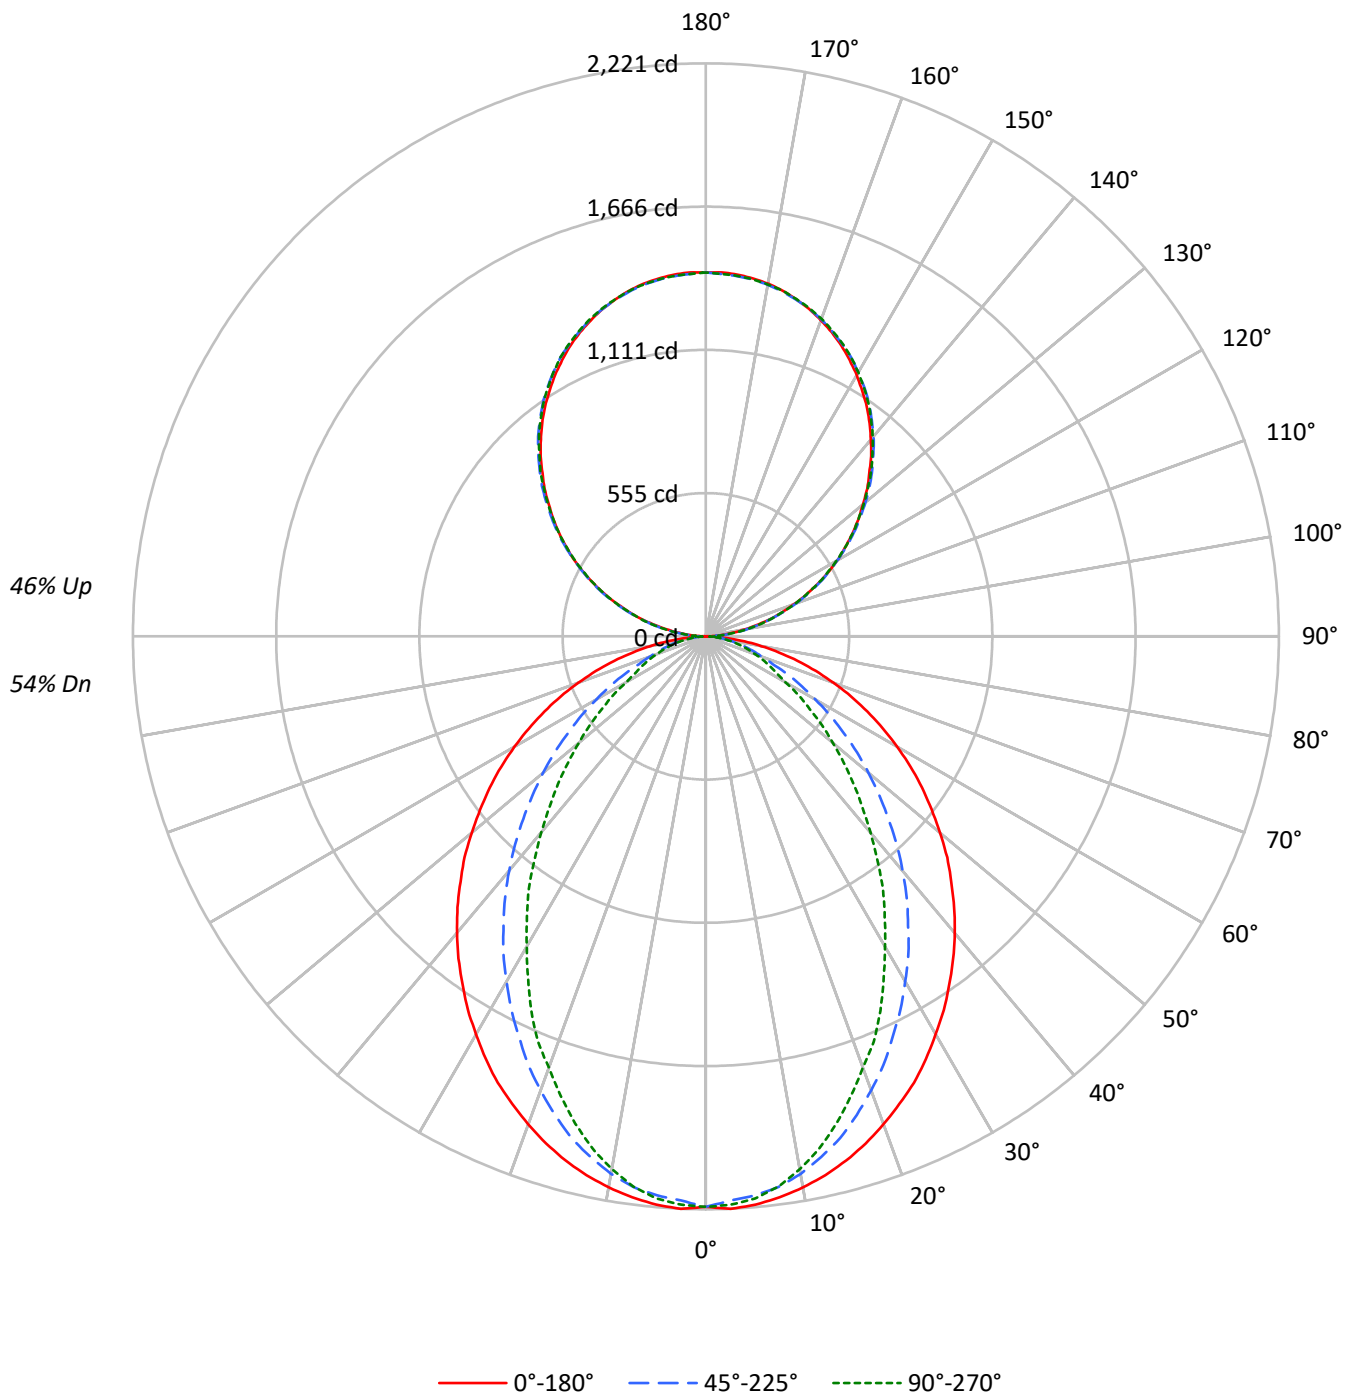

TEST NUMBER: P922318

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US940-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	84	78	73	84	78	73	68	67	63	60	57	54	52	48	46	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	43	40	38
4	76	66	58	52	71	61	55	49	53	48	44	46	42	38	38	36	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	29	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	27	29	26	23
8	56	44	36	31	52	41	34	30	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	27	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1614	1614	1614
5°	1617	1589	1599
10°	1601	1558	1547
15°	1579	1506	1467
20°	1549	1436	1369
25°	1520	1356	1274
30°	1480	1275	1153
35°	1440	1187	1047
40°	1400	1097	925
45°	1354	996	815
50°	1306	895	707
55°	1256	786	604
60°	1198	673	497
65°	1131	557	448
70°	1050	450	406
75°	949	397	370
80°	801	333	322
85°	558	224	244

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1354 cd/sqm

TEST NUMBER: P922318

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US940-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	2.4
10°-20°	568.9	6.7
20°-30°	798.7	9.4
30°-40°	870.7	10.3
40°-50°	800.3	9.4
50°-60°	628.5	7.4
60°-70°	409.1	4.8
70°-80°	210.6	2.5
80°-90°	57.8	0.7
90°-100°	87.3	1.0
100°-110°	277.2	3.3
110°-120°	474.5	5.6
120°-130°	624.0	7.3
130°-140°	700.4	8.2
140°-150°	686.8	8.1
150°-160°	576.1	6.8
160°-170°	382.1	4.5
170°-180°	133.5	1.6
0°-30°	1574.9	18.5
0°-40°	2445.6	28.8
0°-60°	3874.3	45.6
0°-90°	4551.7	53.6
90°-120°	838.9	9.9
90°-150°	2850.1	33.6
90°-180°	3942.0	46.4
0°-180°	8493.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	1	15	42	39	40	8
95°	62	74	76	76	74	69
105°	256	259	262	264	264	270
115°	476	483	481	480	476	471
125°	692	703	700	696	695	619
135°	896	909	911	910	907	692
145°	1087	1096	1103	1104	1099	679
155°	1243	1247	1251	1257	1253	572
165°	1353	1351	1351	1360	1354	382
175°	1408	1404	1402	1410	1403	134
180°	1410	1410	1410	1410	1410	

TEST NUMBER: P922318

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US940-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	1.2	15.3	41.6	39.1	40.4
92.5°	26.4	35.7	37.0	38.3	38.3
95°	62.1	74.0	76.1	76.1	74.0
97.5°	103.3	114.3	119.0	119.0	119.0
100°	150.9	160.7	164.1	164.1	162.8
102.5°	201.1	208.3	212.9	214.3	212.9
105°	255.9	259.3	261.9	263.9	263.9
107.5°	310.3	315.4	315.4	316.3	310.3
110°	363.0	369.9	369.9	369.9	366.4

TEST NUMBER: P922318

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US940-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	420.0	427.2	426.0	422.6	420.0
115°	476.1	483.0	480.8	479.6	476.1
117.5°	531.8	541.2	535.2	531.8	528.4
120°	587.9	597.3	587.9	587.9	584.1
122.5°	638.9	650.9	644.9	641.5	638.9
125°	692.5	703.1	699.7	695.9	694.6
127.5°	744.8	758.0	753.3	748.1	744.8
130°	793.7	809.0	806.8	804.3	799.6
132.5°	848.6	860.4	861.3	855.3	851.9
135°	895.7	908.8	911.4	910.2	906.8
137.5°	948.4	959.0	961.2	960.3	955.2
140°	994.7	1005.4	1011.3	1011.3	1006.7
142.5°	1042.3	1053.0	1056.4	1057.7	1053.0
145°	1087.4	1095.9	1102.7	1104.0	1099.3
147.5°	1127.8	1138.4	1143.5	1145.7	1140.9
150°	1169.5	1176.7	1181.3	1185.2	1181.3
152.5°	1206.5	1213.7	1219.6	1224.3	1219.6
155°	1243.4	1246.8	1250.6	1256.6	1252.8
157.5°	1275.3	1277.8	1280.0	1288.5	1282.5
160°	1303.8	1306.4	1307.6	1314.8	1309.7
162.5°	1330.2	1330.2	1331.4	1339.5	1333.6
165°	1352.7	1351.4	1351.4	1359.9	1354.0
167.5°	1373.1	1369.2	1369.2	1377.8	1371.8
170°	1388.4	1385.0	1383.8	1392.2	1385.0
172.5°	1399.0	1395.6	1394.4	1402.8	1395.6
175°	1407.6	1404.1	1401.6	1410.1	1402.8
177.5°	1412.2	1408.8	1406.2	1413.5	1406.2
180°	1410.1	1410.1	1410.1	1410.1	1410.1



TEST NUMBER: P922318

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.15	10.01	10.08	10.95	12.17	5.11	5.97	6.04	6.92	8.14
	3H	10.83	11.60	11.77	12.55	13.80	6.30	7.07	7.25	8.03	9.27
	4H	11.44	12.17	12.40	13.13	14.38	6.75	7.48	7.71	8.44	9.70
	6H	11.87	12.53	12.84	13.50	14.77	7.08	7.75	8.05	8.71	9.98
	8H	11.99	12.63	12.97	13.61	14.88	7.17	7.81	8.15	8.79	10.05
	12H	12.06	12.66	13.04	13.64	14.93	7.21	7.82	8.20	8.79	10.08
4H	2H	9.17	9.89	10.13	10.85	12.11	5.71	6.44	6.68	7.40	8.65
	3H	11.00	11.61	11.98	12.60	13.86	7.07	7.67	8.04	8.66	9.93
	4H	11.70	12.25	12.68	13.23	14.52	7.62	8.17	8.60	9.15	10.44
	6H	12.22	12.69	13.21	13.70	14.99	8.04	8.51	9.03	9.52	10.81
	8H	12.40	12.84	13.39	13.84	15.14	8.17	8.61	9.16	9.61	10.91
	12H	12.49	12.89	13.51	13.91	15.22	8.23	8.63	9.25	9.65	10.96
8H	4H	11.67	12.11	12.66	13.11	14.42	7.90	8.34	8.90	9.34	10.65
	6H	12.24	12.60	13.26	13.65	14.95	8.42	8.79	9.44	9.83	11.13
	8H	12.46	12.78	13.49	13.81	15.13	8.61	8.93	9.64	9.96	11.28
	12H	12.60	12.88	13.63	13.90	15.27	8.73	9.02	9.76	10.04	11.41
12H	4H	11.62	12.02	12.64	13.04	14.35	7.91	8.30	8.92	9.32	10.63
	6H	12.21	12.54	13.24	13.56	14.89	8.47	8.79	9.50	9.82	11.14
	8H	12.44	12.72	13.47	13.74	15.11	8.68	8.97	9.71	9.99	11.36

END OF REPORT