

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922323

Luminaire Tested: DFN2DIP-PN4F0-060D060US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922323
REPORT IS A COMBINATION OF REPORTS P901170 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D060US940-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9844.5 lumens
Efficiency: N/A
Efficacy: 98.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 99.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922323

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US940-RLLONL

Luminous Intensity Polar Plot

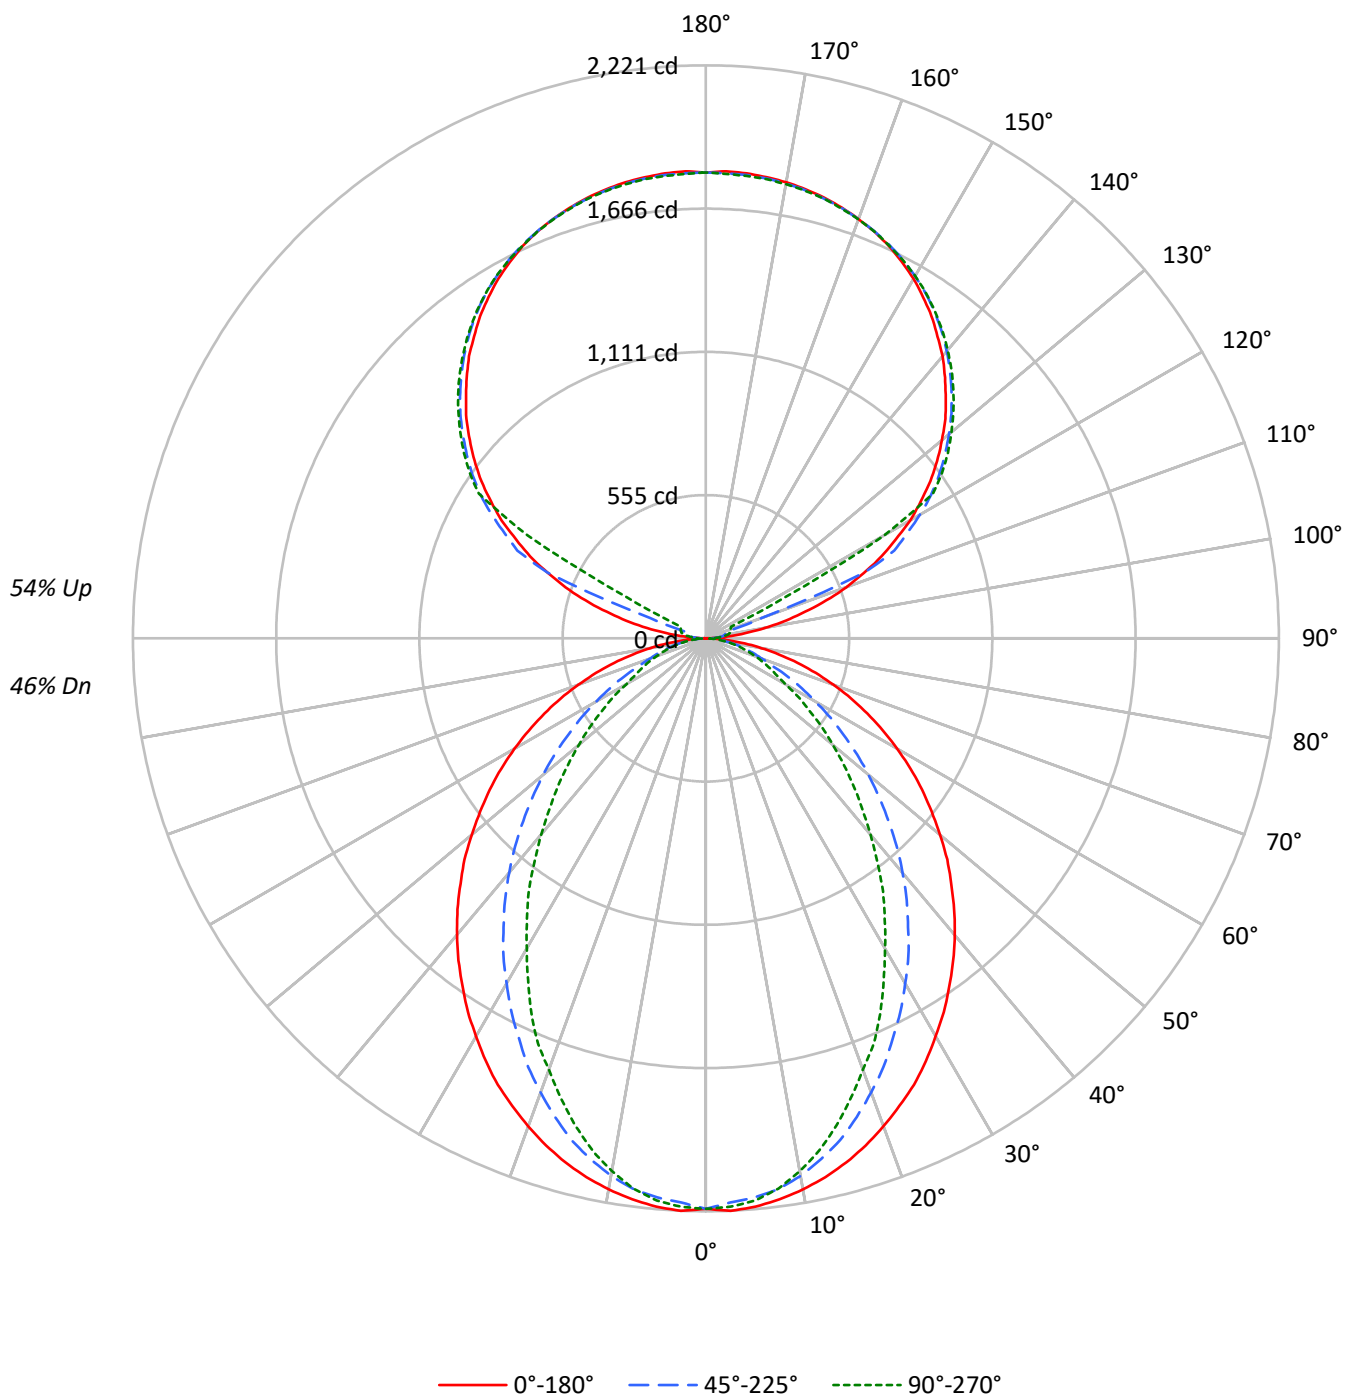

TEST NUMBER: P922323

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1614	1614	1614
5°	1617	1589	1599
10°	1601	1558	1547
15°	1579	1506	1467
20°	1549	1436	1369
25°	1520	1356	1274
30°	1480	1275	1153
35°	1440	1187	1047
40°	1400	1097	925
45°	1354	996	815
50°	1306	895	707
55°	1256	786	604
60°	1198	673	497
65°	1131	557	448
70°	1050	450	406
75°	949	397	370
80°	801	333	322
85°	558	224	244

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1354 cd/sqm

TEST NUMBER: P922323

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	2.1
10°-20°	568.9	5.8
20°-30°	798.7	8.1
30°-40°	870.7	8.8
40°-50°	800.3	8.1
50°-60°	628.5	6.4
60°-70°	409.1	4.2
70°-80°	210.6	2.1
80°-90°	56.9	0.6
90°-100°	59.5	0.6
100°-110°	222.0	2.3
110°-120°	588.7	6.0
120°-130°	976.3	9.9
130°-140°	1037.1	10.5
140°-150°	963.9	9.8
150°-160°	774.9	7.9
160°-170°	499.3	5.1
170°-180°	171.9	1.7
0°-30°	1574.9	16.0
0°-40°	2445.6	24.8
0°-60°	3874.3	39.4
0°-90°	4550.9	46.2
90°-120°	870.2	8.8
90°-150°	3847.4	39.1
90°-180°	5294.0	53.8
0°-180°	9844.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	1	16	26	33	35	9
95°	85	42	51	58	56	101
105°	397	436	80	94	99	424
115°	751	774	806	201	107	740
125°	1062	1079	1104	1113	1117	947
135°	1314	1335	1347	1360	1358	1015
145°	1525	1523	1546	1555	1548	954
155°	1679	1667	1683	1691	1680	774
165°	1769	1761	1765	1774	1765	500
175°	1810	1800	1803	1812	1799	172
180°	1806	1806	1806	1806	1806	

TEST NUMBER: P922323

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	1.2	15.7	26.0	32.7	35.2
92.5°	32.7	27.5	31.3	34.0	35.2
95°	84.9	41.7	50.9	57.6	56.2
97.5°	152.8	45.7	66.5	70.6	71.9
100°	231.3	52.3	74.5	84.9	87.5
102.5°	317.4	315.0	77.1	91.4	95.4
105°	397.2	436.4	79.7	94.0	99.3
107.5°	490.0	522.5	82.4	96.7	101.9
110°	578.9	606.2	228.7	98.1	103.2



TEST NUMBER: P922323

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	662.5	685.9	663.7	100.5	104.6
115°	751.3	773.5	806.2	201.3	107.2
117.5°	828.3	854.4	876.7	689.8	347.5
120°	914.6	934.2	957.8	973.4	797.0
122.5°	987.7	1008.6	1034.8	1042.6	1044.0
125°	1062.2	1079.2	1104.0	1113.2	1117.0
127.5°	1130.2	1148.4	1168.1	1181.2	1182.4
130°	1194.2	1215.1	1229.4	1243.8	1242.6
132.5°	1259.5	1276.6	1290.8	1302.6	1301.4
135°	1314.5	1335.4	1347.0	1360.2	1357.5
137.5°	1371.8	1387.5	1400.7	1413.7	1409.9
140°	1428.0	1438.6	1452.9	1464.6	1458.1
142.5°	1475.2	1484.3	1501.3	1511.6	1505.1
145°	1524.8	1523.4	1545.6	1554.8	1548.3
147.5°	1567.8	1563.9	1586.1	1592.6	1587.5
150°	1609.7	1600.5	1621.5	1629.2	1622.7
152.5°	1644.9	1634.5	1654.0	1662.0	1652.8
155°	1678.9	1667.2	1682.9	1690.7	1680.2
157.5°	1706.4	1695.9	1707.7	1716.9	1706.4
160°	1729.9	1722.0	1729.9	1737.7	1728.6
162.5°	1750.7	1742.9	1749.4	1758.6	1746.9
165°	1769.1	1761.3	1765.1	1774.3	1765.1
167.5°	1783.4	1775.6	1779.6	1788.8	1776.9
170°	1795.3	1787.3	1790.0	1799.1	1787.3
172.5°	1803.0	1795.3	1797.9	1807.1	1795.3
175°	1809.5	1800.4	1803.0	1812.1	1799.1
177.5°	1812.1	1803.0	1804.4	1813.6	1801.8
180°	1805.6	1805.6	1805.6	1805.6	1805.6

TEST NUMBER: P922323

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.45	9.25	9.45	10.26	11.58	4.42	5.22	5.41	6.22	7.55
	3H	10.13	10.85	11.14	11.86	13.21	5.61	6.32	6.61	7.33	8.68
	4H	10.74	11.42	11.76	12.43	13.79	6.06	6.73	7.08	7.75	9.10
	6H	11.16	11.79	12.19	12.81	14.17	6.38	7.00	7.41	8.02	9.39
	8H	11.29	11.88	12.33	12.92	14.28	6.47	7.06	7.50	8.09	9.46
	12H	11.35	11.92	12.39	12.94	14.33	6.51	7.07	7.55	8.10	9.49
4H	2H	8.47	9.15	9.49	10.16	11.52	5.01	5.69	6.04	6.70	8.06
	3H	10.30	10.86	11.33	11.90	13.27	6.36	6.92	7.39	7.97	9.34
	4H	10.99	11.51	12.03	12.54	13.93	6.91	7.42	7.95	8.46	9.85
	6H	11.51	11.95	12.56	13.01	14.40	7.33	7.77	8.38	8.83	10.22
	8H	11.68	12.10	12.74	13.15	14.55	7.46	7.87	8.51	8.92	10.32
	12H	11.78	12.15	12.85	13.22	14.62	7.52	7.89	8.59	8.96	10.37
8H	4H	10.96	11.37	12.01	12.42	13.82	7.19	7.60	8.24	8.65	10.05
	6H	11.53	11.87	12.60	12.96	14.36	7.71	8.05	8.78	9.14	10.54
	8H	11.74	12.04	12.83	13.12	14.54	7.90	8.20	8.98	9.27	10.69
	12H	11.88	12.15	12.97	13.22	14.68	8.02	8.28	9.10	9.35	10.81
12H	4H	10.91	11.28	11.98	12.35	13.75	7.19	7.56	8.26	8.63	10.04
	6H	11.50	11.80	12.58	12.88	14.30	7.76	8.06	8.84	9.13	10.55
	8H	11.72	11.99	12.81	13.06	14.52	7.97	8.23	9.05	9.30	10.76

END OF REPORT