

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922441

Luminaire Tested: DFN2DIP-PN4F0-090D090US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922441
REPORT IS A COMBINATION OF REPORTS P901229 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-090D090US940-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15890.3 lumens
Efficiency: N/A
Efficacy: 102.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 155
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922441

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US940-FLLONL

Luminous Intensity Polar Plot

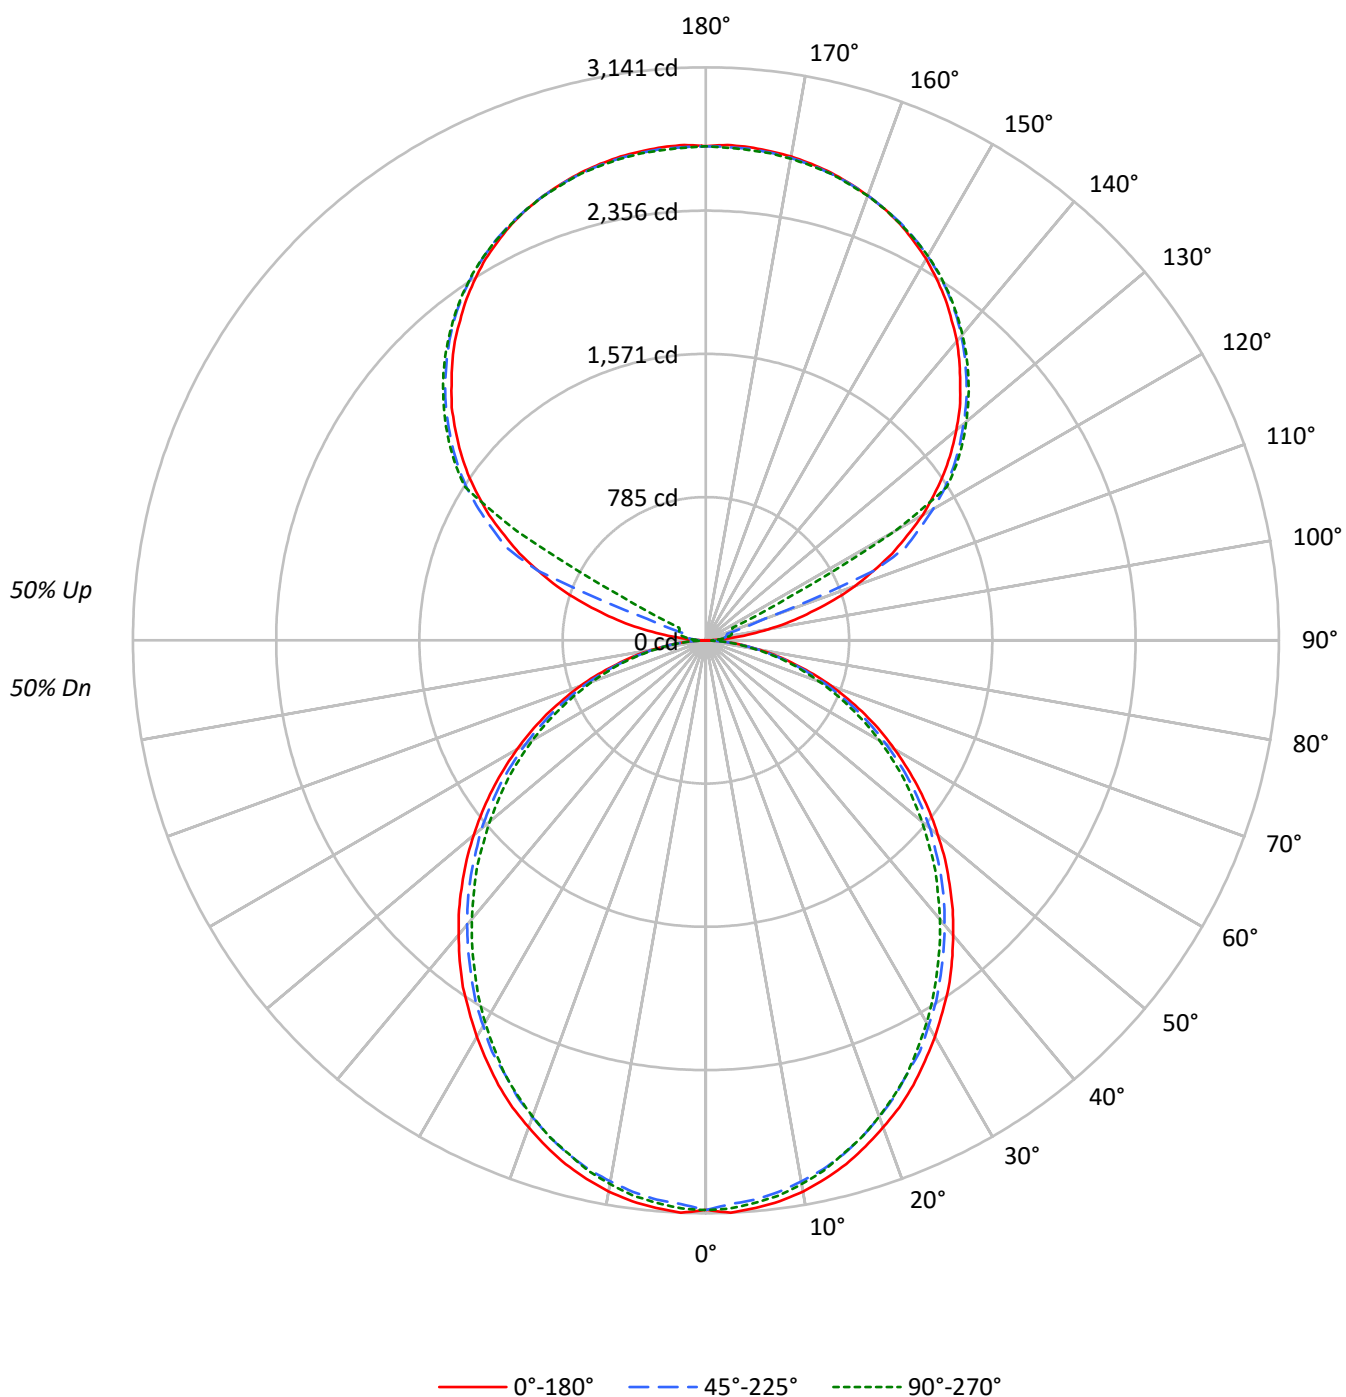

TEST NUMBER: P922441

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56	56	56	50
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47	47	47	42
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40	40	40	35
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34	34	34	30
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29	29	29	26
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26	26	26	22
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23	23	23	20
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20	20	20	17
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18	18	18	16
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16	16	16	14
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15	15	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2279	2279	2279
5°	2283	2248	2263
10°	2265	2218	2233
15°	2231	2182	2186
20°	2186	2131	2137
25°	2142	2071	2081
30°	2085	2015	2009
35°	2032	1949	1933
40°	1967	1882	1861
45°	1902	1815	1787
50°	1830	1744	1702
55°	1756	1663	1624
60°	1671	1566	1534
65°	1579	1466	1428
70°	1462	1344	1314
75°	1299	1198	1209
80°	1104	1012	1009
85°	798	691	674

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1902 cd/sqm

TEST NUMBER: P922441

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.9	1.8
10°-20°	827.0	5.2
20°-30°	1215.3	7.6
30°-40°	1411.5	8.9
40°-50°	1409.7	8.9
50°-60°	1229.3	7.7
60°-70°	908.7	5.7
70°-80°	514.1	3.2
80°-90°	140.5	0.9
90°-100°	89.3	0.6
100°-110°	332.9	2.1
110°-120°	883.0	5.6
120°-130°	1464.5	9.2
130°-140°	1555.6	9.8
140°-150°	1445.8	9.1
150°-160°	1162.4	7.3
160°-170°	749.0	4.7
170°-180°	257.8	1.6
0°-30°	2336.2	14.7
0°-40°	3747.7	23.6
0°-60°	6386.7	40.2
0°-90°	7949.9	50.0
90°-120°	1305.2	8.2
90°-150°	5771.2	36.3
90°-180°	7940.0	50.0
0°-180°	15890.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3123	3123	3123	3123	3123	
5°	3123	3111	3078	3102	3096	296
15°	2973	2955	2916	2928	2913	837
25°	2690	2666	2616	2621	2616	1238
35°	2321	2291	2243	2225	2210	1449
45°	1889	1868	1823	1790	1778	1458
55°	1430	1411	1375	1339	1324	1278
65°	964	946	916	889	874	953
75°	504	499	483	466	472	538
85°	123	120	117	108	105	137
90°	2	24	39	49	53	15
95°	127	63	76	86	84	151
105°	596	655	120	141	149	637
115°	1127	1160	1209	302	161	1109
125°	1593	1619	1656	1670	1676	1421
135°	1972	2003	2020	2040	2036	1523
145°	2287	2285	2318	2332	2322	1431
155°	2518	2501	2524	2536	2520	1161
165°	2654	2642	2648	2662	2648	750
175°	2714	2700	2705	2718	2699	258
180°	2708	2708	2708	2708	2708	

TEST NUMBER: P922441

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3122.7	3122.7	3122.7	3122.7	3122.7
2.5°	3140.9	3125.9	3092.8	3122.7	3117.0
5°	3122.7	3110.9	3077.8	3101.7	3095.9
7.5°	3101.7	3083.9	3050.7	3075.0	3068.9
10°	3068.9	3047.9	3011.8	3035.7	3026.8
12.5°	3023.6	3005.8	2969.8	2984.7	2978.8
15°	2972.7	2954.9	2915.6	2927.8	2912.8
17.5°	2909.6	2891.7	2852.6	2867.6	2852.6
20°	2840.5	2822.6	2780.5	2789.4	2777.7
22.5°	2771.6	2744.6	2705.4	2705.4	2699.3
25°	2690.4	2666.5	2615.6	2621.3	2615.6
27.5°	2600.2	2579.2	2540.4	2531.5	2516.5
30°	2510.4	2486.2	2441.2	2432.3	2420.3
32.5°	2414.2	2396.4	2348.2	2330.1	2318.0
35°	2321.2	2291.2	2243.1	2225.0	2210.0
37.5°	2216.1	2189.0	2140.8	2119.9	2104.9
40°	2108.0	2083.8	2035.7	2008.9	1996.9
42.5°	2002.9	1978.7	1930.9	1900.7	1882.8
45°	1888.8	1867.9	1822.6	1789.8	1777.7
47.5°	1777.7	1756.7	1708.5	1675.4	1657.6
50°	1660.5	1645.5	1603.4	1561.4	1546.4
52.5°	1546.4	1525.4	1486.5	1453.4	1432.4
55°	1429.5	1411.3	1375.3	1339.3	1324.4
57.5°	1312.2	1297.3	1258.1	1222.1	1210.0
60°	1195.0	1183.2	1141.1	1108.0	1099.1
62.5°	1080.9	1059.9	1029.9	1000.1	987.9
65°	964.0	945.8	915.9	888.9	873.9
67.5°	843.9	828.7	801.8	780.9	768.7
70°	732.7	720.6	693.6	672.5	660.8
72.5°	618.7	606.5	591.6	570.6	561.7
75°	504.4	498.6	483.3	465.5	471.5
77.5°	402.3	390.3	384.2	375.3	366.4
80°	300.4	297.2	291.1	282.2	276.3
82.5°	204.2	204.2	201.3	189.2	189.2
85°	123.0	120.1	117.3	108.0	105.1
87.5°	54.1	48.1	42.1	33.2	30.0
90°	1.9	23.5	39.1	49.1	52.8
92.5°	49.1	41.2	47.0	51.0	52.8
95°	127.3	62.6	76.3	86.3	84.3
97.5°	229.3	68.7	99.9	105.8	107.7
100°	347.0	78.5	111.7	127.3	131.3
102.5°	476.2	472.4	115.7	137.1	143.1
105°	595.8	654.7	119.6	141.1	148.9
107.5°	734.9	783.8	123.6	145.0	152.9
110°	868.3	909.3	343.0	147.0	154.8

TEST NUMBER: P922441

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	993.7	1028.9	995.6	150.8	156.9
115°	1126.9	1160.1	1209.2	301.8	160.8
117.5°	1242.5	1281.7	1315.1	1034.7	521.3
120°	1371.9	1401.2	1436.6	1460.1	1195.5
122.5°	1481.6	1513.0	1552.3	1563.9	1566.0
125°	1593.2	1618.8	1656.1	1669.8	1675.6
127.5°	1695.1	1722.6	1752.2	1771.7	1773.6
130°	1791.3	1822.7	1844.1	1865.7	1863.9
132.5°	1889.3	1914.9	1936.3	1954.0	1952.1
135°	1971.7	2003.0	2020.5	2040.3	2036.4
137.5°	2057.8	2081.3	2101.0	2120.6	2114.8
140°	2142.0	2157.8	2179.3	2196.9	2187.2
142.5°	2212.8	2226.5	2251.8	2267.4	2257.7
145°	2287.2	2285.1	2318.4	2332.2	2322.4
147.5°	2351.7	2345.9	2379.2	2389.0	2381.2
150°	2414.6	2400.8	2432.2	2443.8	2434.1
152.5°	2467.4	2451.8	2481.1	2493.0	2479.2
155°	2518.4	2500.9	2524.3	2536.0	2520.4
157.5°	2559.6	2544.0	2561.6	2575.3	2559.6
160°	2594.9	2583.0	2594.9	2606.6	2592.8
162.5°	2626.1	2614.4	2624.2	2637.9	2620.3
165°	2653.6	2641.9	2647.8	2661.5	2647.8
167.5°	2675.2	2663.4	2669.3	2683.1	2665.4
170°	2692.9	2681.0	2684.9	2698.7	2681.0
172.5°	2704.6	2692.9	2696.8	2710.5	2692.9
175°	2714.3	2700.5	2704.6	2718.2	2698.7
177.5°	2718.2	2704.6	2706.6	2720.3	2702.7
180°	2708.5	2708.5	2708.5	2708.5	2708.5

TEST NUMBER: P922441

CATALOG NUMBER: DFN2DIP-PN4F0-090D090US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.14	11.01	11.10	11.98	13.25	9.70	10.57	10.66	11.54	12.81
	3H	11.81	12.58	12.78	13.56	14.86	11.32	12.10	12.29	13.08	14.37
	4H	12.40	13.13	13.38	14.11	15.42	11.91	12.64	12.89	13.63	14.93
	6H	12.80	13.47	13.79	14.46	15.78	12.31	12.98	13.30	13.97	15.29
	8H	12.91	13.55	13.90	14.55	15.87	12.41	13.05	13.41	14.06	15.37
	12H	12.96	13.57	13.96	14.57	15.90	12.46	13.07	13.46	14.07	15.40
4H	2H	10.61	11.34	11.59	12.32	13.62	10.25	10.99	11.24	11.97	13.27
	3H	12.48	13.09	13.47	14.10	15.42	12.07	12.68	13.07	13.70	15.01
	4H	13.19	13.75	14.20	14.76	16.10	12.77	13.33	13.78	14.34	15.68
	6H	13.71	14.19	14.73	15.22	16.56	13.29	13.77	14.30	14.80	16.13
	8H	13.86	14.31	14.88	15.33	16.68	13.43	13.88	14.45	14.91	16.26
	12H	13.94	14.34	14.97	15.38	16.74	13.50	13.90	14.53	14.94	16.30
8H	4H	13.39	13.84	14.41	14.86	16.21	13.02	13.47	14.04	14.49	15.84
	6H	14.02	14.39	15.07	15.46	16.81	13.65	14.02	14.69	15.08	16.43
	8H	14.25	14.57	15.30	15.62	16.99	13.86	14.19	14.91	15.24	16.61
	12H	14.38	14.67	15.43	15.71	17.12	13.98	14.27	15.03	15.31	16.72
12H	4H	13.37	13.78	14.41	14.82	16.18	13.01	13.42	14.05	14.46	15.81
	6H	14.05	14.38	15.10	15.43	16.80	13.69	14.02	14.74	15.07	16.43
	8H	14.30	14.59	15.35	15.63	17.04	13.93	14.21	14.98	15.26	16.67