

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922473

Luminaire Tested: DFN2DIP-PN4F0-100D080US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922473
REPORT IS A COMBINATION OF REPORTS P901213 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-100D080US940-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15890.3 lumens
Efficiency: N/A
Efficacy: 100.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 158.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922473

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US940-FLLONL

Luminous Intensity Polar Plot

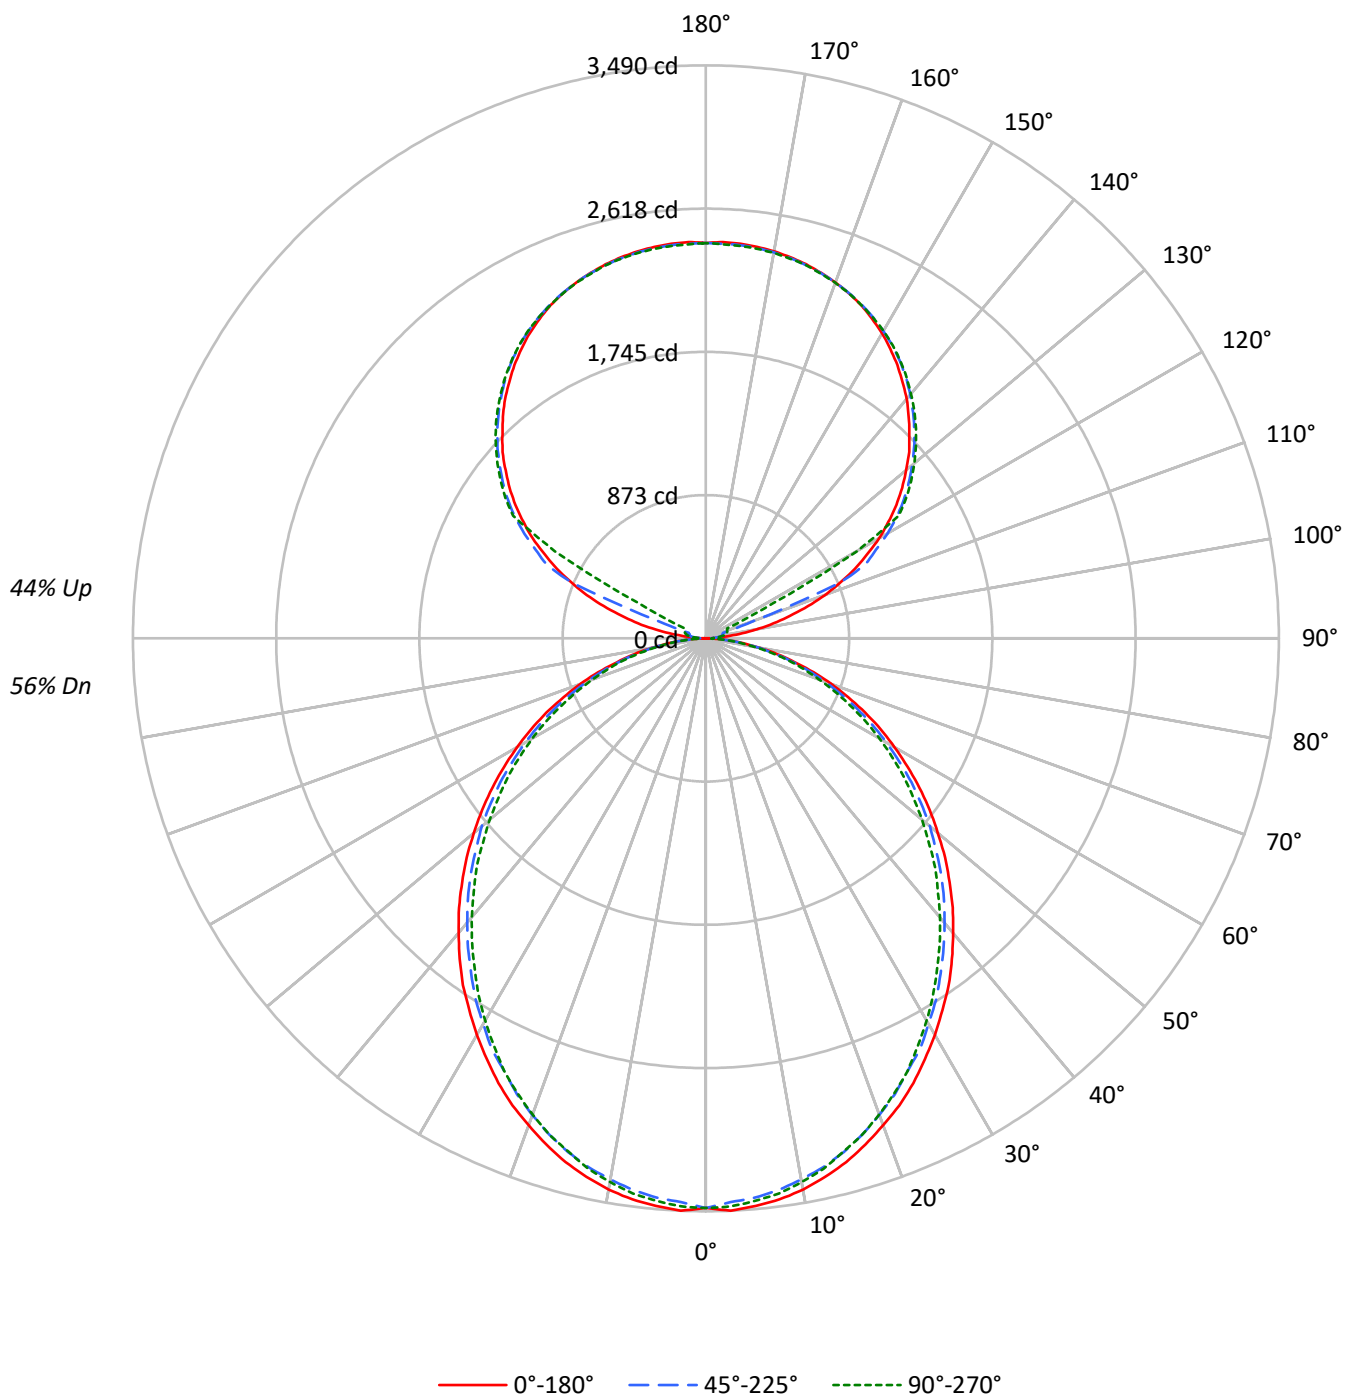

TEST NUMBER: P922473

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	108	108	108	108		101	101	101	101		86	86	86		73	73	73		61	61	61
1	99	95	91	87		92	88	85	82		76	73	71		65	63	61		54	53	52
2	90	83	76	71		84	77	72	67		66	62	59		57	54	51		48	46	44
3	82	73	65	59		76	68	61	56		59	54	50		50	46	43		42	39	37
4	75	64	56	50		70	60	53	48		52	47	42		45	40	37		38	35	32
5	69	57	49	43		64	54	46	41		47	41	36		40	36	32		34	31	28
6	64	52	43	37		59	48	41	36		42	36	32		36	32	28		31	27	25
7	59	47	39	33		55	44	36	31		38	32	28		33	28	25		28	25	22
8	55	42	34	29		51	40	33	28		35	29	25		30	26	22		26	22	20
9	51	39	31	26		47	36	29	25		32	26	22		28	23	20		24	20	18
10	48	35	28	23		44	33	27	22		29	24	20		26	21	18		22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2533	2533	2533
5°	2537	2498	2515
10°	2516	2464	2481
15°	2479	2424	2428
20°	2429	2368	2374
25°	2380	2301	2312
30°	2317	2239	2232
35°	2258	2165	2148
40°	2185	2091	2068
45°	2113	2016	1986
50°	2034	1938	1891
55°	1951	1848	1804
60°	1857	1740	1704
65°	1754	1629	1586
70°	1624	1493	1460
75°	1444	1331	1344
80°	1227	1125	1120
85°	887	768	749

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2113 cd/sqm

TEST NUMBER: P922473

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	326.6	2.1
10°-20°	918.8	5.8
20°-30°	1350.3	8.5
30°-40°	1568.3	9.9
40°-50°	1566.4	9.9
50°-60°	1365.8	8.6
60°-70°	1009.7	6.4
70°-80°	571.3	3.6
80°-90°	155.0	1.0
90°-100°	79.4	0.5
100°-110°	295.9	1.9
110°-120°	784.9	4.9
120°-130°	1301.8	8.2
130°-140°	1382.8	8.7
140°-150°	1285.1	8.1
150°-160°	1033.2	6.5
160°-170°	665.8	4.2
170°-180°	229.2	1.4
0°-30°	2595.7	16.3
0°-40°	4164.0	26.2
0°-60°	7096.2	44.7
0°-90°	8832.2	55.6
90°-120°	1160.2	7.3
90°-150°	5129.9	32.3
90°-180°	7058.0	44.4
0°-180°	15890.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3470	3470	3470	3470	3470	
5°	3470	3457	3420	3446	3440	329
15°	3303	3283	3240	3253	3236	930
25°	2989	2963	2906	2912	2906	1376
35°	2579	2546	2492	2472	2456	1611
45°	2099	2075	2025	1989	1975	1620
55°	1588	1568	1528	1488	1472	1420
65°	1071	1051	1018	988	971	1059
75°	560	554	537	517	524	598
85°	137	134	130	120	117	152
90°	2	21	35	44	47	15
95°	113	56	68	77	75	134
105°	530	582	106	125	132	566
115°	1002	1031	1075	268	143	986
125°	1416	1439	1472	1484	1489	1263
135°	1753	1780	1796	1814	1810	1354
145°	2033	2031	2061	2073	2064	1272
155°	2238	2223	2244	2254	2240	1032
165°	2359	2348	2354	2366	2354	666
175°	2413	2400	2404	2416	2399	230
180°	2408	2408	2408	2408	2408	

TEST NUMBER: P922473

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3469.7	3469.7	3469.7	3469.7	3469.7
2.5°	3489.9	3473.2	3436.4	3469.7	3463.3
5°	3469.7	3456.6	3419.8	3446.4	3440.0
7.5°	3446.4	3426.5	3389.7	3416.6	3409.9
10°	3409.9	3386.5	3346.5	3373.1	3363.2
12.5°	3359.6	3339.8	3299.8	3316.4	3309.7
15°	3303.0	3283.2	3239.6	3253.0	3236.5
17.5°	3232.9	3213.1	3169.5	3186.2	3169.5
20°	3156.0	3136.2	3089.5	3099.4	3086.3
22.5°	3079.6	3049.6	3006.0	3006.0	2999.3
25°	2989.4	2962.8	2906.2	2912.5	2906.2
27.5°	2889.1	2865.8	2822.6	2812.7	2796.0
30°	2789.4	2762.4	2712.5	2702.6	2689.1
32.5°	2682.4	2662.6	2609.1	2589.0	2575.5
35°	2579.1	2545.8	2492.3	2472.2	2455.5
37.5°	2462.3	2432.1	2378.7	2355.4	2338.7
40°	2342.3	2315.3	2261.9	2232.2	2218.8
42.5°	2225.4	2198.5	2145.5	2111.8	2092.0
45°	2098.7	2075.4	2025.1	1988.6	1975.2
47.5°	1975.2	1951.9	1898.4	1861.5	1841.7
50°	1844.9	1828.3	1781.5	1734.8	1718.2
52.5°	1718.2	1694.9	1651.6	1614.9	1591.5
55°	1588.3	1568.2	1528.1	1488.1	1471.5
57.5°	1458.0	1441.4	1397.8	1357.9	1344.4
60°	1327.8	1314.6	1267.9	1231.1	1221.2
62.5°	1201.0	1177.7	1144.4	1111.2	1097.7
65°	1071.1	1051.0	1017.7	987.6	971.0
67.5°	937.7	920.7	891.0	867.6	854.2
70°	814.1	800.7	770.6	747.3	734.1
72.5°	687.4	674.0	657.4	634.0	624.0
75°	560.4	554.0	537.0	517.2	523.9
77.5°	447.1	433.6	426.9	417.0	407.1
80°	333.8	330.3	323.5	313.6	306.9
82.5°	226.9	226.9	223.7	210.3	210.3
85°	136.6	133.5	130.3	120.0	116.8
87.5°	60.2	53.4	46.7	36.8	33.3
90°	1.7	20.9	34.8	43.6	47.0
92.5°	43.6	36.6	41.8	45.3	47.0
95°	113.2	55.6	67.9	76.8	74.9
97.5°	203.8	61.0	88.7	94.2	95.8
100°	308.4	69.7	99.3	113.2	116.6
102.5°	423.3	419.9	102.8	121.8	127.2
105°	529.6	581.9	106.3	125.4	132.4
107.5°	653.3	696.7	109.9	128.9	135.9
110°	771.9	808.2	305.0	130.7	137.6



TEST NUMBER: P922473

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	883.3	914.5	885.0	134.0	139.5
115°	1001.7	1031.3	1074.9	268.3	142.9
117.5°	1104.5	1139.2	1169.0	919.7	463.4
120°	1219.5	1245.5	1277.0	1297.9	1062.7
122.5°	1316.9	1344.9	1379.8	1390.2	1392.0
125°	1416.2	1439.0	1472.0	1484.3	1489.4
127.5°	1506.8	1531.2	1557.6	1574.8	1576.5
130°	1592.2	1620.1	1639.2	1658.5	1656.8
132.5°	1679.4	1702.1	1721.2	1736.9	1735.2
135°	1752.6	1780.5	1796.0	1813.6	1810.1
137.5°	1829.2	1850.0	1867.6	1885.0	1879.8
140°	1904.0	1918.1	1937.2	1952.8	1944.1
142.5°	1966.9	1979.1	2001.6	2015.5	2006.8
145°	2033.1	2031.2	2060.8	2073.0	2064.3
147.5°	2090.4	2085.3	2114.8	2123.5	2116.7
150°	2146.3	2134.0	2162.0	2172.3	2163.6
152.5°	2193.3	2179.3	2205.4	2216.0	2203.8
155°	2238.5	2223.0	2243.9	2254.2	2240.4
157.5°	2275.1	2261.3	2277.0	2289.2	2275.1
160°	2306.6	2296.1	2306.6	2316.9	2304.7
162.5°	2334.3	2324.0	2332.6	2344.8	2329.1
165°	2358.8	2348.4	2353.6	2365.7	2353.6
167.5°	2377.9	2367.4	2372.8	2385.0	2369.3
170°	2393.7	2383.1	2386.7	2398.9	2383.1
172.5°	2404.1	2393.7	2397.2	2409.4	2393.7
175°	2412.7	2400.5	2404.1	2416.2	2398.9
177.5°	2416.2	2404.1	2405.8	2418.1	2402.4
180°	2407.5	2407.5	2407.5	2407.5	2407.5

TEST NUMBER: P922473

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.01	11.92	11.92	12.85	14.04	10.57	11.48	11.48	12.41	13.60
	3H	12.68	13.50	13.59	14.43	15.64	12.19	13.01	13.11	13.95	15.16
	4H	13.27	14.04	14.20	14.98	16.21	12.78	13.56	13.71	14.50	15.72
	6H	13.67	14.39	14.62	15.33	16.57	13.18	13.90	14.13	14.84	16.08
	8H	13.78	14.46	14.73	15.42	16.66	13.29	13.97	14.24	14.93	16.17
	12H	13.83	14.48	14.79	15.44	16.70	13.33	13.98	14.29	14.94	16.20
4H	2H	11.48	12.25	12.42	13.19	14.42	11.12	11.90	12.06	12.84	14.06
	3H	13.35	14.00	14.30	14.97	16.21	12.95	13.59	13.90	14.57	15.80
	4H	14.07	14.66	15.03	15.63	16.89	13.65	14.24	14.61	15.21	16.47
	6H	14.59	15.10	15.56	16.09	17.35	14.17	14.68	15.14	15.66	16.93
	8H	14.74	15.22	15.72	16.20	17.48	14.31	14.79	15.29	15.77	17.05
	12H	14.82	15.25	15.81	16.25	17.53	14.38	14.81	15.37	15.81	17.09
8H	4H	14.27	14.75	15.24	15.73	17.00	13.90	14.38	14.87	15.36	16.63
	6H	14.91	15.30	15.91	16.33	17.60	14.53	14.92	15.53	15.95	17.22
	8H	15.13	15.48	16.14	16.49	17.78	14.75	15.09	15.75	16.11	17.40
	12H	15.27	15.57	16.28	16.58	17.92	14.86	15.17	15.88	16.18	17.51
12H	4H	14.26	14.69	15.25	15.69	16.97	13.90	14.33	14.89	15.33	16.61
	6H	14.94	15.29	15.95	16.30	17.59	14.57	14.92	15.58	15.93	17.22
	8H	15.18	15.49	16.20	16.50	17.83	14.81	15.12	15.82	16.12	17.46

END OF REPORT