

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922481

Luminaire Tested: DFN2DIP-PN4F0-100D100US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922481
REPORT IS A COMBINATION OF REPORTS P901249 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-100D100US940-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17655.9 lumens
Efficiency: N/A
Efficacy: 100.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 175.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922481

CATALOG NUMBER: DFN2DIP-PN4F0-100D100US940-FLLONL

Luminous Intensity Polar Plot

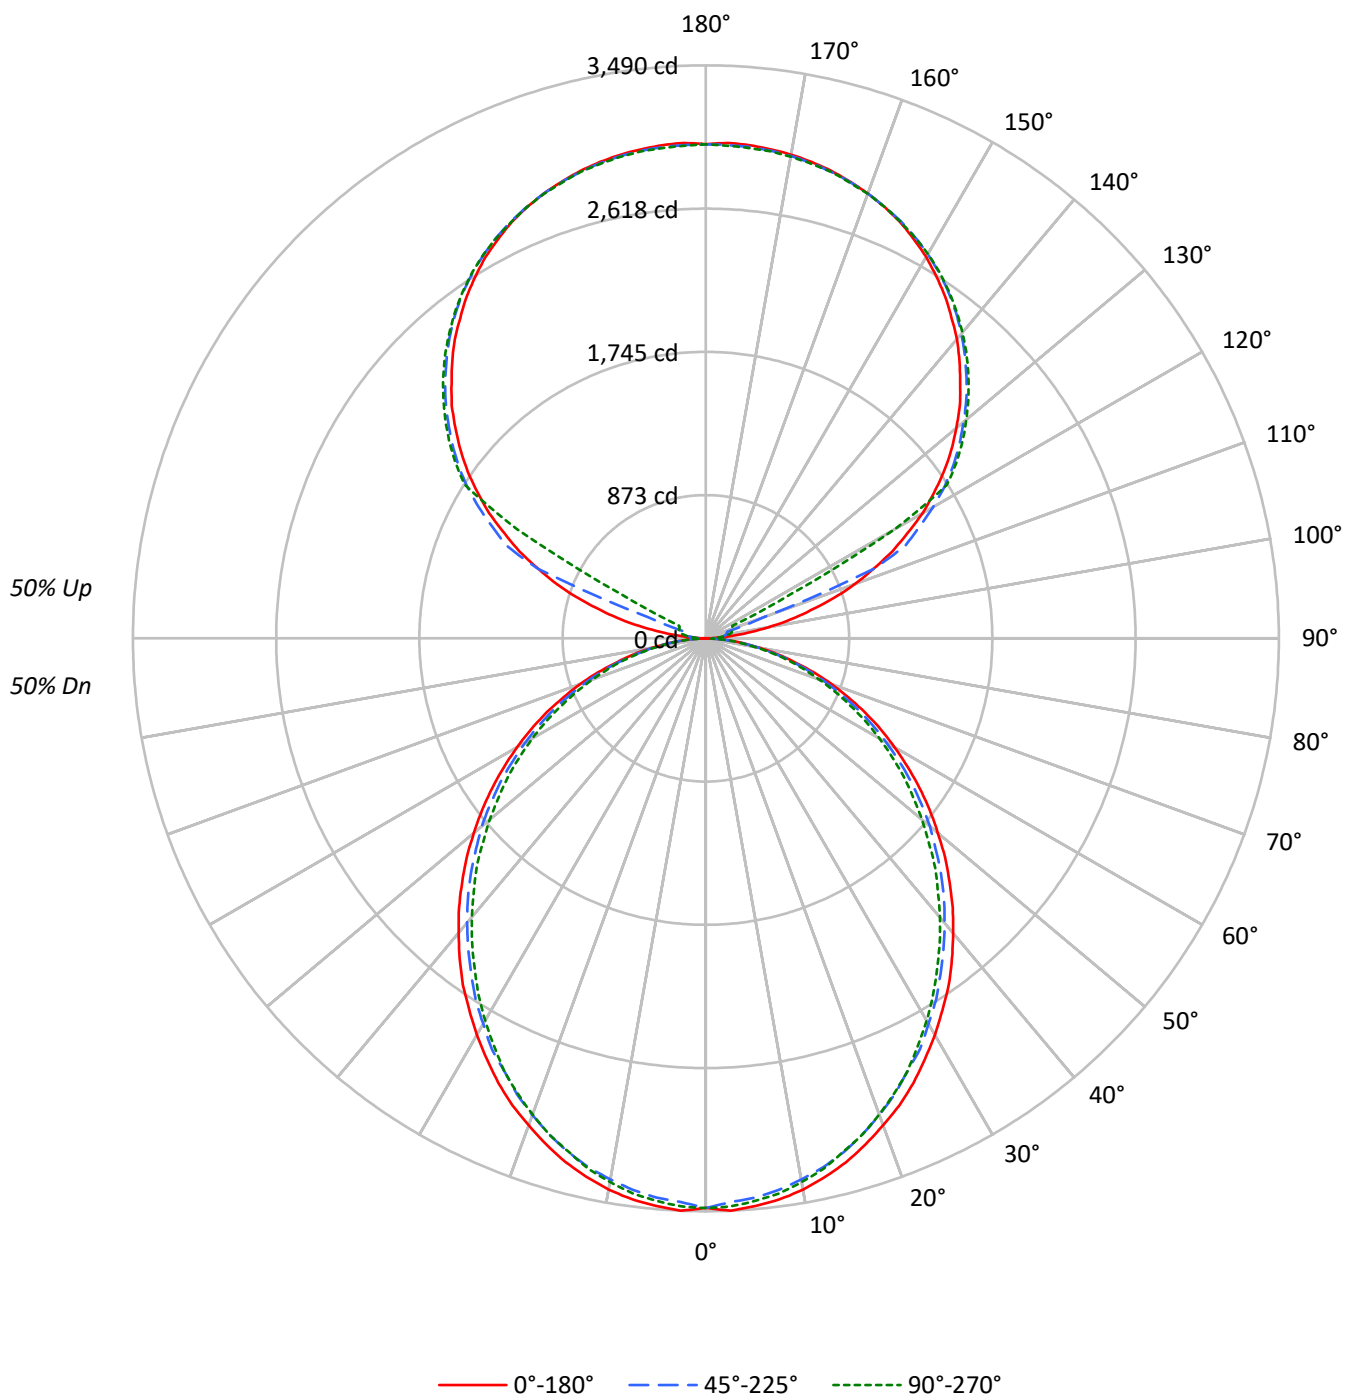

TEST NUMBER: P922481

CATALOG NUMBER: DFN2DIP-PN4F0-100D100US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2533	2533	2533
5°	2537	2498	2515
10°	2516	2464	2481
15°	2479	2424	2428
20°	2429	2368	2374
25°	2380	2301	2312
30°	2317	2239	2232
35°	2258	2165	2148
40°	2185	2091	2068
45°	2113	2016	1986
50°	2034	1938	1891
55°	1951	1848	1804
60°	1857	1740	1704
65°	1754	1629	1586
70°	1624	1493	1460
75°	1444	1331	1344
80°	1227	1125	1120
85°	887	768	749

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2113 cd/sqm

TEST NUMBER: P922481

CATALOG NUMBER: DFN2DIP-PN4F0-100D100US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	326.6	1.8
10°-20°	918.8	5.2
20°-30°	1350.3	7.6
30°-40°	1568.3	8.9
40°-50°	1566.4	8.9
50°-60°	1365.8	7.7
60°-70°	1009.7	5.7
70°-80°	571.3	3.2
80°-90°	156.1	0.9
90°-100°	99.2	0.6
100°-110°	369.9	2.1
110°-120°	981.1	5.6
120°-130°	1627.2	9.2
130°-140°	1728.5	9.8
140°-150°	1606.5	9.1
150°-160°	1291.5	7.3
160°-170°	832.2	4.7
170°-180°	286.4	1.6
0°-30°	2595.7	14.7
0°-40°	4164.0	23.6
0°-60°	7096.2	40.2
0°-90°	8833.2	50.0
90°-120°	1450.3	8.2
90°-150°	6412.5	36.3
90°-180°	8823.0	50.0
0°-180°	17655.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3470	3470	3470	3470	3470	
5°	3470	3457	3420	3446	3440	329
15°	3303	3283	3240	3253	3236	930
25°	2989	2963	2906	2912	2906	1376
35°	2579	2546	2492	2472	2456	1611
45°	2099	2075	2025	1989	1975	1620
55°	1588	1568	1528	1488	1472	1420
65°	1071	1051	1018	988	971	1059
75°	560	554	537	517	524	598
85°	137	134	130	120	117	152
90°	2	26	43	55	59	16
95°	141	70	85	96	94	168
105°	662	727	133	157	166	707
115°	1252	1289	1344	335	179	1233
125°	1770	1799	1840	1855	1862	1579
135°	2191	2226	2245	2267	2263	1692
145°	2541	2539	2576	2591	2580	1589
155°	2798	2779	2805	2818	2800	1289
165°	2948	2935	2942	2957	2942	833
175°	3016	3001	3005	3020	2999	287
180°	3009	3009	3009	3009	3009	

TEST NUMBER: P922481

CATALOG NUMBER: DFN2DIP-PN4F0-100D100US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3469.7	3469.7	3469.7	3469.7	3469.7
2.5°	3489.9	3473.2	3436.4	3469.7	3463.3
5°	3469.7	3456.6	3419.8	3446.4	3440.0
7.5°	3446.4	3426.5	3389.7	3416.6	3409.9
10°	3409.9	3386.5	3346.5	3373.1	3363.2
12.5°	3359.6	3339.8	3299.8	3316.4	3309.7
15°	3303.0	3283.2	3239.6	3253.0	3236.5
17.5°	3232.9	3213.1	3169.5	3186.2	3169.5
20°	3156.0	3136.2	3089.5	3099.4	3086.3
22.5°	3079.6	3049.6	3006.0	3006.0	2999.3
25°	2989.4	2962.8	2906.2	2912.5	2906.2
27.5°	2889.1	2865.8	2822.6	2812.7	2796.0
30°	2789.4	2762.4	2712.5	2702.6	2689.1
32.5°	2682.4	2662.6	2609.1	2589.0	2575.5
35°	2579.1	2545.8	2492.3	2472.2	2455.5
37.5°	2462.3	2432.1	2378.7	2355.4	2338.7
40°	2342.3	2315.3	2261.9	2232.2	2218.8
42.5°	2225.4	2198.5	2145.5	2111.8	2092.0
45°	2098.7	2075.4	2025.1	1988.6	1975.2
47.5°	1975.2	1951.9	1898.4	1861.5	1841.7
50°	1844.9	1828.3	1781.5	1734.8	1718.2
52.5°	1718.2	1694.9	1651.6	1614.9	1591.5
55°	1588.3	1568.2	1528.1	1488.1	1471.5
57.5°	1458.0	1441.4	1397.8	1357.9	1344.4
60°	1327.8	1314.6	1267.9	1231.1	1221.2
62.5°	1201.0	1177.7	1144.4	1111.2	1097.7
65°	1071.1	1051.0	1017.7	987.6	971.0
67.5°	937.7	920.7	891.0	867.6	854.2
70°	814.1	800.7	770.6	747.3	734.1
72.5°	687.4	674.0	657.4	634.0	624.0
75°	560.4	554.0	537.0	517.2	523.9
77.5°	447.1	433.6	426.9	417.0	407.1
80°	333.8	330.3	323.5	313.6	306.9
82.5°	226.9	226.9	223.7	210.3	210.3
85°	136.6	133.5	130.3	120.0	116.8
87.5°	60.2	53.4	46.7	36.8	33.3
90°	2.1	26.1	43.4	54.6	58.7
92.5°	54.6	45.7	52.3	56.6	58.7
95°	141.4	69.6	84.8	95.9	93.6
97.5°	254.7	76.2	110.9	117.6	119.8
100°	385.6	87.1	124.1	141.4	145.9
102.5°	529.1	524.9	128.5	152.3	159.0
105°	662.0	727.4	133.0	156.7	165.5
107.5°	816.6	870.9	137.3	161.1	169.9
110°	964.7	1010.3	381.1	163.5	171.9

TEST NUMBER: P922481

CATALOG NUMBER: DFN2DIP-PN4F0-100D100US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1104.1	1143.2	1106.3	167.6	174.3
115°	1252.1	1289.1	1343.6	335.4	178.7
117.5°	1380.5	1424.1	1461.2	1149.7	579.3
120°	1524.4	1556.9	1596.3	1622.4	1328.4
122.5°	1646.2	1681.1	1724.7	1737.7	1740.0
125°	1770.3	1798.8	1840.1	1855.4	1861.8
127.5°	1883.6	1914.1	1946.9	1968.6	1970.7
130°	1990.3	2025.3	2049.1	2073.0	2071.0
132.5°	2099.2	2127.6	2151.4	2171.0	2169.0
135°	2190.8	2225.6	2245.1	2267.0	2262.6
137.5°	2286.4	2312.6	2334.5	2356.3	2349.7
140°	2380.0	2397.6	2421.4	2441.1	2430.2
142.5°	2458.6	2473.9	2502.1	2519.3	2508.6
145°	2541.4	2539.1	2576.1	2591.3	2580.4
147.5°	2613.0	2606.6	2643.5	2654.4	2645.9
150°	2682.8	2667.6	2702.5	2715.4	2704.6
152.5°	2741.5	2724.2	2756.8	2769.9	2754.7
155°	2798.2	2778.7	2804.9	2817.8	2800.5
157.5°	2843.9	2826.6	2846.3	2861.5	2843.9
160°	2883.3	2870.1	2883.3	2896.2	2880.9
162.5°	2917.9	2904.9	2915.8	2931.1	2911.4
165°	2948.4	2935.4	2941.9	2957.2	2941.9
167.5°	2972.4	2959.2	2966.0	2981.3	2961.5
170°	2992.0	2978.9	2983.3	2998.6	2978.9
172.5°	3005.0	2992.0	2996.5	3011.8	2992.0
175°	3015.9	3000.6	3005.0	3020.3	2998.6
177.5°	3020.3	3005.0	3007.4	3022.6	3002.9
180°	3009.4	3009.4	3009.4	3009.4	3009.4

TEST NUMBER: P922481

CATALOG NUMBER: DFN2DIP-PN4F0-100D100US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.51	11.37	11.47	12.34	13.62	10.07	10.93	11.03	11.90	13.18
	3H	12.17	12.95	13.14	13.93	15.22	11.69	12.46	12.66	13.44	14.74
	4H	12.76	13.49	13.75	14.48	15.78	12.28	13.01	13.26	13.99	15.29
	6H	13.17	13.84	14.16	14.83	16.14	12.67	13.35	13.67	14.34	15.65
	8H	13.27	13.91	14.27	14.92	16.23	12.78	13.42	13.78	14.43	15.74
	12H	13.32	13.93	14.33	14.93	16.27	12.82	13.43	13.83	14.43	15.77
4H	2H	10.97	11.70	11.96	12.69	13.99	10.62	11.35	11.61	12.34	13.64
	3H	12.84	13.45	13.84	14.47	15.78	12.44	13.05	13.44	14.06	15.38
	4H	13.56	14.12	14.56	15.12	16.46	13.14	13.70	14.15	14.71	16.04
	6H	14.08	14.56	15.09	15.59	16.92	13.65	14.13	14.67	15.16	16.50
	8H	14.23	14.68	15.25	15.70	17.05	13.80	14.25	14.82	15.27	16.62
	12H	14.30	14.71	15.34	15.75	17.10	13.86	14.27	14.90	15.31	16.66
8H	4H	13.75	14.20	14.77	15.23	16.58	13.38	13.83	14.40	14.86	16.21
	6H	14.39	14.76	15.43	15.83	17.18	14.01	14.38	15.06	15.45	16.80
	8H	14.61	14.94	15.66	15.99	17.36	14.23	14.55	15.28	15.61	16.97
	12H	14.75	15.03	15.80	16.08	17.49	14.34	14.63	15.40	15.68	17.09
12H	4H	13.74	14.15	14.78	15.19	16.54	13.38	13.78	14.41	14.82	16.18
	6H	14.42	14.75	15.47	15.80	17.17	14.05	14.38	15.10	15.43	16.80
	8H	14.66	14.95	15.72	16.00	17.41	14.29	14.58	15.35	15.63	17.04

END OF REPORT