

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925022

Luminaire Tested: DFN2DIP-PN4F0-050D080US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925022
REPORT IS A COMBINATION OF REPORTS P899684 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-050D080US950-RLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10808.9 lumens
Efficiency: N/A
Efficacy: 106.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 102
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925022

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US950-RLLFLL

Luminous Intensity Polar Plot

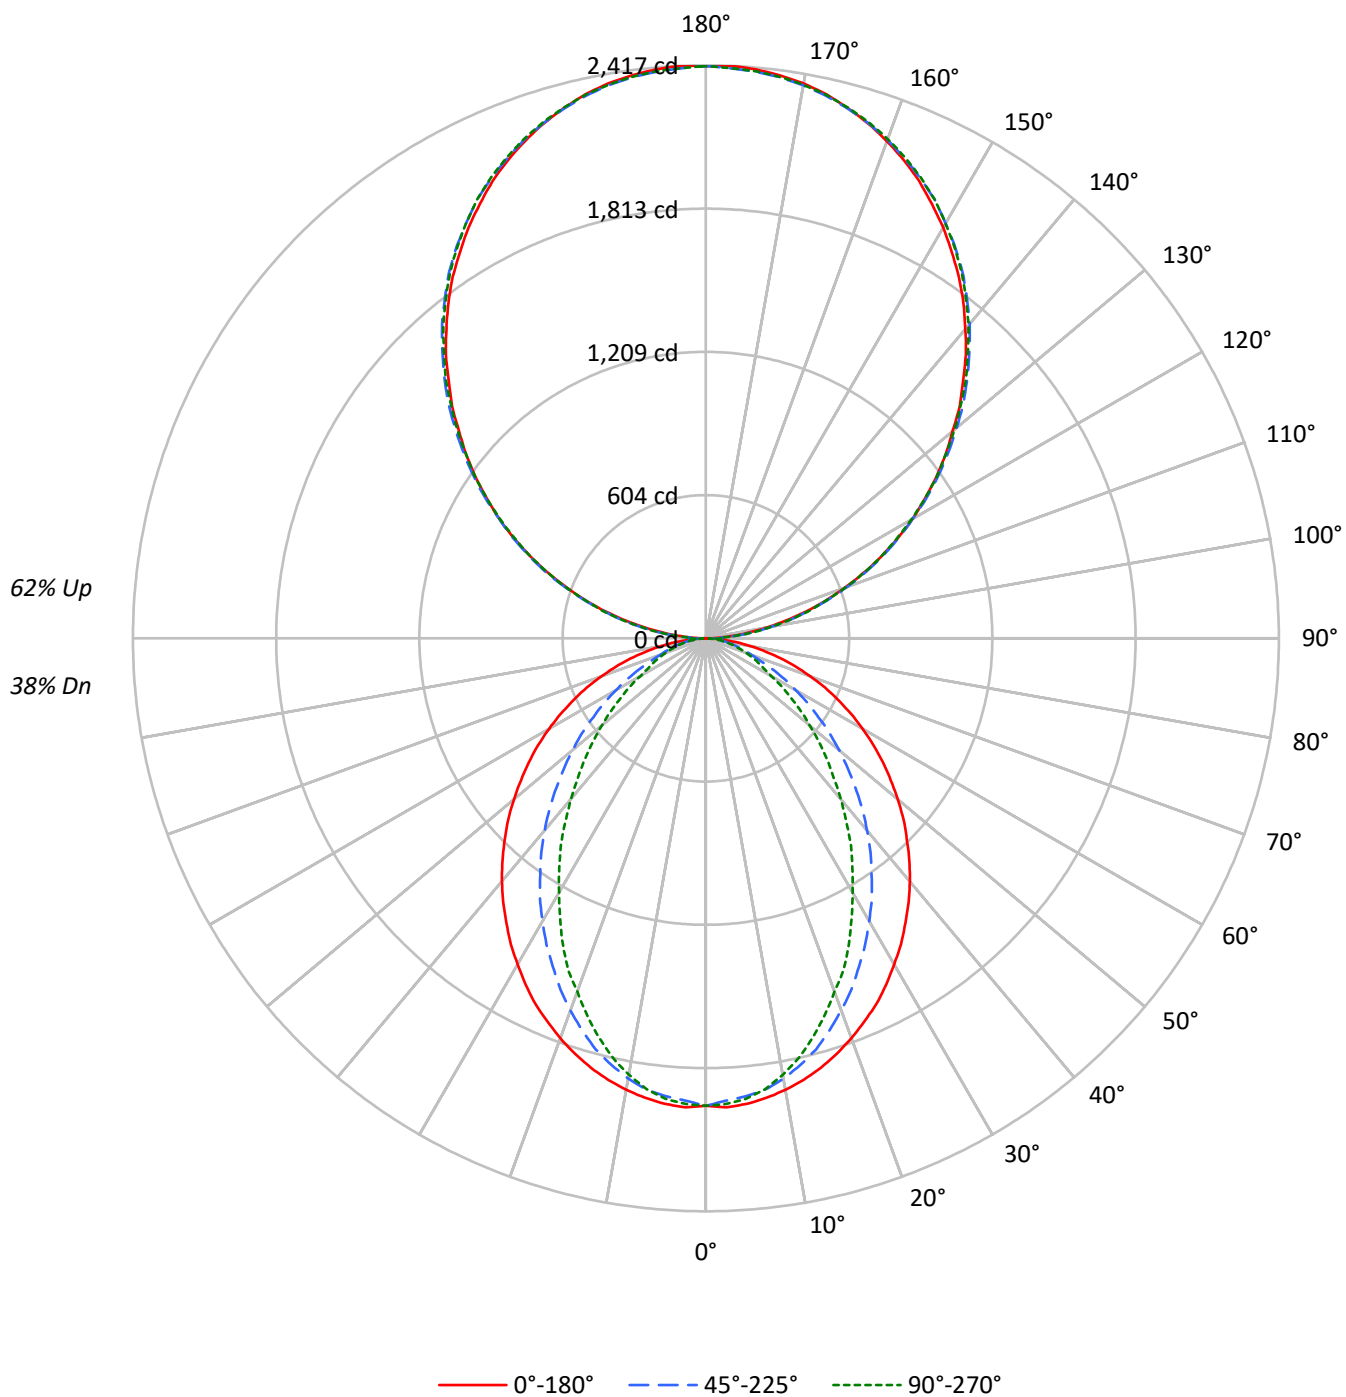

TEST NUMBER: P925022

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	76	76	76	60	60	60	45	45	45
1	95	91	88	84	86	83	80	77	67	65	63	53	52	50	40	39	38
2	87	80	74	69	79	73	68	64	59	56	53	47	45	43	36	34	33
3	80	71	64	58	72	64	58	54	53	48	45	42	39	37	32	30	28
4	73	63	55	49	66	57	51	46	47	42	39	38	34	32	29	27	25
5	67	56	48	42	61	51	44	39	42	37	33	34	30	28	26	24	22
6	62	50	42	37	56	46	39	34	38	33	29	31	27	24	24	21	19
7	57	45	38	32	52	42	35	30	35	30	26	28	24	22	22	19	17
8	53	41	34	29	48	38	31	27	32	27	23	26	22	19	20	18	16
9	49	38	30	26	45	35	28	24	29	24	21	24	20	17	19	16	14
10	46	35	28	23	42	32	26	21	27	22	19	22	18	16	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1439	1439	1439
5°	1441	1416	1426
10°	1427	1389	1379
15°	1407	1343	1308
20°	1382	1280	1220
25°	1355	1209	1135
30°	1319	1137	1028
35°	1284	1059	933
40°	1248	978	825
45°	1207	888	726
50°	1164	798	630
55°	1120	701	538
60°	1068	600	443
65°	1008	497	399
70°	936	401	362
75°	846	354	330
80°	714	298	287
85°	498	200	218

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1892 cd/sqm

TEST NUMBER: P925022

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US950-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	1.7
10°-20°	507.2	4.7
20°-30°	712.1	6.6
30°-40°	776.3	7.2
40°-50°	713.5	6.6
50°-60°	560.3	5.2
60°-70°	364.7	3.4
70°-80°	187.7	1.7
80°-90°	54.8	0.5
90°-100°	149.4	1.4
100°-110°	474.6	4.4
110°-120°	812.1	7.5
120°-130°	1068.1	9.9
130°-140°	1198.9	11.1
140°-150°	1175.6	10.9
150°-160°	986.2	9.1
160°-170°	654.0	6.1
170°-180°	228.6	2.1
0°-30°	1404.1	13.0
0°-40°	2180.4	20.2
0°-60°	3454.1	32.0
0°-90°	4061.4	37.6
90°-120°	1436.1	13.3
90°-150°	4878.6	45.1
90°-180°	6747.0	62.4
0°-180°	10808.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	2	26	71	67	69	11
95°	106	127	130	130	127	118
105°	438	444	448	452	452	462
115°	815	827	823	821	815	806
125°	1185	1204	1198	1191	1189	1059
135°	1533	1556	1560	1558	1552	1185
145°	1861	1876	1888	1890	1882	1163
155°	2128	2134	2141	2151	2144	980
165°	2316	2313	2313	2328	2318	653
175°	2409	2404	2399	2414	2401	229
180°	2414	2414	2414	2414	2414	

TEST NUMBER: P925022

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	2.2	26.2	71.4	67.0	69.2
92.5°	45.1	61.2	63.3	65.4	65.4
95°	106.3	126.6	130.2	130.2	126.6
97.5°	176.9	195.8	203.8	203.8	203.8
100°	258.3	275.0	280.9	280.9	278.7
102.5°	344.2	356.6	364.5	366.7	364.5
105°	438.1	443.9	448.3	451.9	451.9
107.5°	531.2	540.0	540.0	541.4	531.2
110°	621.4	633.1	633.1	633.1	627.3

TEST NUMBER: P925022

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	718.9	731.3	729.1	723.3	718.9
115°	815.0	826.6	823.0	820.8	815.0
117.5°	910.3	926.3	916.1	910.3	904.5
120°	1006.4	1022.4	1006.4	1006.4	999.8
122.5°	1093.7	1114.1	1103.9	1098.1	1093.7
125°	1185.3	1203.6	1197.7	1191.2	1189.1
127.5°	1274.9	1297.4	1289.4	1280.7	1274.9
130°	1358.6	1384.7	1381.1	1376.8	1368.8
132.5°	1452.5	1472.8	1474.3	1464.1	1458.3
135°	1533.2	1555.8	1560.2	1558.0	1552.2
137.5°	1623.4	1641.6	1645.3	1643.8	1635.1
140°	1702.8	1720.9	1731.1	1731.1	1723.1
142.5°	1784.3	1802.5	1808.3	1810.5	1802.5
145°	1861.4	1875.9	1887.6	1889.8	1881.8
147.5°	1930.5	1948.7	1957.4	1961.1	1953.1
150°	2001.9	2014.2	2022.2	2028.8	2022.2
152.5°	2065.1	2077.5	2087.7	2095.7	2087.7
155°	2128.5	2134.3	2140.9	2151.0	2144.5
157.5°	2183.0	2187.4	2191.1	2205.6	2195.4
160°	2231.8	2236.2	2238.4	2250.7	2242.0
162.5°	2276.9	2276.9	2279.1	2292.9	2282.7
165°	2315.5	2313.3	2313.3	2327.9	2317.6
167.5°	2350.4	2343.9	2343.9	2358.4	2348.2
170°	2376.6	2370.8	2368.6	2383.2	2370.8
172.5°	2394.8	2389.0	2386.8	2401.3	2389.0
175°	2409.3	2403.5	2399.1	2413.7	2401.3
177.5°	2417.3	2411.5	2407.1	2419.5	2407.1
180°	2413.7	2413.7	2413.7	2413.7	2413.7

TEST NUMBER: P925022

CATALOG NUMBER: DFN2DIP-PN4F0-050D080US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.13	7.87	8.20	8.93	10.37	3.10	3.84	4.16	4.90	6.34
	3H	8.81	9.47	9.88	10.54	12.00	4.28	4.94	5.35	6.01	7.47
	4H	9.41	10.04	10.50	11.11	12.58	4.73	5.35	5.81	6.42	7.89
	6H	9.83	10.41	10.92	11.48	12.96	5.04	5.62	6.14	6.69	8.17
	8H	9.96	10.50	11.05	11.60	13.07	5.13	5.68	6.23	6.77	8.24
	12H	10.02	10.54	11.12	11.62	13.12	5.17	5.69	6.27	6.78	8.27
4H	2H	7.14	7.77	8.23	8.84	10.30	3.68	4.31	4.77	5.38	6.85
	3H	8.96	9.48	10.06	10.58	12.06	5.03	5.55	6.12	6.65	8.12
	4H	9.65	10.13	10.76	11.22	12.72	5.57	6.05	6.67	7.14	8.64
	6H	10.17	10.58	11.28	11.69	13.18	5.99	6.39	7.10	7.51	9.00
	8H	10.34	10.72	11.45	11.83	13.34	6.11	6.49	7.22	7.60	9.11
	12H	10.44	10.78	11.56	11.90	13.41	6.17	6.52	7.30	7.64	9.15
8H	4H	9.62	10.00	10.72	11.10	12.61	5.85	6.23	6.96	7.33	8.84
	6H	10.18	10.50	11.31	11.64	13.15	6.36	6.68	7.49	7.82	9.33
	8H	10.40	10.68	11.54	11.80	13.33	6.55	6.83	7.69	7.96	9.48
	12H	10.54	10.78	11.68	11.90	13.46	6.67	6.91	7.81	8.04	9.60
12H	4H	9.56	9.91	10.69	11.03	12.54	5.85	6.19	6.97	7.31	8.82
	6H	10.16	10.43	11.29	11.56	13.08	6.41	6.69	7.55	7.82	9.34
	8H	10.38	10.62	11.52	11.74	13.30	6.62	6.86	7.76	7.98	9.55

END OF REPORT