

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925048

Luminaire Tested: DFN2DIP-PN4F0-060D060US950-FLLFLL

Issue Date: 11/21/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P925048  
REPORT IS A COMBINATION OF REPORTS P899649 AND P896497  
Test Lab: INNOVATION CENTER  
Issue Date: 11/21/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: NEO-RAY  
Catalog Number: DFN2DIP-PN4F0-060D060US950-FLLFLL  
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 10732.5 lumens  
Efficiency: N/A  
Efficacy: 107.6 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29  
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')  
CIE Type: General Diffuse

Input Watts (W): 99.7  
Input Voltage (V):  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: 0.9933  
Total Harmonic Distortion (THDi): 0.066  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P925048

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US950-FLLFLL

### Luminous Intensity Polar Plot

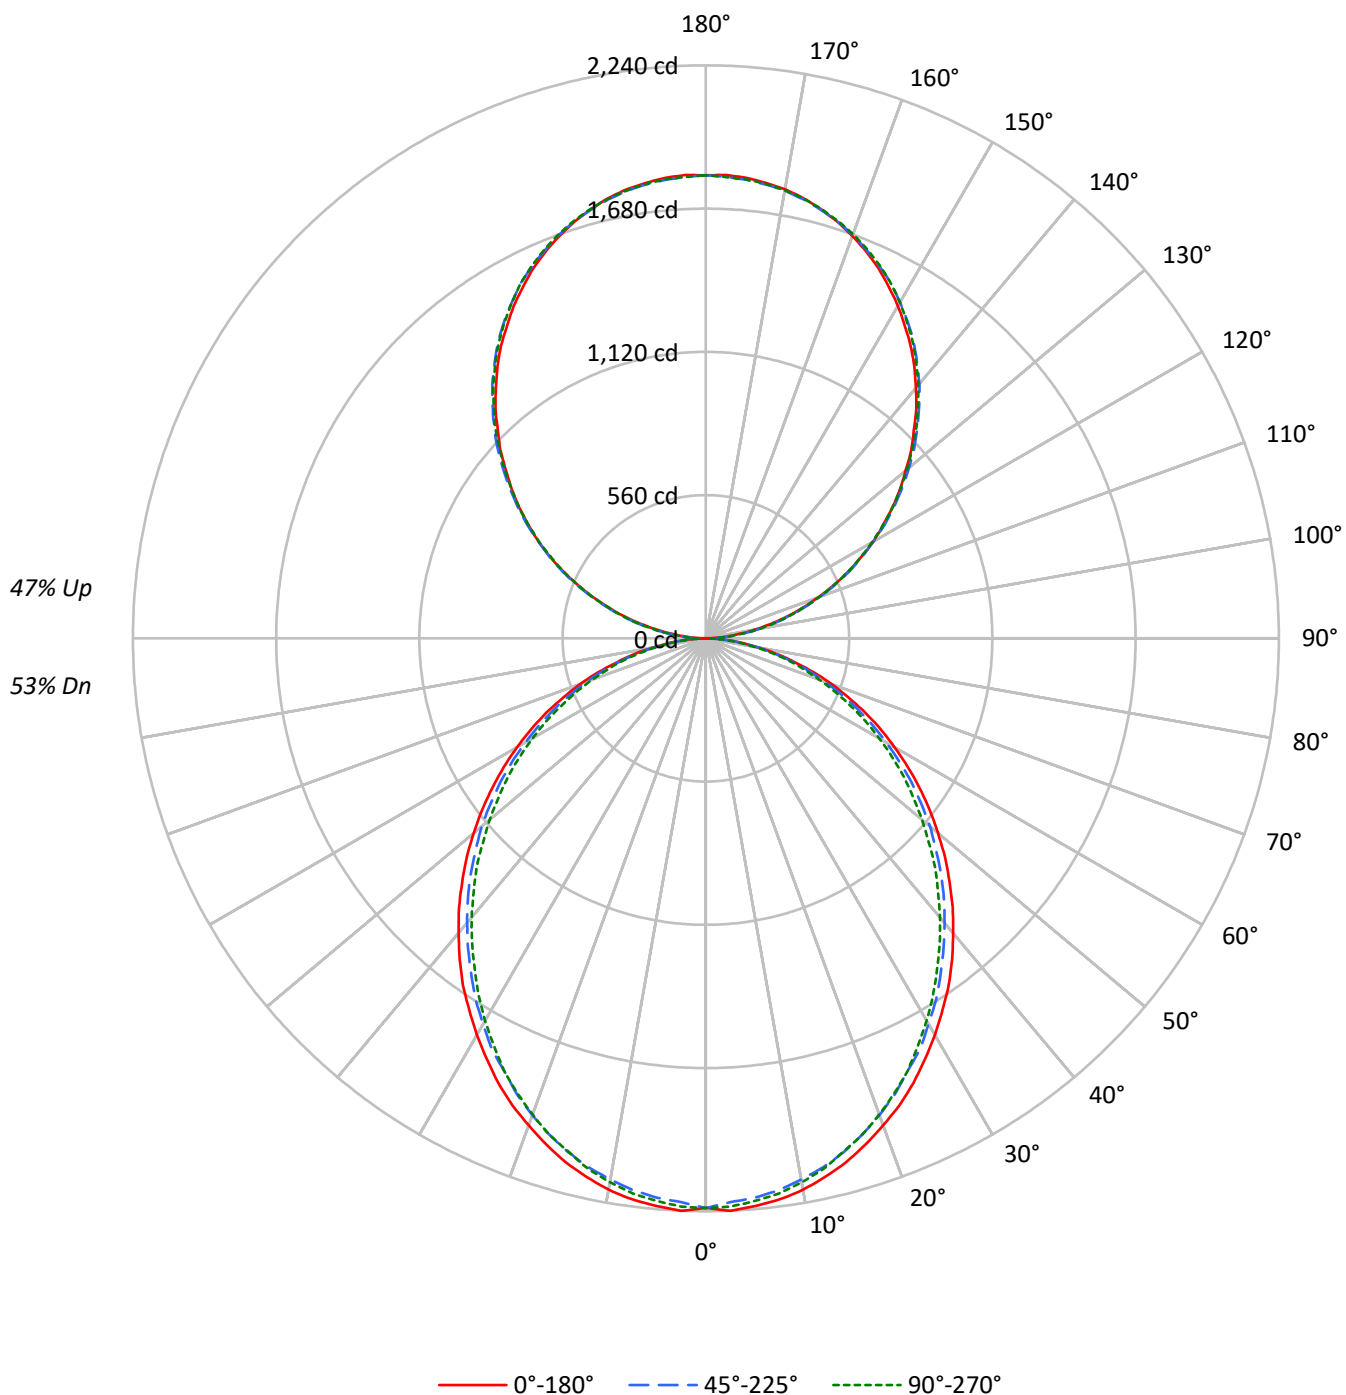

TEST NUMBER: P925048

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US950-FLLFLL

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |    |    |    |    |    |    |    |    |    |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20 |    |    |    | 20 |    |    |    | 20 |
| RC  | 80  |     |     |     | 70  |     |     |     | 50 |    |    |    | 30 |    |    |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 |
| RCR |     |     |     |     |     |     |     |     |    |    |    |    |    |    |    |    |    |
| 0   | 108 | 108 | 108 | 108 | 100 | 100 | 100 | 100 | 85 | 85 | 85 | 71 | 71 | 71 | 59 | 59 | 59 |
| 1   | 98  | 94  | 90  | 87  | 91  | 87  | 84  | 81  | 74 | 72 | 70 | 63 | 61 | 59 | 52 | 51 | 50 |
| 2   | 90  | 82  | 76  | 71  | 83  | 76  | 71  | 66  | 65 | 61 | 58 | 55 | 52 | 50 | 46 | 44 | 42 |
| 3   | 82  | 72  | 65  | 59  | 75  | 67  | 61  | 55  | 58 | 53 | 49 | 49 | 45 | 42 | 41 | 38 | 36 |
| 4   | 75  | 64  | 56  | 50  | 69  | 60  | 52  | 47  | 51 | 46 | 41 | 43 | 39 | 36 | 36 | 33 | 31 |
| 5   | 69  | 57  | 49  | 43  | 63  | 53  | 46  | 40  | 46 | 40 | 36 | 39 | 35 | 31 | 33 | 29 | 27 |
| 6   | 63  | 51  | 43  | 37  | 58  | 48  | 40  | 35  | 41 | 36 | 31 | 35 | 31 | 27 | 30 | 26 | 24 |
| 7   | 59  | 46  | 38  | 33  | 54  | 43  | 36  | 31  | 37 | 32 | 28 | 32 | 28 | 24 | 27 | 24 | 21 |
| 8   | 54  | 42  | 34  | 29  | 50  | 39  | 32  | 27  | 34 | 29 | 24 | 29 | 25 | 22 | 25 | 21 | 19 |
| 9   | 51  | 38  | 31  | 26  | 47  | 36  | 29  | 24  | 31 | 26 | 22 | 27 | 23 | 19 | 23 | 20 | 17 |
| 10  | 47  | 35  | 28  | 23  | 44  | 33  | 26  | 22  | 29 | 23 | 20 | 25 | 21 | 18 | 21 | 18 | 15 |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°   | 45°  | 90°  |
|-----|------|------|------|
| 0°  | 1626 | 1626 | 1626 |
| 5°  | 1628 | 1603 | 1614 |
| 10° | 1615 | 1582 | 1593 |
| 15° | 1591 | 1556 | 1559 |
| 20° | 1559 | 1520 | 1524 |
| 25° | 1527 | 1477 | 1484 |
| 30° | 1487 | 1437 | 1433 |
| 35° | 1450 | 1390 | 1379 |
| 40° | 1403 | 1342 | 1327 |
| 45° | 1356 | 1294 | 1275 |
| 50° | 1305 | 1244 | 1214 |
| 55° | 1252 | 1186 | 1158 |
| 60° | 1192 | 1117 | 1094 |
| 65° | 1126 | 1046 | 1018 |
| 70° | 1043 | 959  | 937  |
| 75° | 927  | 855  | 863  |
| 80° | 787  | 722  | 719  |
| 85° | 569  | 493  | 481  |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1416 cd/sqm

TEST NUMBER: P925048

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US950-FLLFLL

**ZONAL LUMENS:**

| Zone      | Lumens  | % Fixture |
|-----------|---------|-----------|
| 0°-10°    | 209.6   | 2.0       |
| 10°-20°   | 589.8   | 5.5       |
| 20°-30°   | 866.8   | 8.1       |
| 30°-40°   | 1006.7  | 9.4       |
| 40°-50°   | 1005.5  | 9.4       |
| 50°-60°   | 876.7   | 8.2       |
| 60°-70°   | 648.1   | 6.0       |
| 70°-80°   | 366.7   | 3.4       |
| 80°-90°   | 101.9   | 0.9       |
| 90°-100°  | 112.0   | 1.0       |
| 100°-110° | 355.9   | 3.3       |
| 110°-120° | 609.1   | 5.7       |
| 120°-130° | 801.1   | 7.5       |
| 130°-140° | 899.2   | 8.4       |
| 140°-150° | 881.7   | 8.2       |
| 150°-160° | 739.6   | 6.9       |
| 160°-170° | 490.5   | 4.6       |
| 170°-180° | 171.4   | 1.6       |
| 0°-30°    | 1666.2  | 15.5      |
| 0°-40°    | 2673.0  | 24.9      |
| 0°-60°    | 4555.2  | 42.4      |
| 0°-90°    | 5671.9  | 52.8      |
| 90°-120°  | 1077.0  | 10.0      |
| 90°-150°  | 3659.0  | 34.1      |
| 90°-180°  | 5061.0  | 47.2      |
| 0°-180°   | 10732.5 | 100.0     |

**CANDELA DISTRIBUTION:**

|      | 0°   | 22.5° | 45°  | 67.5° | 90°  | Flux |
|------|------|-------|------|-------|------|------|
| 0°   | 2227 | 2227  | 2227 | 2227  | 2227 |      |
| 5°   | 2227 | 2219  | 2195 | 2212  | 2208 | 211  |
| 15°  | 2120 | 2108  | 2080 | 2088  | 2078 | 597  |
| 25°  | 1919 | 1902  | 1866 | 1870  | 1866 | 883  |
| 35°  | 1656 | 1634  | 1600 | 1587  | 1576 | 1034 |
| 45°  | 1347 | 1332  | 1300 | 1276  | 1268 | 1040 |
| 55°  | 1020 | 1007  | 981  | 955   | 945  | 912  |
| 65°  | 688  | 675   | 653  | 634   | 623  | 680  |
| 75°  | 360  | 356   | 345  | 332   | 336  | 384  |
| 85°  | 88   | 86    | 84   | 77    | 75   | 98   |
| 90°  | 2    | 20    | 54   | 50    | 52   | 10   |
| 95°  | 80   | 95    | 98   | 98    | 95   | 89   |
| 105° | 329  | 333   | 336  | 339   | 339  | 347  |
| 115° | 611  | 620   | 617  | 616   | 611  | 605  |
| 125° | 889  | 903   | 898  | 893   | 892  | 794  |
| 135° | 1150 | 1167  | 1170 | 1168  | 1164 | 889  |
| 145° | 1396 | 1407  | 1416 | 1417  | 1411 | 872  |
| 155° | 1596 | 1601  | 1606 | 1613  | 1608 | 735  |
| 165° | 1737 | 1735  | 1735 | 1746  | 1738 | 490  |
| 175° | 1807 | 1803  | 1799 | 1810  | 1801 | 172  |
| 180° | 1810 | 1810  | 1810 | 1810  | 1810 |      |

TEST NUMBER: P925048

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US950-FLLFLL

**CANDELA DISTRIBUTION (FULL):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 0°     | 2227.2 | 2227.2 | 2227.2 | 2227.2 | 2227.2 |
| 2.5°   | 2240.2 | 2229.5 | 2205.8 | 2227.2 | 2223.1 |
| 5°     | 2227.2 | 2218.8 | 2195.2 | 2212.2 | 2208.1 |
| 7.5°   | 2212.2 | 2199.5 | 2175.9 | 2193.2 | 2188.9 |
| 10°    | 2188.9 | 2173.9 | 2148.1 | 2165.2 | 2158.8 |
| 12.5°  | 2156.6 | 2143.8 | 2118.2 | 2128.9 | 2124.6 |
| 15°    | 2120.2 | 2107.5 | 2079.5 | 2088.2 | 2077.5 |
| 17.5°  | 2075.2 | 2062.5 | 2034.6 | 2045.2 | 2034.6 |
| 20°    | 2025.9 | 2013.2 | 1983.2 | 1989.6 | 1981.2 |
| 22.5°  | 1976.9 | 1957.5 | 1929.6 | 1929.6 | 1925.3 |
| 25°    | 1918.9 | 1901.9 | 1865.5 | 1869.6 | 1865.5 |
| 27.5°  | 1854.6 | 1839.6 | 1811.8 | 1805.5 | 1794.9 |
| 30°    | 1790.6 | 1773.2 | 1741.2 | 1734.8 | 1726.2 |
| 32.5°  | 1721.9 | 1709.2 | 1674.8 | 1661.9 | 1653.3 |
| 35°    | 1655.6 | 1634.2 | 1599.9 | 1586.9 | 1576.2 |
| 37.5°  | 1580.6 | 1561.2 | 1527.0 | 1511.9 | 1501.2 |
| 40°    | 1503.5 | 1486.2 | 1452.0 | 1432.9 | 1424.2 |
| 42.5°  | 1428.5 | 1411.3 | 1377.2 | 1355.6 | 1342.9 |
| 45°    | 1347.2 | 1332.2 | 1299.9 | 1276.5 | 1267.9 |
| 47.5°  | 1267.9 | 1252.9 | 1218.6 | 1195.0 | 1182.2 |
| 50°    | 1184.3 | 1173.6 | 1143.7 | 1113.6 | 1102.9 |
| 52.5°  | 1102.9 | 1087.9 | 1060.2 | 1036.6 | 1021.6 |
| 55°    | 1019.5 | 1006.6 | 980.9  | 955.2  | 944.6  |
| 57.5°  | 936.0  | 925.3  | 897.3  | 871.7  | 863.0  |
| 60°    | 852.3  | 843.9  | 814.0  | 790.3  | 783.9  |
| 62.5°  | 770.9  | 755.9  | 734.6  | 713.2  | 704.6  |
| 65°    | 687.5  | 674.7  | 653.3  | 633.9  | 623.2  |
| 67.5°  | 601.9  | 591.0  | 571.9  | 556.9  | 548.3  |
| 70°    | 522.6  | 514.0  | 494.6  | 479.7  | 471.3  |
| 72.5°  | 441.2  | 432.6  | 422.0  | 407.0  | 400.6  |
| 75°    | 359.7  | 355.7  | 344.7  | 332.0  | 336.3  |
| 77.5°  | 287.0  | 278.4  | 274.0  | 267.7  | 261.3  |
| 80°    | 214.3  | 212.0  | 207.7  | 201.3  | 197.0  |
| 82.5°  | 145.7  | 145.7  | 143.6  | 135.0  | 135.0  |
| 85°    | 87.7   | 85.7   | 83.6   | 77.0   | 75.0   |
| 87.5°  | 38.6   | 34.3   | 30.0   | 23.7   | 21.4   |
| 90°    | 1.6    | 19.7   | 53.5   | 50.2   | 51.8   |
| 92.5°  | 33.9   | 45.9   | 47.5   | 49.1   | 49.1   |
| 95°    | 79.7   | 94.9   | 97.7   | 97.7   | 94.9   |
| 97.5°  | 132.6  | 146.8  | 152.8  | 152.8  | 152.8  |
| 100°   | 193.8  | 206.3  | 210.6  | 210.6  | 209.0  |
| 102.5° | 258.2  | 267.4  | 273.4  | 275.0  | 273.4  |
| 105°   | 328.6  | 332.9  | 336.2  | 339.0  | 339.0  |
| 107.5° | 398.4  | 405.0  | 405.0  | 406.0  | 398.4  |
| 110°   | 466.1  | 474.8  | 474.8  | 474.8  | 470.4  |

TEST NUMBER: P925048

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US950-FLLFLL

**CANDELA DISTRIBUTION (continued):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 112.5° | 539.2  | 548.5  | 546.8  | 542.4  | 539.2  |
| 115°   | 611.2  | 620.0  | 617.2  | 615.6  | 611.2  |
| 117.5° | 682.8  | 694.8  | 687.1  | 682.8  | 678.4  |
| 120°   | 754.8  | 766.8  | 754.8  | 754.8  | 749.8  |
| 122.5° | 820.2  | 835.5  | 827.9  | 823.6  | 820.2  |
| 125°   | 889.0  | 902.7  | 898.3  | 893.4  | 891.8  |
| 127.5° | 956.2  | 973.1  | 967.1  | 960.6  | 956.2  |
| 130°   | 1019.0 | 1038.6 | 1035.9 | 1032.6 | 1026.6 |
| 132.5° | 1089.4 | 1104.6 | 1105.7 | 1098.1 | 1093.7 |
| 135°   | 1150.0 | 1166.8 | 1170.1 | 1168.5 | 1164.1 |
| 137.5° | 1217.6 | 1231.2 | 1234.0 | 1232.9 | 1226.4 |
| 140°   | 1277.1 | 1290.8 | 1298.4 | 1298.4 | 1292.4 |
| 142.5° | 1338.2 | 1351.8 | 1356.2 | 1357.8 | 1351.8 |
| 145°   | 1396.1 | 1407.0 | 1415.7 | 1417.4 | 1411.3 |
| 147.5° | 1447.9 | 1461.5 | 1468.1 | 1470.8 | 1464.8 |
| 150°   | 1501.4 | 1510.7 | 1516.7 | 1521.5 | 1516.7 |
| 152.5° | 1548.8 | 1558.2 | 1565.8 | 1571.8 | 1565.8 |
| 155°   | 1596.3 | 1600.7 | 1605.6 | 1613.3 | 1608.3 |
| 157.5° | 1637.3 | 1640.6 | 1643.3 | 1654.2 | 1646.6 |
| 160°   | 1673.9 | 1677.1 | 1678.8 | 1688.0 | 1681.5 |
| 162.5° | 1707.7 | 1707.7 | 1709.3 | 1719.7 | 1712.0 |
| 165°   | 1736.6 | 1734.9 | 1734.9 | 1745.9 | 1738.3 |
| 167.5° | 1762.8 | 1757.9 | 1757.9 | 1768.8 | 1761.2 |
| 170°   | 1782.5 | 1778.1 | 1776.4 | 1787.3 | 1778.1 |
| 172.5° | 1796.1 | 1791.7 | 1790.1 | 1801.0 | 1791.7 |
| 175°   | 1807.0 | 1802.7 | 1799.3 | 1810.3 | 1801.0 |
| 177.5° | 1813.0 | 1808.7 | 1805.3 | 1814.6 | 1805.3 |
| 180°   | 1810.3 | 1810.3 | 1810.3 | 1810.3 | 1810.3 |

TEST NUMBER: P925048

CATALOG NUMBER: DFN2DIP-PN4F0-060D060US950-FLLFLL

**CIE UGR TABLE:**

| Reflectances:   |      |                  |       |       |       |       |                |       |       |       |       |
|-----------------|------|------------------|-------|-------|-------|-------|----------------|-------|-------|-------|-------|
| Ceiling         |      | 0.7              | 0.7   | 0.5   | 0.5   | 0.3   | 0.7            | 0.7   | 0.5   | 0.5   | 0.3   |
| Wall            |      | 0.5              | 0.3   | 0.5   | 0.3   | 0.3   | 0.5            | 0.3   | 0.5   | 0.3   | 0.3   |
| Reference plane |      | 0.2              | 0.2   | 0.2   | 0.2   | 0.2   | 0.2            | 0.2   | 0.2   | 0.2   | 0.2   |
| Room dimensions |      | Viewed crosswise |       |       |       |       | Viewed endwise |       |       |       |       |
| X=2H            | Y=2H | 9.23             | 10.11 | 10.16 | 11.06 | 12.29 | 8.79           | 9.67  | 9.72  | 10.62 | 11.85 |
|                 | 3H   | 10.89            | 11.69 | 11.83 | 12.65 | 13.90 | 10.41          | 11.20 | 11.35 | 12.16 | 13.42 |
|                 | 4H   | 11.48            | 12.24 | 12.44 | 13.20 | 14.46 | 10.99          | 11.75 | 11.95 | 12.71 | 13.97 |
|                 | 6H   | 11.89            | 12.58 | 12.85 | 13.55 | 14.82 | 11.39          | 12.09 | 12.36 | 13.06 | 14.33 |
|                 | 8H   | 11.99            | 12.65 | 12.97 | 13.64 | 14.91 | 11.50          | 12.16 | 12.48 | 13.15 | 14.42 |
|                 | 12H  | 12.04            | 12.67 | 13.02 | 13.65 | 14.95 | 11.54          | 12.17 | 12.52 | 13.15 | 14.45 |
| 4H              | 2H   | 9.69             | 10.44 | 10.65 | 11.41 | 12.67 | 9.34           | 10.09 | 10.30 | 11.06 | 12.32 |
|                 | 3H   | 11.56            | 12.19 | 12.54 | 13.18 | 14.46 | 11.16          | 11.79 | 12.13 | 12.78 | 14.06 |
|                 | 4H   | 12.28            | 12.85 | 13.26 | 13.84 | 15.14 | 11.86          | 12.44 | 12.84 | 13.42 | 14.72 |
|                 | 6H   | 12.80            | 13.29 | 13.79 | 14.31 | 15.60 | 12.37          | 12.87 | 13.37 | 13.88 | 15.18 |
|                 | 8H   | 12.95            | 13.41 | 13.95 | 14.42 | 15.73 | 12.52          | 12.99 | 13.52 | 13.99 | 15.30 |
|                 | 12H  | 13.03            | 13.45 | 14.04 | 14.46 | 15.78 | 12.59          | 13.00 | 13.60 | 14.02 | 15.34 |
| 8H              | 4H   | 12.48            | 12.94 | 13.48 | 13.95 | 15.26 | 12.11          | 12.57 | 13.10 | 13.57 | 14.89 |
|                 | 6H   | 13.11            | 13.50 | 14.14 | 14.54 | 15.85 | 12.74          | 13.12 | 13.76 | 14.17 | 15.48 |
|                 | 8H   | 13.34            | 13.68 | 14.37 | 14.71 | 16.04 | 12.95          | 13.29 | 13.98 | 14.32 | 15.65 |
|                 | 12H  | 13.47            | 13.77 | 14.51 | 14.80 | 16.17 | 13.07          | 13.37 | 14.10 | 14.39 | 15.77 |
| 12H             | 4H   | 12.47            | 12.88 | 13.48 | 13.90 | 15.22 | 12.10          | 12.52 | 13.12 | 13.54 | 14.86 |
|                 | 6H   | 13.14            | 13.48 | 14.17 | 14.51 | 15.84 | 12.78          | 13.12 | 13.81 | 14.15 | 15.48 |
|                 | 8H   | 13.39            | 13.69 | 14.42 | 14.71 | 16.09 | 13.02          | 13.32 | 14.05 | 14.34 | 15.72 |