

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925057

Luminaire Tested: DFN2DIP-PN4F0-060D080US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925057
REPORT IS A COMBINATION OF REPORTS P901205 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D080US950-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13222.5 lumens
Efficiency: N/A
Efficacy: 117.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 112.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925057

CATALOG NUMBER: DFN2DIP-PN4F0-060D080US950-FLLONL

Luminous Intensity Polar Plot

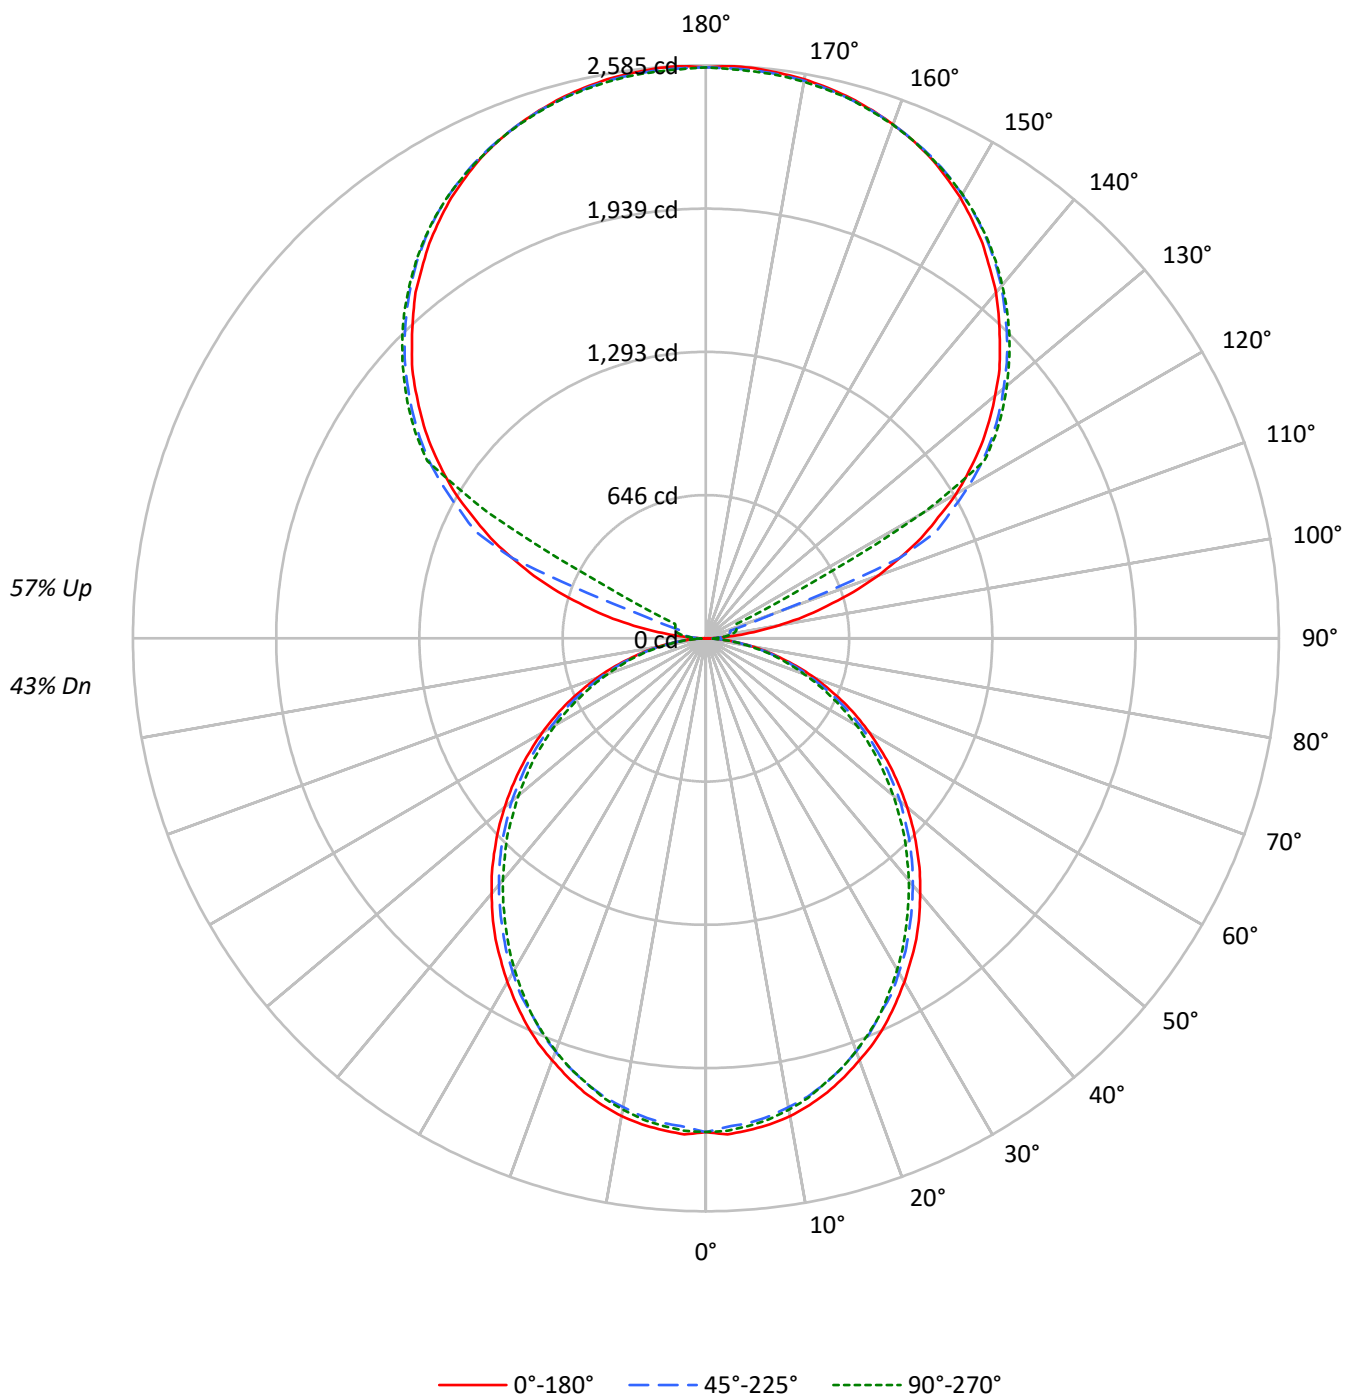

TEST NUMBER: P925057

CATALOG NUMBER: DFN2DIP-PN4F0-060D080US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50
1	96	92	88	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	80	74	69	80	74	68	64	61	57	54	49	47	44	39	37	35
3	80	71	63	58	73	65	58	53	54	49	45	44	40	38	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	31	28	26
5	67	56	48	42	61	51	44	39	43	37	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	32	52	41	34	29	35	29	25	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1626	1626	1626
5°	1628	1603	1614
10°	1615	1582	1593
15°	1591	1556	1559
20°	1559	1520	1524
25°	1527	1477	1484
30°	1487	1437	1433
35°	1450	1390	1379
40°	1403	1342	1327
45°	1356	1294	1275
50°	1305	1244	1214
55°	1252	1186	1158
60°	1192	1117	1094
65°	1126	1046	1018
70°	1043	959	937
75°	927	855	863
80°	787	722	719
85°	569	493	481

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1375 cd/sqm

TEST NUMBER: P925057

CATALOG NUMBER: DFN2DIP-PN4F0-060D080US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.6	1.6
10°-20°	589.8	4.5
20°-30°	866.8	6.6
30°-40°	1006.7	7.6
40°-50°	1005.5	7.6
50°-60°	876.7	6.6
60°-70°	648.1	4.9
70°-80°	366.7	2.8
80°-90°	101.3	0.8
90°-100°	84.9	0.6
100°-110°	316.6	2.4
110°-120°	839.7	6.4
120°-130°	1392.7	10.5
130°-140°	1479.4	11.2
140°-150°	1374.9	10.4
150°-160°	1105.4	8.4
160°-170°	712.3	5.4
170°-180°	245.2	1.9
0°-30°	1666.2	12.6
0°-40°	2673.0	20.2
0°-60°	4555.2	34.5
0°-90°	5671.3	42.9
90°-120°	1241.3	9.4
90°-150°	5488.3	41.5
90°-180°	7551.0	57.1
0°-180°	13222.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2227	2227	2227	2227	2227	
5°	2227	2219	2195	2212	2208	211
15°	2120	2108	2080	2088	2078	597
25°	1919	1902	1866	1870	1866	883
35°	1656	1634	1600	1587	1576	1034
45°	1347	1332	1300	1276	1268	1040
55°	1020	1007	981	955	945	912
65°	688	675	653	634	623	680
75°	360	356	345	332	336	384
85°	88	86	84	77	75	98
90°	2	22	37	47	50	12
95°	121	60	73	82	80	143
105°	567	623	114	134	142	605
115°	1072	1103	1150	287	153	1055
125°	1515	1540	1575	1588	1594	1351
135°	1875	1905	1922	1940	1936	1448
145°	2175	2173	2205	2218	2208	1360
155°	2395	2378	2401	2412	2397	1104
165°	2524	2512	2518	2531	2518	713
175°	2581	2568	2572	2585	2566	246
180°	2576	2576	2576	2576	2576	

TEST NUMBER: P925057

CATALOG NUMBER: DFN2DIP-PN4F0-060D080US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2227.2	2227.2	2227.2	2227.2	2227.2
2.5°	2240.2	2229.5	2205.8	2227.2	2223.1
5°	2227.2	2218.8	2195.2	2212.2	2208.1
7.5°	2212.2	2199.5	2175.9	2193.2	2188.9
10°	2188.9	2173.9	2148.1	2165.2	2158.8
12.5°	2156.6	2143.8	2118.2	2128.9	2124.6
15°	2120.2	2107.5	2079.5	2088.2	2077.5
17.5°	2075.2	2062.5	2034.6	2045.2	2034.6
20°	2025.9	2013.2	1983.2	1989.6	1981.2
22.5°	1976.9	1957.5	1929.6	1929.6	1925.3
25°	1918.9	1901.9	1865.5	1869.6	1865.5
27.5°	1854.6	1839.6	1811.8	1805.5	1794.9
30°	1790.6	1773.2	1741.2	1734.8	1726.2
32.5°	1721.9	1709.2	1674.8	1661.9	1653.3
35°	1655.6	1634.2	1599.9	1586.9	1576.2
37.5°	1580.6	1561.2	1527.0	1511.9	1501.2
40°	1503.5	1486.2	1452.0	1432.9	1424.2
42.5°	1428.5	1411.3	1377.2	1355.6	1342.9
45°	1347.2	1332.2	1299.9	1276.5	1267.9
47.5°	1267.9	1252.9	1218.6	1195.0	1182.2
50°	1184.3	1173.6	1143.7	1113.6	1102.9
52.5°	1102.9	1087.9	1060.2	1036.6	1021.6
55°	1019.5	1006.6	980.9	955.2	944.6
57.5°	936.0	925.3	897.3	871.7	863.0
60°	852.3	843.9	814.0	790.3	783.9
62.5°	770.9	755.9	734.6	713.2	704.6
65°	687.5	674.7	653.3	633.9	623.2
67.5°	601.9	591.0	571.9	556.9	548.3
70°	522.6	514.0	494.6	479.7	471.3
72.5°	441.2	432.6	422.0	407.0	400.6
75°	359.7	355.7	344.7	332.0	336.3
77.5°	287.0	278.4	274.0	267.7	261.3
80°	214.3	212.0	207.7	201.3	197.0
82.5°	145.7	145.7	143.6	135.0	135.0
85°	87.7	85.7	83.6	77.0	75.0
87.5°	38.6	34.3	30.0	23.7	21.4
90°	1.8	22.3	37.2	46.7	50.3
92.5°	46.7	39.2	44.7	48.5	50.3
95°	121.1	59.5	72.6	82.1	80.1
97.5°	218.0	65.3	94.9	100.7	102.5
100°	330.0	74.6	106.3	121.1	124.8
102.5°	452.9	449.2	110.0	130.3	136.1
105°	566.6	622.6	113.7	134.1	141.7
107.5°	698.9	745.4	117.5	137.9	145.4
110°	825.8	864.7	326.3	139.9	147.2

TEST NUMBER: P925057

CATALOG NUMBER: DFN2DIP-PN4F0-060D080US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	945.0	978.4	946.8	143.4	149.2
115°	1071.6	1103.3	1150.0	287.1	152.9
117.5°	1181.6	1218.8	1250.7	984.0	495.8
120°	1304.7	1332.5	1366.2	1388.5	1136.9
122.5°	1408.9	1438.8	1476.2	1487.3	1489.3
125°	1515.1	1539.5	1574.9	1587.9	1593.5
127.5°	1612.1	1638.2	1666.4	1684.9	1686.7
130°	1703.5	1733.3	1753.7	1774.3	1772.5
132.5°	1796.7	1821.0	1841.4	1858.2	1856.4
135°	1875.0	1904.9	1921.5	1940.3	1936.5
137.5°	1956.9	1979.3	1998.1	2016.7	2011.1
140°	2037.0	2052.1	2072.5	2089.3	2079.9
142.5°	2104.3	2117.3	2141.4	2156.3	2147.0
145°	2175.1	2173.1	2204.8	2217.9	2208.5
147.5°	2236.5	2230.9	2262.5	2271.9	2264.5
150°	2296.2	2283.1	2313.0	2324.0	2314.8
152.5°	2346.5	2331.6	2359.4	2370.8	2357.7
155°	2394.9	2378.3	2400.6	2411.7	2396.9
157.5°	2434.0	2419.2	2436.0	2449.1	2434.0
160°	2467.7	2456.5	2467.7	2478.8	2465.7
162.5°	2497.4	2486.3	2495.6	2508.6	2491.8
165°	2523.5	2512.5	2518.0	2531.0	2518.0
167.5°	2544.0	2532.8	2538.5	2551.6	2534.8
170°	2560.9	2549.6	2553.4	2566.5	2549.6
172.5°	2572.0	2560.9	2564.6	2577.7	2560.9
175°	2581.2	2568.2	2572.0	2585.0	2566.5
177.5°	2585.0	2572.0	2573.9	2587.0	2570.2
180°	2575.7	2575.7	2575.7	2575.7	2575.7

TEST NUMBER: P925057

CATALOG NUMBER: DFN2DIP-PN4F0-060D080US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.27	9.07	9.29	10.10	11.47	7.83	8.63	8.85	9.66	11.03
	3H	9.93	10.65	10.96	11.68	13.07	9.45	10.17	10.47	11.20	12.59
	4H	10.52	11.20	11.56	12.23	13.63	10.03	10.71	11.07	11.75	13.14
	6H	10.92	11.54	11.97	12.58	13.99	10.43	11.05	11.47	12.09	13.50
	8H	11.02	11.62	12.08	12.67	14.08	10.53	11.13	11.58	12.18	13.59
	12H	11.07	11.64	12.13	12.69	14.12	10.57	11.14	11.63	12.19	13.62
4H	2H	8.73	9.41	9.77	10.44	11.84	8.38	9.06	9.42	10.09	11.49
	3H	10.59	11.16	11.64	12.22	13.63	10.19	10.76	11.24	11.82	13.23
	4H	11.30	11.83	12.36	12.88	14.31	10.89	11.41	11.95	12.46	13.90
	6H	11.82	12.27	12.89	13.35	14.77	11.39	11.84	12.46	12.92	14.35
	8H	11.97	12.39	13.04	13.46	14.90	11.54	11.96	12.61	13.03	14.47
	12H	12.04	12.42	13.13	13.50	14.95	11.60	11.98	12.69	13.06	14.51
8H	4H	11.50	11.91	12.57	12.99	14.43	11.13	11.54	12.20	12.61	14.06
	6H	12.13	12.47	13.22	13.59	15.03	11.75	12.10	12.84	13.21	14.65
	8H	12.35	12.65	13.45	13.75	15.21	11.97	12.27	13.07	13.37	14.82
	12H	12.48	12.75	13.59	13.84	15.34	12.08	12.35	13.18	13.44	14.94
12H	4H	11.48	11.86	12.57	12.94	14.39	11.12	11.50	12.20	12.58	14.03
	6H	12.16	12.46	13.26	13.56	15.02	11.79	12.10	12.89	13.19	14.65
	8H	12.40	12.67	13.50	13.76	15.26	12.03	12.29	13.13	13.39	14.88

END OF REPORT