

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925164

Luminaire Tested: DFN2DIP-PN4F0-090D080US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925164
REPORT IS A COMBINATION OF REPORTS P899691 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-090D080US950-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15254.5 lumens
Efficiency: N/A
Efficacy: 104.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 146.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925164

CATALOG NUMBER: DFN2DIP-PN4F0-090D080US950-FLLFLL

Luminous Intensity Polar Plot

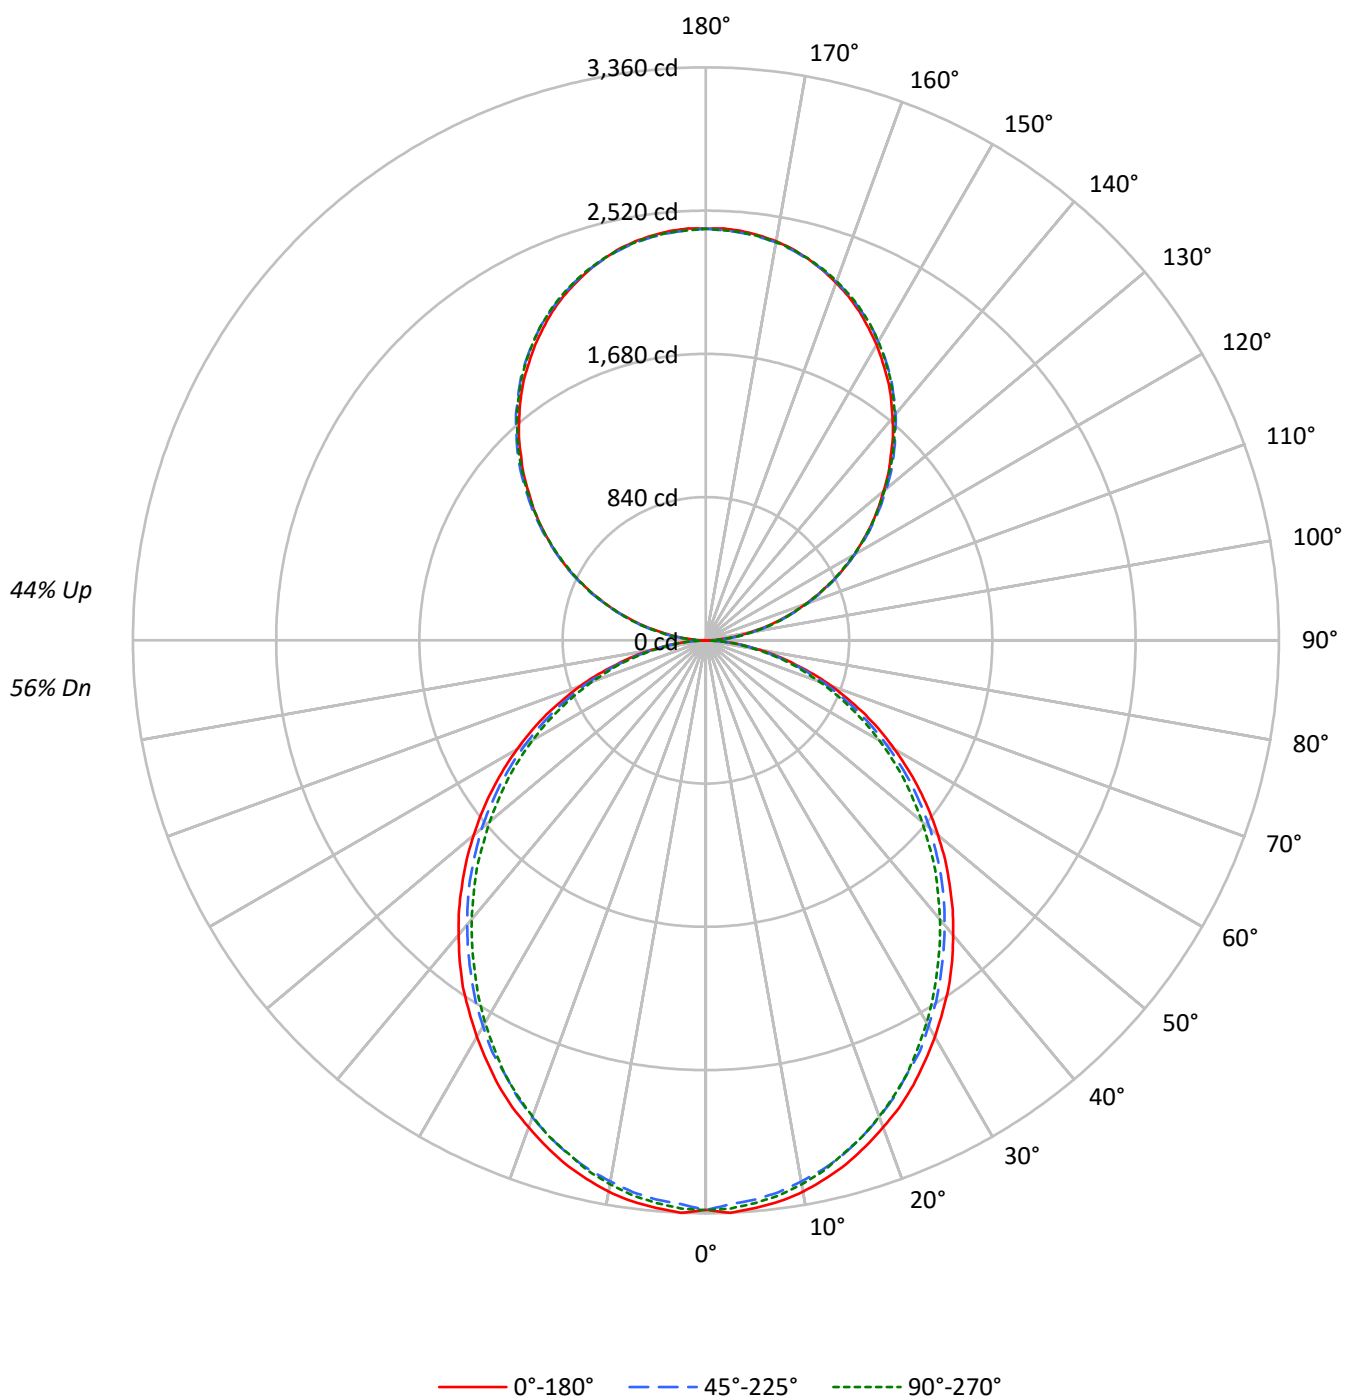

TEST NUMBER: P925164

CATALOG NUMBER: DFN2DIP-PN4F0-090D080US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	73	73	73	61	61	61
1	99	95	91	87	92	88	85	82	76	73	71	65	63	61	54	53	52
2	90	83	77	71	84	77	72	67	67	62	59	57	54	51	48	46	44
3	82	73	65	59	76	68	61	56	59	54	50	50	46	43	42	40	37
4	75	64	56	50	70	60	53	48	52	47	42	45	41	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	36	40	36	32	34	31	28
6	64	52	43	37	59	48	41	36	42	36	32	36	32	28	31	27	25
7	59	47	39	33	55	44	36	31	38	32	28	33	28	25	28	25	22
8	55	42	35	29	51	40	33	28	35	29	25	30	26	22	26	22	20
9	51	39	31	26	47	36	30	25	32	26	22	28	23	20	24	20	18
10	48	36	28	23	44	33	27	22	30	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2439	2439	2439
5°	2443	2405	2421
10°	2423	2373	2389
15°	2387	2334	2338
20°	2339	2280	2286
25°	2291	2216	2226
30°	2231	2156	2149
35°	2174	2085	2068
40°	2104	2013	1991
45°	2034	1941	1912
50°	1958	1866	1821
55°	1878	1779	1737
60°	1788	1675	1641
65°	1689	1569	1527
70°	1564	1438	1406
75°	1390	1282	1294
80°	1181	1083	1079
85°	854	740	722

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2034 cd/sqm

TEST NUMBER: P925164

CATALOG NUMBER: DFN2DIP-PN4F0-090D080US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	314.4	2.1
10°-20°	884.7	5.8
20°-30°	1300.2	8.5
30°-40°	1510.1	9.9
40°-50°	1508.2	9.9
50°-60°	1315.1	8.6
60°-70°	972.2	6.4
70°-80°	550.0	3.6
80°-90°	152.0	1.0
90°-100°	149.4	1.0
100°-110°	474.6	3.1
110°-120°	812.1	5.3
120°-130°	1068.1	7.0
130°-140°	1198.9	7.9
140°-150°	1175.6	7.7
150°-160°	986.2	6.5
160°-170°	654.0	4.3
170°-180°	228.6	1.5
0°-30°	2499.3	16.4
0°-40°	4009.4	26.3
0°-60°	6832.8	44.8
0°-90°	8507.0	55.8
90°-120°	1436.1	9.4
90°-150°	4878.6	32.0
90°-180°	6747.0	44.2
0°-180°	15254.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3341	3341	3341	3341	3341	
5°	3341	3328	3293	3318	3312	317
15°	3180	3161	3119	3132	3116	896
25°	2878	2853	2798	2804	2798	1324
35°	2483	2451	2400	2380	2364	1551
45°	2021	1998	1950	1915	1902	1560
55°	1529	1510	1471	1433	1417	1367
65°	1031	1012	980	951	935	1020
75°	540	533	517	498	504	576
85°	132	128	126	116	112	147
90°	2	26	71	67	69	15
95°	106	127	130	130	127	118
105°	438	444	448	452	452	462
115°	815	827	823	821	815	806
125°	1185	1204	1198	1191	1189	1059
135°	1533	1556	1560	1558	1552	1185
145°	1861	1876	1888	1890	1882	1163
155°	2128	2134	2141	2151	2144	980
165°	2316	2313	2313	2328	2318	653
175°	2409	2404	2399	2414	2401	229
180°	2414	2414	2414	2414	2414	

TEST NUMBER: P925164

CATALOG NUMBER: DFN2DIP-PN4F0-090D080US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3340.8	3340.8	3340.8	3340.8	3340.8
2.5°	3360.3	3344.2	3308.9	3340.8	3334.7
5°	3340.8	3328.2	3292.8	3318.4	3312.2
7.5°	3318.4	3299.3	3263.8	3289.8	3283.3
10°	3283.3	3260.8	3222.2	3247.8	3238.3
12.5°	3234.8	3215.7	3177.3	3193.2	3186.8
15°	3180.3	3161.3	3119.3	3132.3	3116.2
17.5°	3112.8	3093.7	3051.8	3067.9	3051.8
20°	3038.9	3019.8	2974.8	2984.3	2971.7
22.5°	2965.2	2936.3	2894.3	2894.3	2887.9
25°	2878.3	2852.7	2798.3	2804.4	2798.3
27.5°	2781.9	2759.3	2717.9	2708.3	2692.3
30°	2685.8	2659.8	2611.8	2602.2	2589.3
32.5°	2582.9	2563.8	2512.3	2492.9	2479.9
35°	2483.4	2451.3	2399.8	2380.4	2364.4
37.5°	2370.9	2341.9	2290.4	2267.9	2251.9
40°	2255.3	2229.4	2177.9	2149.3	2136.4
42.5°	2142.8	2116.9	2065.8	2033.5	2014.4
45°	2020.8	1998.3	1949.9	1914.8	1901.9
47.5°	1901.9	1879.4	1827.9	1792.5	1773.4
50°	1776.4	1760.4	1715.4	1670.5	1654.4
52.5°	1654.4	1631.9	1590.3	1554.9	1532.4
55°	1529.4	1509.9	1471.4	1432.9	1416.9
57.5°	1403.9	1387.9	1346.0	1307.5	1294.5
60°	1278.5	1265.9	1220.8	1185.4	1175.9
62.5°	1156.4	1133.9	1101.9	1069.9	1056.9
65°	1031.4	1011.9	979.9	950.9	934.9
67.5°	902.9	886.6	857.8	835.4	822.4
70°	783.9	770.9	742.0	719.5	706.9
72.5°	661.9	648.9	632.9	610.5	600.9
75°	539.6	533.4	517.1	498.0	504.5
77.5°	430.4	417.6	411.1	401.5	392.0
80°	321.4	318.0	311.5	301.9	295.5
82.5°	218.5	218.5	215.4	202.4	202.4
85°	131.6	128.5	125.5	115.5	112.5
87.5°	57.9	51.4	45.0	35.5	32.1
90°	2.2	26.2	71.4	67.0	69.2
92.5°	45.1	61.2	63.3	65.4	65.4
95°	106.3	126.6	130.2	130.2	126.6
97.5°	176.9	195.8	203.8	203.8	203.8
100°	258.3	275.0	280.9	280.9	278.7
102.5°	344.2	356.6	364.5	366.7	364.5
105°	438.1	443.9	448.3	451.9	451.9
107.5°	531.2	540.0	540.0	541.4	531.2
110°	621.4	633.1	633.1	633.1	627.3

TEST NUMBER: P925164

CATALOG NUMBER: DFN2DIP-PN4F0-090D080US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	718.9	731.3	729.1	723.3	718.9
115°	815.0	826.6	823.0	820.8	815.0
117.5°	910.3	926.3	916.1	910.3	904.5
120°	1006.4	1022.4	1006.4	1006.4	999.8
122.5°	1093.7	1114.1	1103.9	1098.1	1093.7
125°	1185.3	1203.6	1197.7	1191.2	1189.1
127.5°	1274.9	1297.4	1289.4	1280.7	1274.9
130°	1358.6	1384.7	1381.1	1376.8	1368.8
132.5°	1452.5	1472.8	1474.3	1464.1	1458.3
135°	1533.2	1555.8	1560.2	1558.0	1552.2
137.5°	1623.4	1641.6	1645.3	1643.8	1635.1
140°	1702.8	1720.9	1731.1	1731.1	1723.1
142.5°	1784.3	1802.5	1808.3	1810.5	1802.5
145°	1861.4	1875.9	1887.6	1889.8	1881.8
147.5°	1930.5	1948.7	1957.4	1961.1	1953.1
150°	2001.9	2014.2	2022.2	2028.8	2022.2
152.5°	2065.1	2077.5	2087.7	2095.7	2087.7
155°	2128.5	2134.3	2140.9	2151.0	2144.5
157.5°	2183.0	2187.4	2191.1	2205.6	2195.4
160°	2231.8	2236.2	2238.4	2250.7	2242.0
162.5°	2276.9	2276.9	2279.1	2292.9	2282.7
165°	2315.5	2313.3	2313.3	2327.9	2317.6
167.5°	2350.4	2343.9	2343.9	2358.4	2348.2
170°	2376.6	2370.8	2368.6	2383.2	2370.8
172.5°	2394.8	2389.0	2386.8	2401.3	2389.0
175°	2409.3	2403.5	2399.1	2413.7	2401.3
177.5°	2417.3	2411.5	2407.1	2419.5	2407.1
180°	2413.7	2413.7	2413.7	2413.7	2413.7

TEST NUMBER: P925164

CATALOG NUMBER: DFN2DIP-PN4F0-090D080US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.89	11.81	11.80	12.73	13.92	10.45	11.37	11.36	12.29	13.48
	3H	12.56	13.38	13.48	14.32	15.53	12.07	12.90	12.99	13.83	15.04
	4H	13.15	13.93	14.08	14.87	16.09	12.66	13.44	13.60	14.38	15.60
	6H	13.56	14.27	14.50	15.22	16.45	13.06	13.78	14.01	14.73	15.96
	8H	13.66	14.35	14.61	15.31	16.54	13.17	13.85	14.12	14.82	16.05
	12H	13.71	14.36	14.67	15.32	16.58	13.21	13.86	14.17	14.82	16.08
4H	2H	11.36	12.14	12.30	13.08	14.30	11.01	11.79	11.95	12.73	13.95
	3H	13.23	13.88	14.18	14.85	16.09	12.83	13.48	13.78	14.45	15.68
	4H	13.95	14.55	14.91	15.51	16.77	13.53	14.13	14.49	15.09	16.35
	6H	14.47	14.98	15.44	15.97	17.23	14.05	14.56	15.02	15.55	16.81
	8H	14.63	15.10	15.60	16.09	17.36	14.20	14.67	15.17	15.66	16.93
	12H	14.70	15.13	15.70	16.13	17.41	14.26	14.69	15.26	15.69	16.97
8H	4H	14.15	14.63	15.13	15.61	16.89	13.78	14.26	14.76	15.24	16.51
	6H	14.79	15.19	15.79	16.21	17.48	14.41	14.81	15.41	15.83	17.10
	8H	15.01	15.36	16.02	16.37	17.66	14.63	14.98	15.64	15.99	17.28
	12H	15.15	15.46	16.16	16.46	17.80	14.75	15.05	15.76	16.06	17.39
12H	4H	14.14	14.57	15.13	15.57	16.85	13.78	14.21	14.77	15.21	16.49
	6H	14.82	15.17	15.83	16.18	17.47	14.46	14.81	15.46	15.82	17.11
	8H	15.07	15.38	16.08	16.38	17.72	14.70	15.00	15.71	16.01	17.34

END OF REPORT