

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903468

Luminaire Tested: DFN2DIP-SQ2F0-030D030US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903468
REPORT IS A COMBINATION OF REPORTS P899771 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-030D030US830-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5301.8 lumens
Efficiency: N/A
Efficacy: 115.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 45.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903468

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US830-FLLFLL

Luminous Intensity Polar Plot

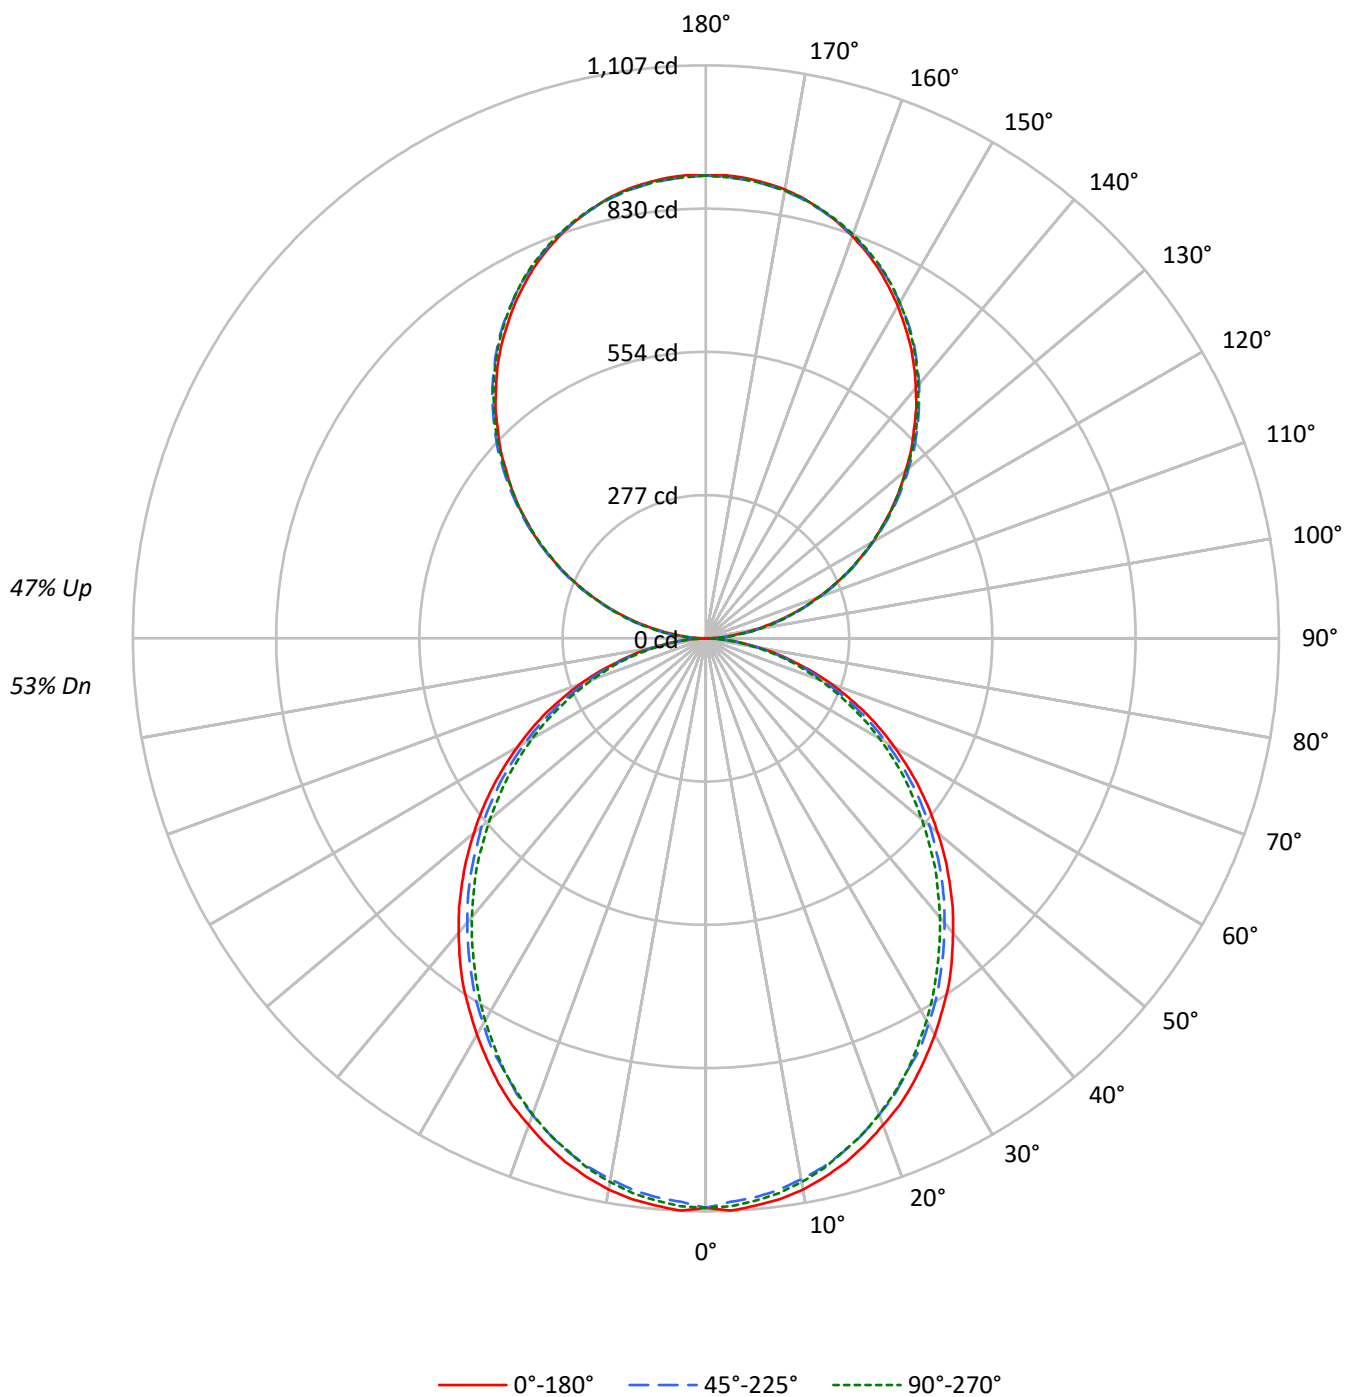

TEST NUMBER: P903468

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2419	2419	2419
5°	2419	2380	2398
10°	2395	2343	2362
15°	2356	2299	2308
20°	2304	2240	2253
25°	2252	2171	2190
30°	2189	2106	2110
35°	2128	2031	2026
40°	2054	1954	1946
45°	1980	1877	1863
50°	1899	1796	1769
55°	1814	1702	1681
60°	1717	1592	1580
65°	1611	1477	1460
70°	1477	1337	1331
75°	1292	1168	1208
80°	1066	953	982
85°	722	602	616

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1980 cd/sqm

TEST NUMBER: P903468

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	103.6	2.0
10°-20°	291.4	5.5
20°-30°	428.2	8.1
30°-40°	497.3	9.4
40°-50°	496.7	9.4
50°-60°	433.1	8.2
60°-70°	320.2	6.0
70°-80°	181.1	3.4
80°-90°	50.3	0.9
90°-100°	55.3	1.0
100°-110°	175.8	3.3
110°-120°	300.9	5.7
120°-130°	395.7	7.5
130°-140°	444.2	8.4
140°-150°	435.6	8.2
150°-160°	365.4	6.9
160°-170°	242.3	4.6
170°-180°	84.7	1.6
0°-30°	823.1	15.5
0°-40°	1320.4	24.9
0°-60°	2250.3	42.4
0°-90°	2801.9	52.8
90°-120°	532.1	10.0
90°-150°	1807.5	34.1
90°-180°	2500.0	47.2
0°-180°	5301.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1100	1100	1100	1100	1100	
5°	1100	1096	1084	1093	1091	104
15°	1047	1041	1027	1032	1026	295
25°	948	940	922	924	922	436
35°	818	807	790	784	779	511
45°	666	658	642	631	626	514
55°	504	497	485	472	467	450
65°	340	333	323	313	308	336
75°	178	176	170	164	166	190
85°	43	42	41	38	37	48
90°	1	10	26	25	26	5
95°	39	47	48	48	47	44
105°	162	164	166	167	167	171
115°	302	306	305	304	302	299
125°	439	446	444	441	440	392
135°	568	576	578	577	575	439
145°	690	695	699	700	697	431
155°	789	791	793	797	795	363
165°	858	857	857	862	859	242
175°	893	890	889	894	890	85
180°	894	894	894	894	894	

TEST NUMBER: P903468

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1100.2	1100.2	1100.2	1100.2	1100.2
2.5°	1106.6	1101.4	1089.7	1100.2	1098.3
5°	1100.2	1096.1	1084.4	1092.9	1090.8
7.5°	1092.9	1086.6	1074.9	1083.5	1081.3
10°	1081.3	1073.8	1061.2	1069.6	1066.5
12.5°	1065.4	1059.0	1046.4	1051.6	1049.5
15°	1047.4	1041.1	1027.3	1031.5	1026.2
17.5°	1025.1	1018.9	1005.0	1010.3	1005.0
20°	1000.8	994.5	979.7	982.8	978.6
22.5°	976.6	967.0	953.2	953.2	951.0
25°	947.9	939.5	921.5	923.6	921.5
27.5°	916.2	908.7	895.0	891.9	886.6
30°	884.5	876.0	860.2	857.0	852.7
32.5°	850.6	844.3	827.4	821.0	816.7
35°	817.8	807.3	790.3	783.9	778.6
37.5°	780.8	771.3	754.3	746.9	741.6
40°	742.7	734.2	717.3	707.8	703.6
42.5°	705.7	697.2	680.3	669.7	663.4
45°	665.5	658.1	642.2	630.6	626.3
47.5°	626.3	619.0	602.0	590.3	584.0
50°	585.0	579.8	565.0	550.2	544.9
52.5°	544.9	537.4	523.8	512.1	504.6
55°	503.7	497.3	484.6	471.9	466.7
57.5°	462.3	457.0	443.3	430.6	426.3
60°	421.0	416.9	402.1	390.4	387.3
62.5°	380.9	373.4	362.9	352.3	348.1
65°	339.7	333.3	322.7	313.2	307.9
67.5°	297.4	292.0	282.5	275.1	270.9
70°	258.2	253.9	244.4	237.0	232.8
72.5°	218.0	213.7	208.4	201.0	197.9
75°	177.7	175.7	170.3	164.0	166.2
77.5°	141.8	137.5	135.3	132.2	129.1
80°	105.8	104.7	102.5	99.4	97.4
82.5°	71.9	71.9	71.0	66.6	66.6
85°	43.4	42.3	41.3	38.1	37.0
87.5°	19.0	17.0	14.8	11.7	10.6
90°	0.8	9.7	26.4	24.8	25.6
92.5°	16.7	22.6	23.5	24.2	24.2
95°	39.4	46.9	48.3	48.3	46.9
97.5°	65.5	72.5	75.5	75.5	75.5
100°	95.7	101.9	104.1	104.1	103.3
102.5°	127.5	132.1	135.1	135.9	135.1
105°	162.3	164.5	166.1	167.4	167.4
107.5°	196.8	200.0	200.0	200.6	196.8
110°	230.3	234.6	234.6	234.6	232.4



TEST NUMBER: P903468

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	266.4	271.0	270.1	268.0	266.4
115°	302.0	306.2	304.9	304.2	302.0
117.5°	337.2	343.2	339.4	337.2	335.1
120°	372.9	378.8	372.9	372.9	370.4
122.5°	405.2	412.7	409.0	406.8	405.2
125°	439.2	445.9	443.7	441.3	440.5
127.5°	472.3	480.7	477.8	474.5	472.3
130°	503.3	513.0	511.7	510.1	507.1
132.5°	538.1	545.6	546.2	542.4	540.3
135°	568.1	576.4	578.1	577.2	575.0
137.5°	601.4	608.2	609.5	609.1	605.8
140°	630.8	637.6	641.4	641.4	638.4
142.5°	661.1	667.8	670.0	670.8	667.8
145°	689.7	695.0	699.4	700.1	697.2
147.5°	715.3	722.0	725.2	726.6	723.6
150°	741.7	746.3	749.2	751.7	749.2
152.5°	765.2	769.7	773.5	776.5	773.5
155°	788.6	790.7	793.1	796.9	794.6
157.5°	808.8	810.4	811.8	817.2	813.4
160°	826.9	828.5	829.3	833.9	830.7
162.5°	843.6	843.6	844.4	849.5	845.7
165°	857.9	857.1	857.1	862.4	858.7
167.5°	870.8	868.4	868.4	873.7	870.0
170°	880.5	878.4	877.6	883.0	878.4
172.5°	887.2	885.1	884.3	889.7	885.1
175°	892.7	890.5	888.9	894.3	889.7
177.5°	895.6	893.4	891.8	896.5	891.8
180°	894.3	894.3	894.3	894.3	894.3

TEST NUMBER: P903468

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.48	11.37	11.42	12.32	13.55	10.04	10.93	10.97	11.88	13.11
	3H	12.13	12.92	13.07	13.88	15.14	11.64	12.43	12.58	13.39	14.65
	4H	12.70	13.46	13.66	14.42	15.68	12.21	12.96	13.17	13.93	15.19
	6H	13.09	13.78	14.06	14.75	16.03	12.59	13.28	13.56	14.25	15.53
	8H	13.19	13.85	14.16	14.83	16.11	12.69	13.35	13.66	14.33	15.61
	12H	13.23	13.86	14.21	14.84	16.14	12.72	13.35	13.70	14.33	15.63
4H	2H	10.94	11.69	11.90	12.65	13.92	10.58	11.34	11.55	12.30	13.56
	3H	12.78	13.41	13.76	14.41	15.68	12.38	13.00	13.35	14.00	15.27
	4H	13.48	14.06	14.47	15.04	16.35	13.06	13.63	14.04	14.62	15.92
	6H	13.98	14.48	14.98	15.49	16.79	13.55	14.04	14.54	15.06	16.35
	8H	14.12	14.58	15.12	15.59	16.90	13.69	14.15	14.68	15.15	16.46
	12H	14.19	14.61	15.20	15.62	16.94	13.74	14.16	14.75	15.18	16.50
8H	4H	13.67	14.13	14.67	15.14	16.45	13.29	13.76	14.29	14.76	16.07
	6H	14.28	14.66	15.30	15.71	17.02	13.89	14.28	14.92	15.32	16.63
	8H	14.49	14.82	15.52	15.86	17.19	14.09	14.43	15.12	15.46	16.79
	12H	14.61	14.90	15.64	15.93	17.30	14.20	14.49	15.23	15.52	16.89
12H	4H	13.65	14.07	14.67	15.09	16.41	13.29	13.70	14.30	14.72	16.04
	6H	14.30	14.64	15.33	15.67	17.00	13.93	14.27	14.96	15.30	16.63
	8H	14.53	14.83	15.56	15.85	17.23	14.15	14.45	15.18	15.47	16.85

END OF REPORT