

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903484

Luminaire Tested: DFN2DIP-SQ2F0-030D070US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903484
REPORT IS A COMBINATION OF REPORTS P899819 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-030D070US830-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8638.4 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 77.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903484

CATALOG NUMBER: DFN2DIP-SQ2F0-030D070US830-FLLFLL

Luminous Intensity Polar Plot

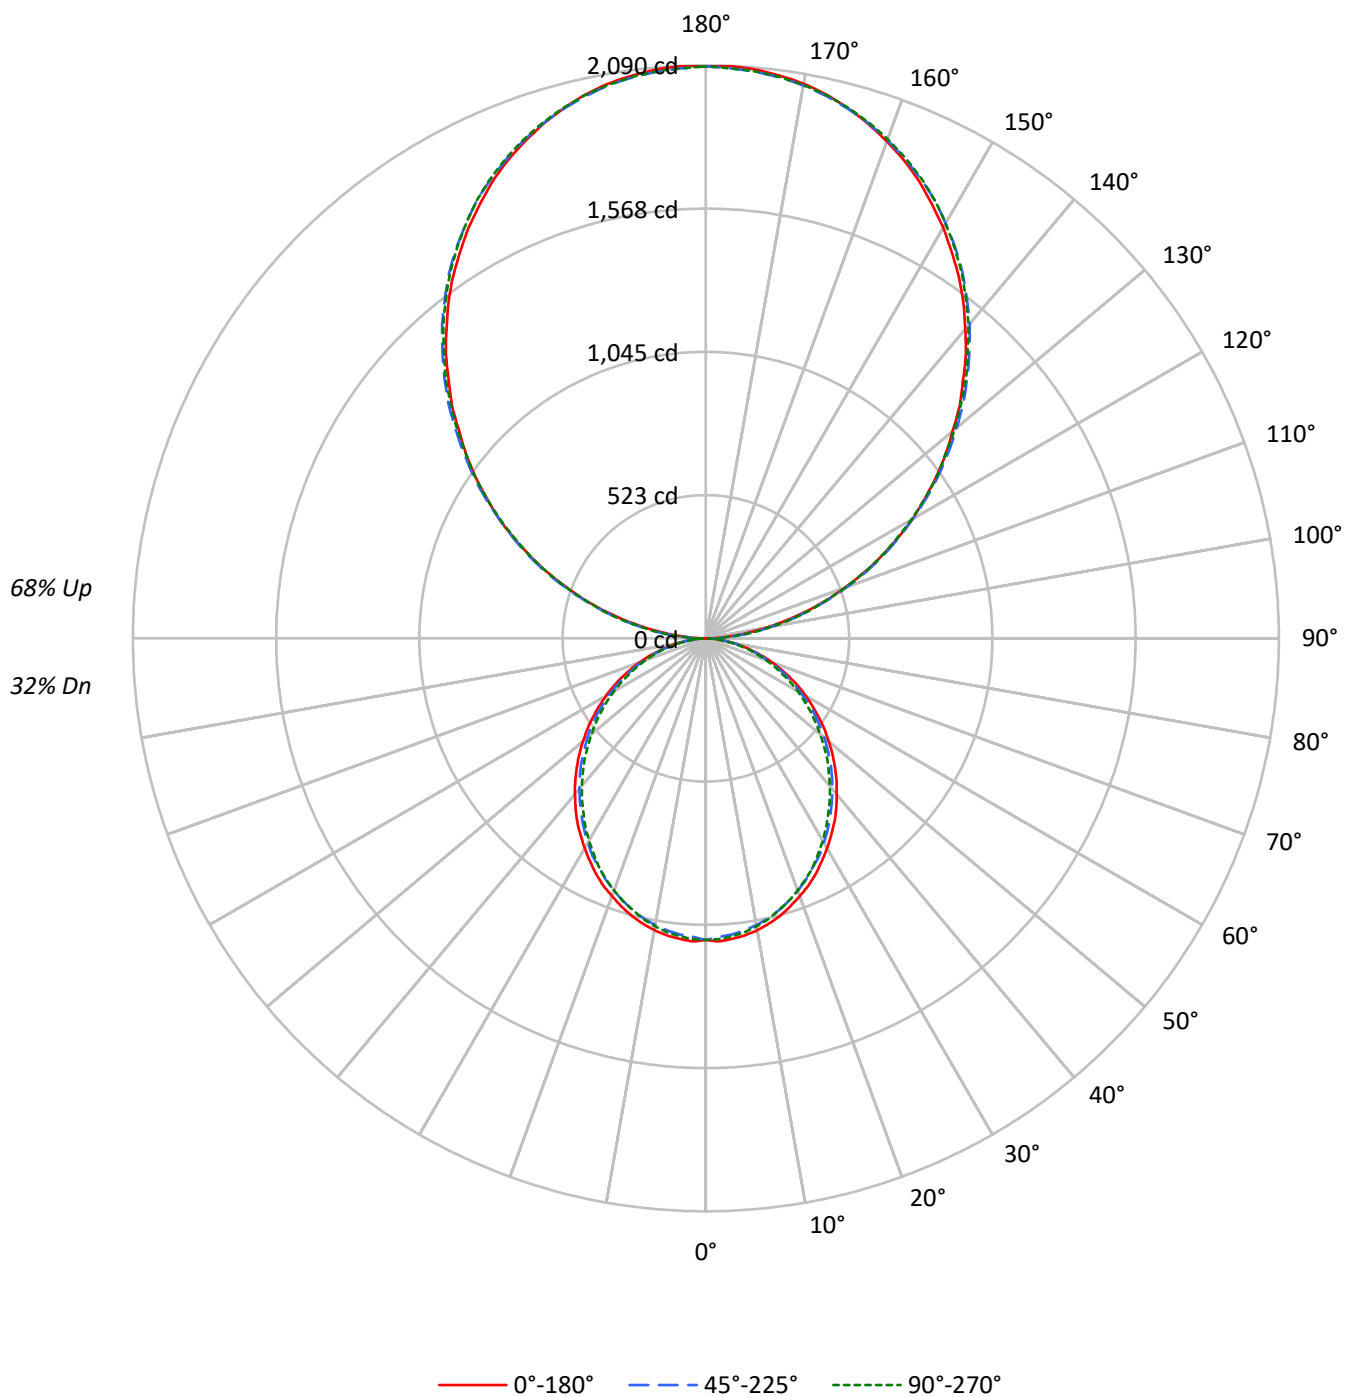

TEST NUMBER: P903484

CATALOG NUMBER: DFN2DIP-SQ2F0-030D070US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	56	56	56	40	40	40
1	94	90	86	82	84	81	78	75	64	62	60	49	48	47	35	34	34
2	85	78	72	67	77	71	66	61	56	53	50	43	41	39	31	30	28
3	78	69	62	56	70	62	56	51	50	45	42	38	35	33	28	26	24
4	71	61	53	47	64	55	48	43	44	39	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	39	34	31	30	27	24	22	20	18
6	60	48	40	35	54	44	37	32	35	30	27	27	24	21	20	18	16
7	55	43	36	30	50	40	33	28	32	27	23	25	21	19	18	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	14	13
9	48	36	29	24	43	33	26	22	27	22	18	21	17	15	15	13	11
10	44	33	26	21	40	30	24	20	24	20	16	19	16	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2419	2419	2419
5°	2419	2380	2398
10°	2395	2343	2362
15°	2356	2299	2308
20°	2304	2240	2253
25°	2252	2171	2190
30°	2189	2106	2110
35°	2128	2031	2026
40°	2054	1954	1946
45°	1980	1877	1863
50°	1899	1796	1769
55°	1814	1702	1681
60°	1717	1592	1580
65°	1611	1477	1460
70°	1477	1337	1331
75°	1292	1168	1208
80°	1066	953	982
85°	722	602	616

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2909 cd/sqm

TEST NUMBER: P903484

CATALOG NUMBER: DFN2DIP-SQ2F0-030D070US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	103.6	1.2
10°-20°	291.4	3.4
20°-30°	428.2	5.0
30°-40°	497.3	5.8
40°-50°	496.7	5.8
50°-60°	433.1	5.0
60°-70°	320.2	3.7
70°-80°	181.1	2.1
80°-90°	53.7	0.6
90°-100°	129.1	1.5
100°-110°	410.3	4.7
110°-120°	702.1	8.1
120°-130°	923.3	10.7
130°-140°	1036.4	12.0
140°-150°	1016.3	11.8
150°-160°	852.6	9.9
160°-170°	565.4	6.5
170°-180°	197.6	2.3
0°-30°	823.1	9.5
0°-40°	1320.4	15.3
0°-60°	2250.3	26.0
0°-90°	2805.3	32.5
90°-120°	1241.5	14.4
90°-150°	4217.6	48.8
90°-180°	5833.0	67.5
0°-180°	8638.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1100	1100	1100	1100	1100	
5°	1100	1096	1084	1093	1091	104
15°	1047	1041	1027	1032	1026	295
25°	948	940	922	924	922	436
35°	818	807	790	784	779	511
45°	666	658	642	631	626	514
55°	504	497	485	472	467	450
65°	340	333	323	313	308	336
75°	178	176	170	164	166	190
85°	43	42	41	38	37	48
90°	2	23	62	58	60	8
95°	92	109	113	113	109	102
105°	379	384	388	391	391	400
115°	705	715	712	710	705	697
125°	1025	1040	1036	1030	1028	916
135°	1326	1345	1349	1347	1342	1025
145°	1609	1622	1632	1634	1627	1005
155°	1840	1845	1851	1860	1854	847
165°	2002	2000	2000	2012	2004	565
175°	2083	2078	2074	2087	2076	198
180°	2087	2087	2087	2087	2087	

TEST NUMBER: P903484

CATALOG NUMBER: DFN2DIP-SQ2F0-030D070US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1100.2	1100.2	1100.2	1100.2	1100.2
2.5°	1106.6	1101.4	1089.7	1100.2	1098.3
5°	1100.2	1096.1	1084.4	1092.9	1090.8
7.5°	1092.9	1086.6	1074.9	1083.5	1081.3
10°	1081.3	1073.8	1061.2	1069.6	1066.5
12.5°	1065.4	1059.0	1046.4	1051.6	1049.5
15°	1047.4	1041.1	1027.3	1031.5	1026.2
17.5°	1025.1	1018.9	1005.0	1010.3	1005.0
20°	1000.8	994.5	979.7	982.8	978.6
22.5°	976.6	967.0	953.2	953.2	951.0
25°	947.9	939.5	921.5	923.6	921.5
27.5°	916.2	908.7	895.0	891.9	886.6
30°	884.5	876.0	860.2	857.0	852.7
32.5°	850.6	844.3	827.4	821.0	816.7
35°	817.8	807.3	790.3	783.9	778.6
37.5°	780.8	771.3	754.3	746.9	741.6
40°	742.7	734.2	717.3	707.8	703.6
42.5°	705.7	697.2	680.3	669.7	663.4
45°	665.5	658.1	642.2	630.6	626.3
47.5°	626.3	619.0	602.0	590.3	584.0
50°	585.0	579.8	565.0	550.2	544.9
52.5°	544.9	537.4	523.8	512.1	504.6
55°	503.7	497.3	484.6	471.9	466.7
57.5°	462.3	457.0	443.3	430.6	426.3
60°	421.0	416.9	402.1	390.4	387.3
62.5°	380.9	373.4	362.9	352.3	348.1
65°	339.7	333.3	322.7	313.2	307.9
67.5°	297.4	292.0	282.5	275.1	270.9
70°	258.2	253.9	244.4	237.0	232.8
72.5°	218.0	213.7	208.4	201.0	197.9
75°	177.7	175.7	170.3	164.0	166.2
77.5°	141.8	137.5	135.3	132.2	129.1
80°	105.8	104.7	102.5	99.4	97.4
82.5°	71.9	71.9	71.0	66.6	66.6
85°	43.4	42.3	41.3	38.1	37.0
87.5°	19.0	17.0	14.8	11.7	10.6
90°	1.9	22.6	61.6	57.9	59.8
92.5°	39.0	52.9	54.8	56.6	56.6
95°	91.8	109.4	112.6	112.6	109.4
97.5°	152.9	169.2	176.2	176.2	176.2
100°	223.3	237.8	242.8	242.8	240.9
102.5°	297.6	308.2	315.2	317.1	315.2
105°	378.7	383.7	387.5	390.7	390.7
107.5°	459.2	466.7	466.7	468.1	459.2
110°	537.2	547.3	547.3	547.3	542.2

TEST NUMBER: P903484

CATALOG NUMBER: DFN2DIP-SQ2F0-030D070US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	621.5	632.3	630.4	625.3	621.5
115°	704.6	714.6	711.5	709.6	704.6
117.5°	786.9	800.8	792.0	786.9	781.9
120°	870.0	883.8	870.0	870.0	864.3
122.5°	945.5	963.1	954.3	949.2	945.5
125°	1024.7	1040.5	1035.5	1029.8	1027.9
127.5°	1102.1	1121.6	1114.7	1107.2	1102.1
130°	1174.5	1197.1	1194.0	1190.2	1183.3
132.5°	1255.7	1273.3	1274.5	1265.7	1260.7
135°	1325.5	1344.9	1348.8	1346.8	1341.8
137.5°	1403.4	1419.2	1422.3	1421.1	1413.5
140°	1472.1	1487.8	1496.6	1496.6	1489.7
142.5°	1542.5	1558.2	1563.2	1565.1	1558.2
145°	1609.2	1621.7	1631.8	1633.7	1626.8
147.5°	1669.0	1684.7	1692.2	1695.4	1688.5
150°	1730.6	1741.3	1748.2	1753.9	1748.2
152.5°	1785.3	1796.0	1804.8	1811.8	1804.8
155°	1840.0	1845.0	1850.8	1859.5	1853.9
157.5°	1887.3	1891.0	1894.1	1906.8	1897.9
160°	1929.4	1933.2	1935.0	1945.7	1938.1
162.5°	1968.4	1968.4	1970.3	1982.2	1973.4
165°	2001.7	1999.8	1999.8	2012.4	2003.6
167.5°	2031.9	2026.3	2026.3	2038.8	2030.0
170°	2054.6	2049.6	2047.7	2060.2	2049.6
172.5°	2070.3	2065.2	2063.3	2075.9	2065.2
175°	2082.8	2077.8	2074.1	2086.6	2075.9
177.5°	2089.8	2084.7	2080.9	2091.7	2080.9
180°	2086.6	2086.6	2086.6	2086.6	2086.6



TEST NUMBER: P903484

CATALOG NUMBER: DFN2DIP-SQ2F0-030D070US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.34	9.06	9.43	10.15	11.65	7.89	8.62	8.99	9.71	11.21
	3H	9.97	10.61	11.07	11.72	13.23	9.48	10.13	10.58	11.23	12.74
	4H	10.54	11.15	11.65	12.25	13.78	10.04	10.66	11.16	11.76	13.28
	6H	10.91	11.48	12.03	12.58	14.12	10.41	10.98	11.54	12.08	13.62
	8H	11.01	11.54	12.13	12.66	14.19	10.51	11.04	11.63	12.16	13.69
	12H	11.04	11.55	12.17	12.67	14.22	10.53	11.05	11.66	12.16	13.71
4H	2H	8.77	9.38	9.89	10.49	12.01	8.41	9.03	9.53	10.13	11.66
	3H	10.60	11.11	11.73	12.24	13.78	10.19	10.71	11.32	11.83	13.37
	4H	11.29	11.76	12.42	12.88	14.44	10.87	11.34	12.00	12.46	14.02
	6H	11.78	12.19	12.92	13.33	14.87	11.35	11.75	12.49	12.89	14.44
	8H	11.92	12.30	13.05	13.43	14.99	11.48	11.86	12.62	12.99	14.56
	12H	11.98	12.32	13.13	13.46	15.03	11.53	11.87	12.68	13.01	14.58
8H	4H	11.47	11.84	12.60	12.98	14.54	11.09	11.47	12.23	12.60	14.16
	6H	12.07	12.38	13.23	13.55	15.12	11.68	12.00	12.84	13.17	14.73
	8H	12.27	12.55	13.44	13.70	15.28	11.88	12.15	13.04	13.31	14.89
	12H	12.39	12.63	13.55	13.78	15.39	11.98	12.22	13.14	13.37	14.98
12H	4H	11.44	11.79	12.60	12.93	14.50	11.07	11.42	12.23	12.56	14.13
	6H	12.09	12.36	13.26	13.52	15.10	11.72	11.99	12.88	13.14	14.73
	8H	12.31	12.55	13.48	13.70	15.32	11.93	12.17	13.10	13.32	14.94

END OF REPORT