

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903503

Luminaire Tested: DFN2DIP-SQ2F0-040D050US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903503
REPORT IS A COMBINATION OF REPORTS P901318 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D050US830-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7870.2 lumens
Efficiency: N/A
Efficacy: 110.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 71.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903503

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US830-RLLONL

Luminous Intensity Polar Plot

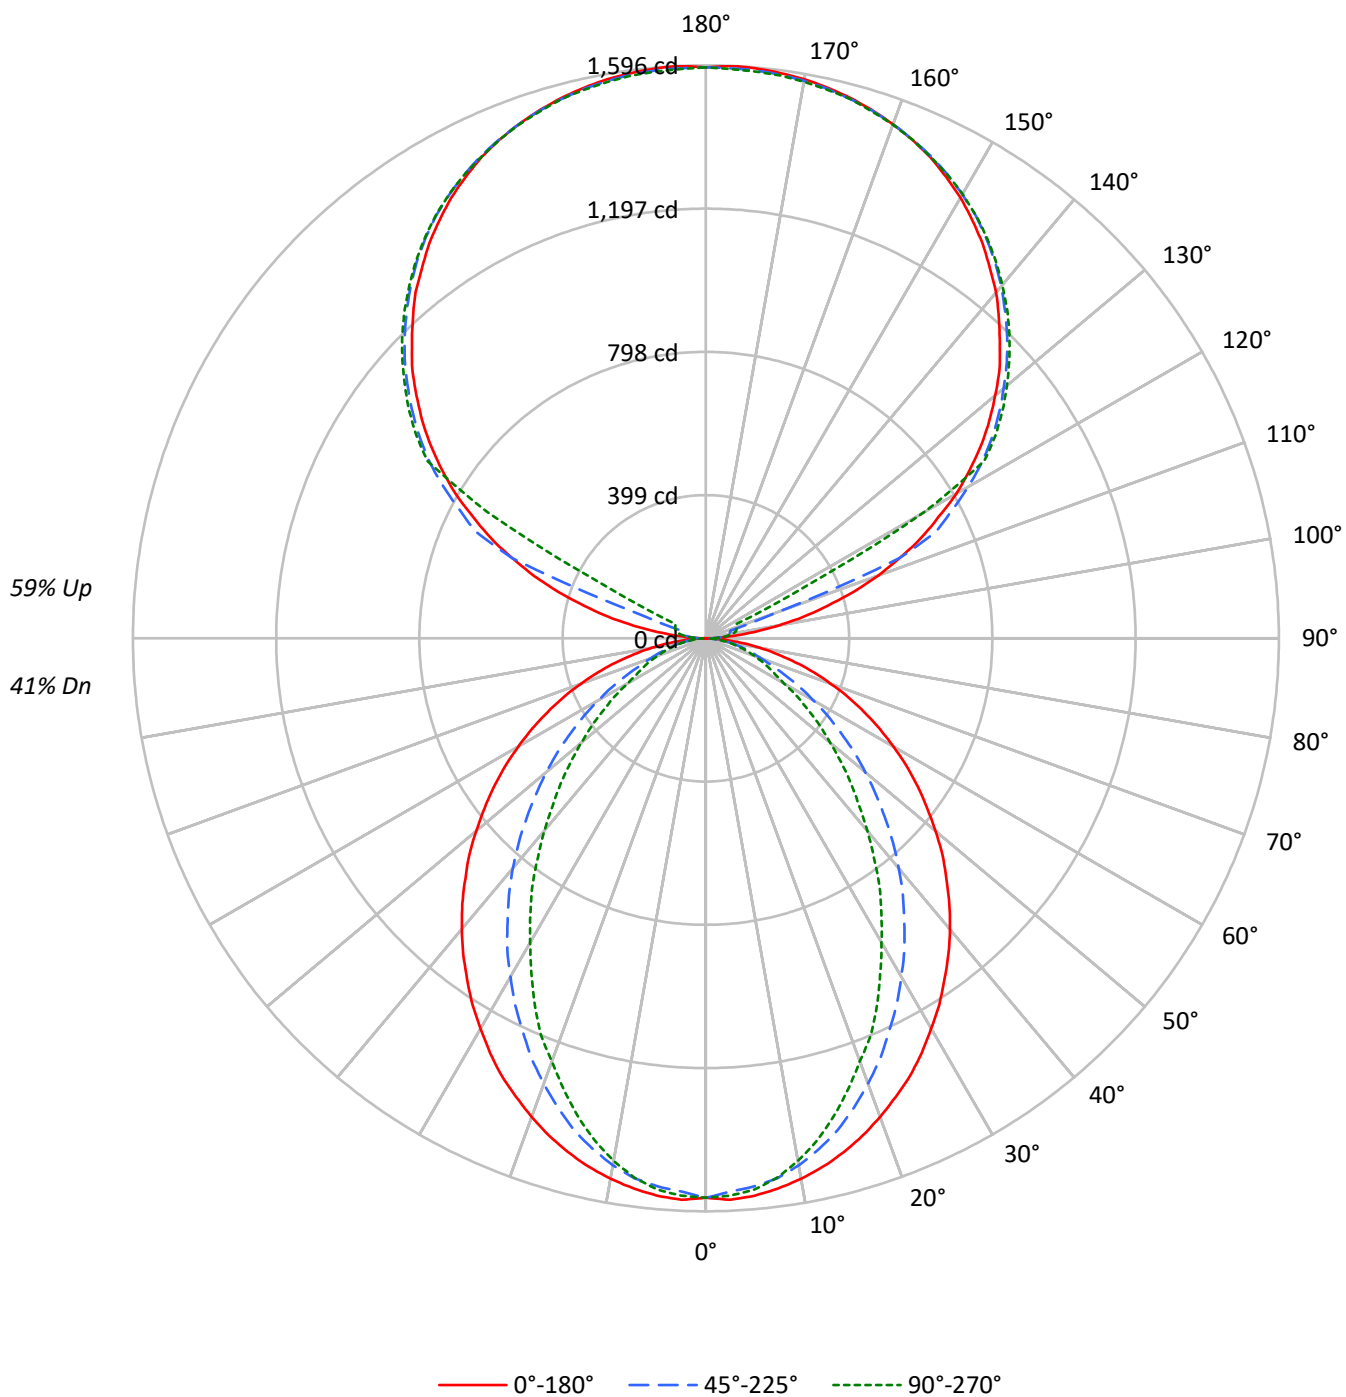

TEST NUMBER: P903503

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48
1	96	92	88	85	87	84	81	78	69	67	65	55	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	57	54	49	47	44	38	36	35
3	80	71	64	59	73	65	59	54	54	50	46	44	41	38	34	32	30
4	74	63	56	50	67	58	52	46	48	43	40	39	36	33	31	28	26
5	68	57	49	43	62	52	45	40	43	38	34	35	32	29	28	25	23
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	25	23	21
7	58	46	38	33	53	42	36	31	36	30	27	29	25	23	23	21	19
8	54	42	34	29	49	39	32	27	33	27	24	27	23	20	21	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	28	23	19	23	19	17	18	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3426	3426	3426
5°	3426	3365	3389
10°	3386	3291	3274
15°	3334	3175	3099
20°	3266	3018	2886
25°	3197	2844	2680
30°	3106	2665	2422
35°	3016	2475	2194
40°	2925	2278	1935
45°	2819	2061	1699
50°	2710	1842	1469
55°	2595	1610	1249
60°	2461	1368	1024
65°	2308	1122	916
70°	2121	894	822
75°	1886	774	739
80°	1548	628	626
85°	1008	391	446

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2819 cd/sqm

TEST NUMBER: P903503

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	146.0	1.9
10°-20°	400.9	5.1
20°-30°	562.8	7.2
30°-40°	613.5	7.8
40°-50°	563.9	7.2
50°-60°	442.9	5.6
60°-70°	288.3	3.7
70°-80°	148.4	1.9
80°-90°	40.7	0.5
90°-100°	52.5	0.7
100°-110°	195.5	2.5
110°-120°	518.5	6.6
120°-130°	860.0	10.9
130°-140°	913.5	11.6
140°-150°	849.0	10.8
150°-160°	682.6	8.7
160°-170°	439.8	5.6
170°-180°	151.4	1.9
0°-30°	1109.8	14.1
0°-40°	1723.3	21.9
0°-60°	2730.1	34.7
0°-90°	3207.4	40.8
90°-120°	766.5	9.7
90°-150°	3389.0	43.1
90°-180°	4663.0	59.2
0°-180°	7870.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1558	1558	1558	1558	1558	
5°	1558	1551	1533	1546	1541	148
15°	1482	1466	1419	1392	1378	418
25°	1345	1300	1207	1149	1128	619
35°	1159	1087	963	874	843	726
45°	948	853	705	605	571	732
55°	721	611	458	374	347	644
65°	486	372	245	198	193	482
75°	259	161	113	103	102	274
85°	61	31	27	27	27	70
90°	1	14	23	29	31	7
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P903503

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1558.2	1558.2	1558.2	1558.2	1558.2
2.5°	1565.3	1558.2	1542.7	1556.9	1554.0
5°	1558.2	1551.1	1532.8	1545.5	1541.3
7.5°	1545.5	1537.1	1517.4	1522.9	1515.9
10°	1528.6	1518.7	1490.5	1486.2	1477.9
12.5°	1507.5	1494.8	1456.6	1448.2	1432.7
15°	1482.1	1466.5	1418.6	1391.9	1377.8
17.5°	1452.5	1429.8	1370.6	1339.6	1317.0
20°	1418.6	1390.3	1319.8	1284.7	1253.6
22.5°	1382.0	1349.5	1267.6	1219.7	1198.7
25°	1345.3	1300.1	1207.0	1149.3	1128.0
27.5°	1301.7	1253.6	1150.7	1084.4	1051.9
30°	1255.1	1201.4	1088.5	1016.7	978.6
32.5°	1209.9	1145.0	1029.4	944.8	909.5
35°	1159.2	1087.2	963.2	874.3	843.2
37.5°	1109.8	1032.2	901.1	803.7	768.5
40°	1057.6	973.1	836.2	736.1	699.5
42.5°	1004.0	913.8	771.4	666.9	631.8
45°	947.6	853.1	705.1	604.9	571.1
47.5°	894.1	794.0	641.7	541.5	510.5
50°	834.8	734.7	579.6	482.2	452.7
52.5°	776.9	671.2	520.4	427.3	400.5
55°	720.6	610.6	458.3	373.7	346.9
57.5°	662.8	550.0	403.3	324.3	301.8
60°	603.5	490.7	345.4	273.6	251.1
62.5°	545.8	433.0	296.1	228.5	217.3
65°	486.5	372.2	245.3	197.5	193.1
67.5°	430.2	315.8	197.5	173.4	169.2
70°	370.9	260.9	163.5	149.5	143.7
72.5°	314.5	210.1	136.8	125.5	122.7
75°	259.4	160.7	112.8	102.9	101.6
77.5°	204.5	114.1	88.9	83.2	80.3
80°	153.6	81.8	67.6	62.1	62.1
82.5°	107.2	55.0	46.6	43.6	43.6
85°	60.6	31.0	26.8	26.8	26.8
87.5°	22.6	11.2	11.2	9.9	9.9
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9

TEST NUMBER: P903503

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P903503

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.38	11.14	11.42	12.18	13.58	6.34	7.10	7.38	8.14	9.54
	3H	12.03	12.71	13.08	13.76	15.18	7.51	8.19	8.56	9.24	10.66
	4H	12.63	13.27	13.69	14.32	15.75	7.94	8.58	9.00	9.64	11.06
	6H	13.03	13.62	14.10	14.68	16.11	8.24	8.83	9.31	9.89	11.33
	8H	13.14	13.71	14.22	14.78	16.21	8.32	8.88	9.40	9.96	11.39
	12H	13.20	13.73	14.28	14.80	16.25	8.36	8.89	9.43	9.95	11.41
4H	2H	10.39	11.03	11.45	12.08	13.51	6.92	7.56	7.99	8.61	10.04
	3H	12.19	12.72	13.26	13.80	15.24	8.24	8.78	9.31	9.86	11.29
	4H	12.86	13.35	13.94	14.42	15.88	8.77	9.26	9.85	10.33	11.79
	6H	13.35	13.77	14.44	14.87	16.32	9.17	9.59	10.25	10.68	12.14
	8H	13.52	13.91	14.60	14.99	16.46	9.28	9.68	10.37	10.76	12.23
	12H	13.60	13.95	14.70	15.05	16.53	9.33	9.69	10.44	10.79	12.26
8H	4H	12.82	13.21	13.91	14.30	15.77	9.03	9.43	10.12	10.51	11.98
	6H	13.36	13.68	14.47	14.81	16.28	9.53	9.85	10.64	10.98	12.44
	8H	13.56	13.85	14.68	14.96	16.44	9.70	9.98	10.82	11.09	12.58
	12H	13.69	13.94	14.81	15.04	16.57	9.80	10.05	10.92	11.16	12.68
12H	4H	12.77	13.12	13.87	14.22	15.70	9.03	9.39	10.14	10.49	11.96
	6H	13.33	13.62	14.45	14.73	16.21	9.57	9.85	10.69	10.96	12.45
	8H	13.54	13.79	14.66	14.89	16.42	9.76	10.01	10.88	11.11	12.64

END OF REPORT