

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903507

Luminaire Tested: DFN2DIP-SQ2F0-040D060US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903507
REPORT IS A COMBINATION OF REPORTS P901330 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D060US830-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8803.3 lumens
Efficiency: N/A
Efficacy: 110.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 79.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903507

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US830-RLLONL

Luminous Intensity Polar Plot

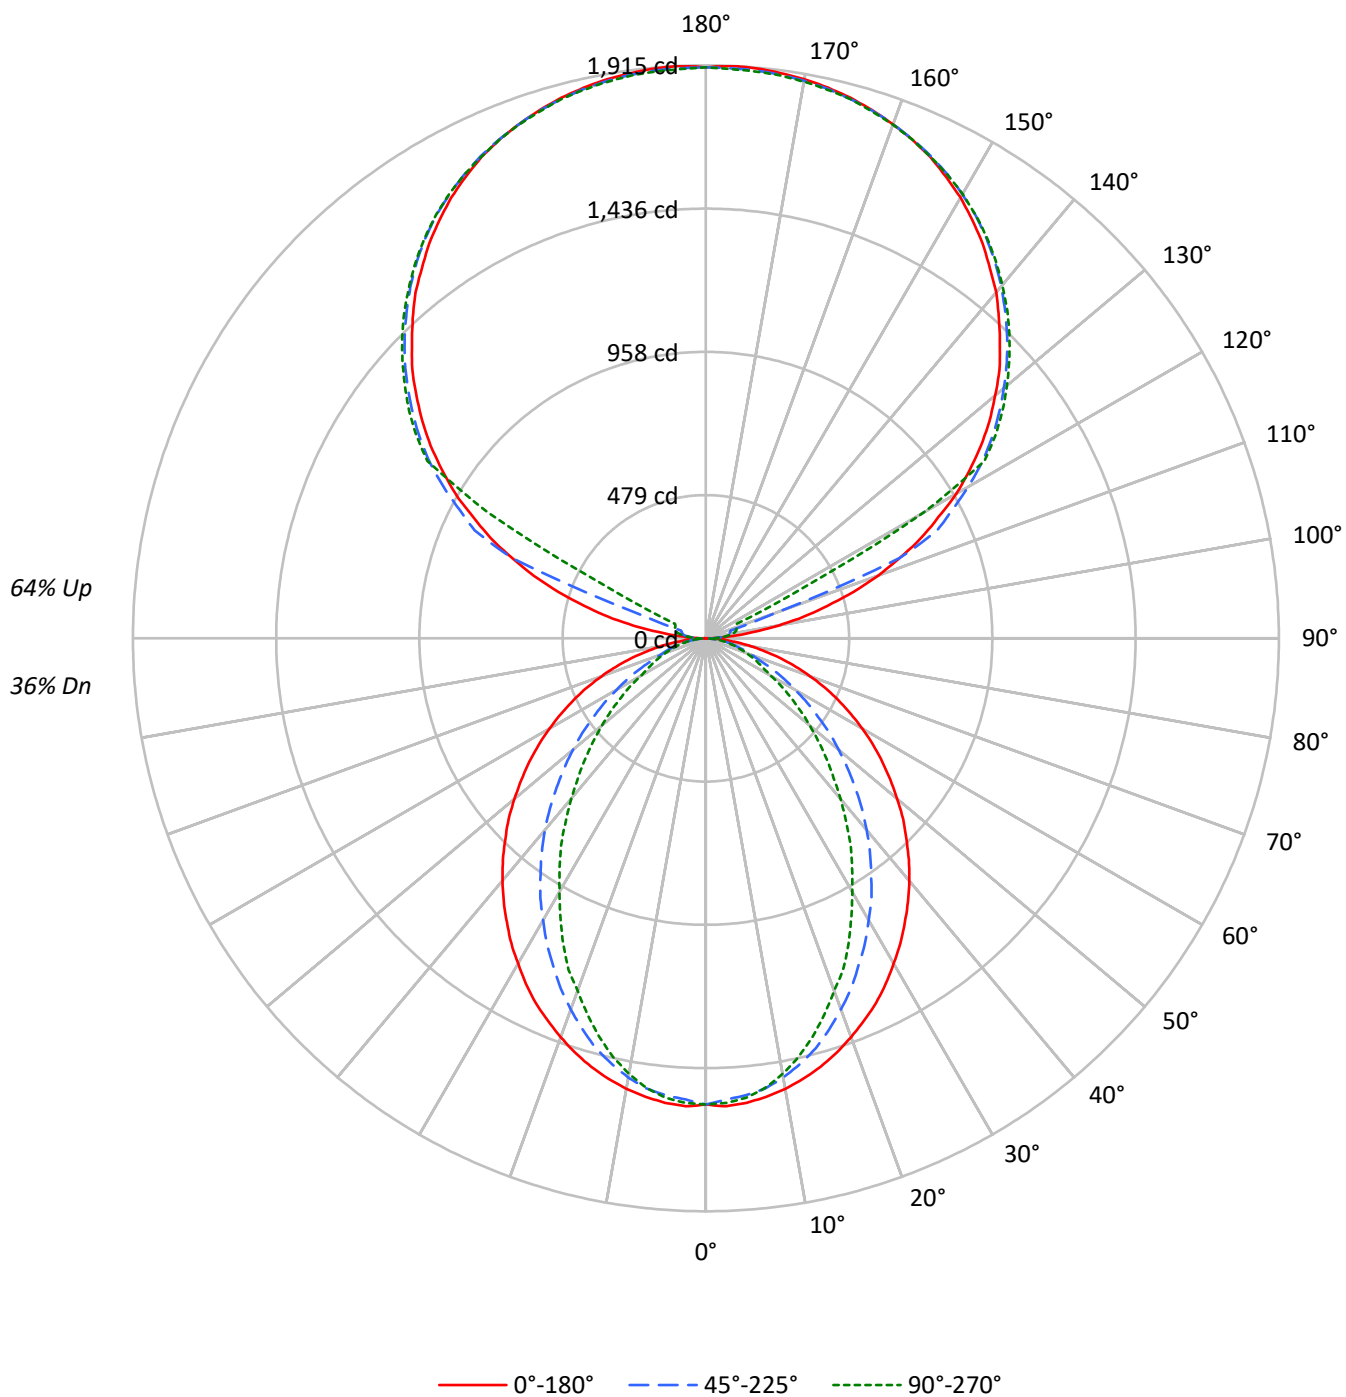

TEST NUMBER: P903507

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	52	51	50	39	38	38
2	87	80	74	69	78	73	68	63	59	56	53	46	44	42	35	33	32
3	79	70	63	58	72	64	58	53	52	48	45	41	38	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	37	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	15	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3426	3426	3426
5°	3426	3365	3389
10°	3386	3291	3274
15°	3334	3175	3099
20°	3266	3018	2886
25°	3197	2844	2680
30°	3106	2665	2422
35°	3016	2475	2194
40°	2925	2278	1935
45°	2819	2061	1699
50°	2710	1842	1469
55°	2595	1610	1249
60°	2461	1368	1024
65°	2308	1122	916
70°	2121	894	822
75°	1886	774	739
80°	1548	628	626
85°	1008	391	446

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2819 cd/sqm

TEST NUMBER: P903507

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	146.0	1.7
10°-20°	400.9	4.6
20°-30°	562.8	6.4
30°-40°	613.5	7.0
40°-50°	563.9	6.4
50°-60°	442.9	5.0
60°-70°	288.3	3.3
70°-80°	148.4	1.7
80°-90°	41.2	0.5
90°-100°	62.9	0.7
100°-110°	234.6	2.7
110°-120°	622.2	7.1
120°-130°	1032.0	11.7
130°-140°	1096.2	12.5
140°-150°	1018.8	11.6
150°-160°	819.1	9.3
160°-170°	527.8	6.0
170°-180°	181.7	2.1
0°-30°	1109.8	12.6
0°-40°	1723.3	19.6
0°-60°	2730.1	31.0
0°-90°	3208.0	36.4
90°-120°	919.8	10.4
90°-150°	4066.8	46.2
90°-180°	5595.0	63.6
0°-180°	8803.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1558	1558	1558	1558	1558	
5°	1558	1551	1533	1546	1541	148
15°	1482	1466	1419	1392	1378	418
25°	1345	1300	1207	1149	1128	619
35°	1159	1087	963	874	843	726
45°	948	853	705	605	571	732
55°	721	611	458	374	347	644
65°	486	372	245	198	193	482
75°	259	161	113	103	102	274
85°	61	31	27	27	27	70
90°	1	17	28	35	37	8
95°	90	44	54	61	59	106
105°	420	461	84	99	105	449
115°	794	818	852	213	113	782
125°	1123	1141	1167	1177	1181	1001
135°	1389	1412	1424	1438	1435	1073
145°	1612	1610	1634	1643	1636	1008
155°	1775	1762	1779	1787	1776	818
165°	1870	1862	1866	1876	1866	528
175°	1913	1903	1906	1915	1902	182
180°	1909	1909	1909	1909	1909	

TEST NUMBER: P903507

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1558.2	1558.2	1558.2	1558.2	1558.2
2.5°	1565.3	1558.2	1542.7	1556.9	1554.0
5°	1558.2	1551.1	1532.8	1545.5	1541.3
7.5°	1545.5	1537.1	1517.4	1522.9	1515.9
10°	1528.6	1518.7	1490.5	1486.2	1477.9
12.5°	1507.5	1494.8	1456.6	1448.2	1432.7
15°	1482.1	1466.5	1418.6	1391.9	1377.8
17.5°	1452.5	1429.8	1370.6	1339.6	1317.0
20°	1418.6	1390.3	1319.8	1284.7	1253.6
22.5°	1382.0	1349.5	1267.6	1219.7	1198.7
25°	1345.3	1300.1	1207.0	1149.3	1128.0
27.5°	1301.7	1253.6	1150.7	1084.4	1051.9
30°	1255.1	1201.4	1088.5	1016.7	978.6
32.5°	1209.9	1145.0	1029.4	944.8	909.5
35°	1159.2	1087.2	963.2	874.3	843.2
37.5°	1109.8	1032.2	901.1	803.7	768.5
40°	1057.6	973.1	836.2	736.1	699.5
42.5°	1004.0	913.8	771.4	666.9	631.8
45°	947.6	853.1	705.1	604.9	571.1
47.5°	894.1	794.0	641.7	541.5	510.5
50°	834.8	734.7	579.6	482.2	452.7
52.5°	776.9	671.2	520.4	427.3	400.5
55°	720.6	610.6	458.3	373.7	346.9
57.5°	662.8	550.0	403.3	324.3	301.8
60°	603.5	490.7	345.4	273.6	251.1
62.5°	545.8	433.0	296.1	228.5	217.3
65°	486.5	372.2	245.3	197.5	193.1
67.5°	430.2	315.8	197.5	173.4	169.2
70°	370.9	260.9	163.5	149.5	143.7
72.5°	314.5	210.1	136.8	125.5	122.7
75°	259.4	160.7	112.8	102.9	101.6
77.5°	204.5	114.1	88.9	83.2	80.3
80°	153.6	81.8	67.6	62.1	62.1
82.5°	107.2	55.0	46.6	43.6	43.6
85°	60.6	31.0	26.8	26.8	26.8
87.5°	22.6	11.2	11.2	9.9	9.9
90°	1.3	16.6	27.5	34.6	37.2
92.5°	34.6	29.0	33.1	35.9	37.2
95°	89.7	44.1	53.8	60.9	59.4
97.5°	161.6	48.4	70.3	74.6	76.0
100°	244.5	55.2	78.7	89.7	92.5
102.5°	335.5	332.9	81.5	96.6	100.9
105°	419.8	461.3	84.3	99.3	105.0
107.5°	517.9	552.3	87.1	102.2	107.7
110°	611.9	640.7	241.8	103.7	109.1

TEST NUMBER: P903507

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	700.2	725.0	701.5	106.2	110.6
115°	794.1	817.6	852.2	212.7	113.3
117.5°	875.5	903.1	926.7	729.2	367.3
120°	966.8	987.4	1012.4	1028.9	842.4
122.5°	1044.0	1066.1	1093.8	1102.0	1103.5
125°	1122.8	1140.8	1167.0	1176.7	1180.7
127.5°	1194.6	1213.9	1234.7	1248.5	1249.8
130°	1262.3	1284.4	1299.5	1314.8	1313.4
132.5°	1331.3	1349.3	1364.4	1376.9	1375.5
135°	1389.4	1411.6	1423.8	1437.8	1434.9
137.5°	1450.0	1466.6	1480.5	1494.3	1490.3
140°	1509.4	1520.6	1535.7	1548.1	1541.2
142.5°	1559.2	1569.0	1586.9	1597.8	1590.9
145°	1611.7	1610.2	1633.7	1643.4	1636.5
147.5°	1657.2	1653.0	1676.5	1683.4	1678.0
150°	1701.5	1691.8	1713.9	1722.1	1715.2
152.5°	1738.7	1727.7	1748.3	1756.7	1747.0
155°	1774.6	1762.3	1778.9	1787.1	1776.0
157.5°	1803.6	1792.6	1805.1	1814.8	1803.6
160°	1828.5	1820.1	1828.5	1836.7	1827.1
162.5°	1850.5	1842.3	1849.2	1858.9	1846.4
165°	1869.9	1861.7	1865.8	1875.5	1865.8
167.5°	1885.1	1876.8	1881.0	1890.7	1878.2
170°	1897.6	1889.2	1892.1	1901.7	1889.2
172.5°	1905.8	1897.6	1900.4	1910.1	1897.6
175°	1912.7	1903.0	1905.8	1915.4	1901.7
177.5°	1915.4	1905.8	1907.2	1916.9	1904.5
180°	1908.6	1908.6	1908.6	1908.6	1908.6

TEST NUMBER: P903507

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.90	10.63	10.97	11.70	13.15	5.86	6.59	6.93	7.65	9.11
	3H	11.55	12.20	12.63	13.28	14.75	7.02	7.67	8.10	8.75	10.22
	4H	12.14	12.76	13.23	13.84	15.31	7.45	8.07	8.54	9.15	10.63
	6H	12.54	13.11	13.64	14.19	15.68	7.75	8.32	8.85	9.40	10.89
	8H	12.65	13.19	13.76	14.29	15.78	7.83	8.37	8.93	9.47	10.95
	12H	12.70	13.22	13.81	14.31	15.82	7.86	8.38	8.97	9.47	10.98
4H	2H	9.90	10.52	11.00	11.59	13.07	6.43	7.05	7.53	8.13	9.61
	3H	11.69	12.21	12.80	13.32	14.81	7.75	8.26	8.85	9.37	10.86
	4H	12.37	12.84	13.48	13.94	15.45	8.28	8.75	9.39	9.84	11.36
	6H	12.86	13.26	13.97	14.38	15.89	8.67	9.08	9.79	10.19	11.70
	8H	13.02	13.40	14.14	14.51	16.03	8.79	9.16	9.90	10.28	11.80
	12H	13.10	13.44	14.23	14.57	16.09	8.84	9.18	9.97	10.30	11.83
8H	4H	12.32	12.70	13.44	13.81	15.33	8.54	8.92	9.65	10.03	11.55
	6H	12.86	13.18	14.00	14.33	15.85	9.03	9.34	10.17	10.49	12.01
	8H	13.07	13.34	14.21	14.47	16.01	9.20	9.48	10.35	10.61	12.15
	12H	13.19	13.43	14.33	14.56	16.13	9.30	9.54	10.45	10.67	12.25
12H	4H	12.27	12.61	13.40	13.74	15.26	8.53	8.88	9.67	10.00	11.53
	6H	12.84	13.11	13.98	14.24	15.78	9.07	9.34	10.22	10.48	12.02
	8H	13.04	13.28	14.19	14.41	15.98	9.26	9.50	10.41	10.63	12.21

END OF REPORT