

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903521

Luminaire Tested: DFN2DIP-SQ2F0-050D040US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903521
REPORT IS A COMBINATION OF REPORTS P901307 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D040US830-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8398.1 lumens
Efficiency: N/A
Efficacy: 113.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 73.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903521

CATALOG NUMBER: DFN2DIP-SQ2F0-050D040US830-FLLONL

Luminous Intensity Polar Plot

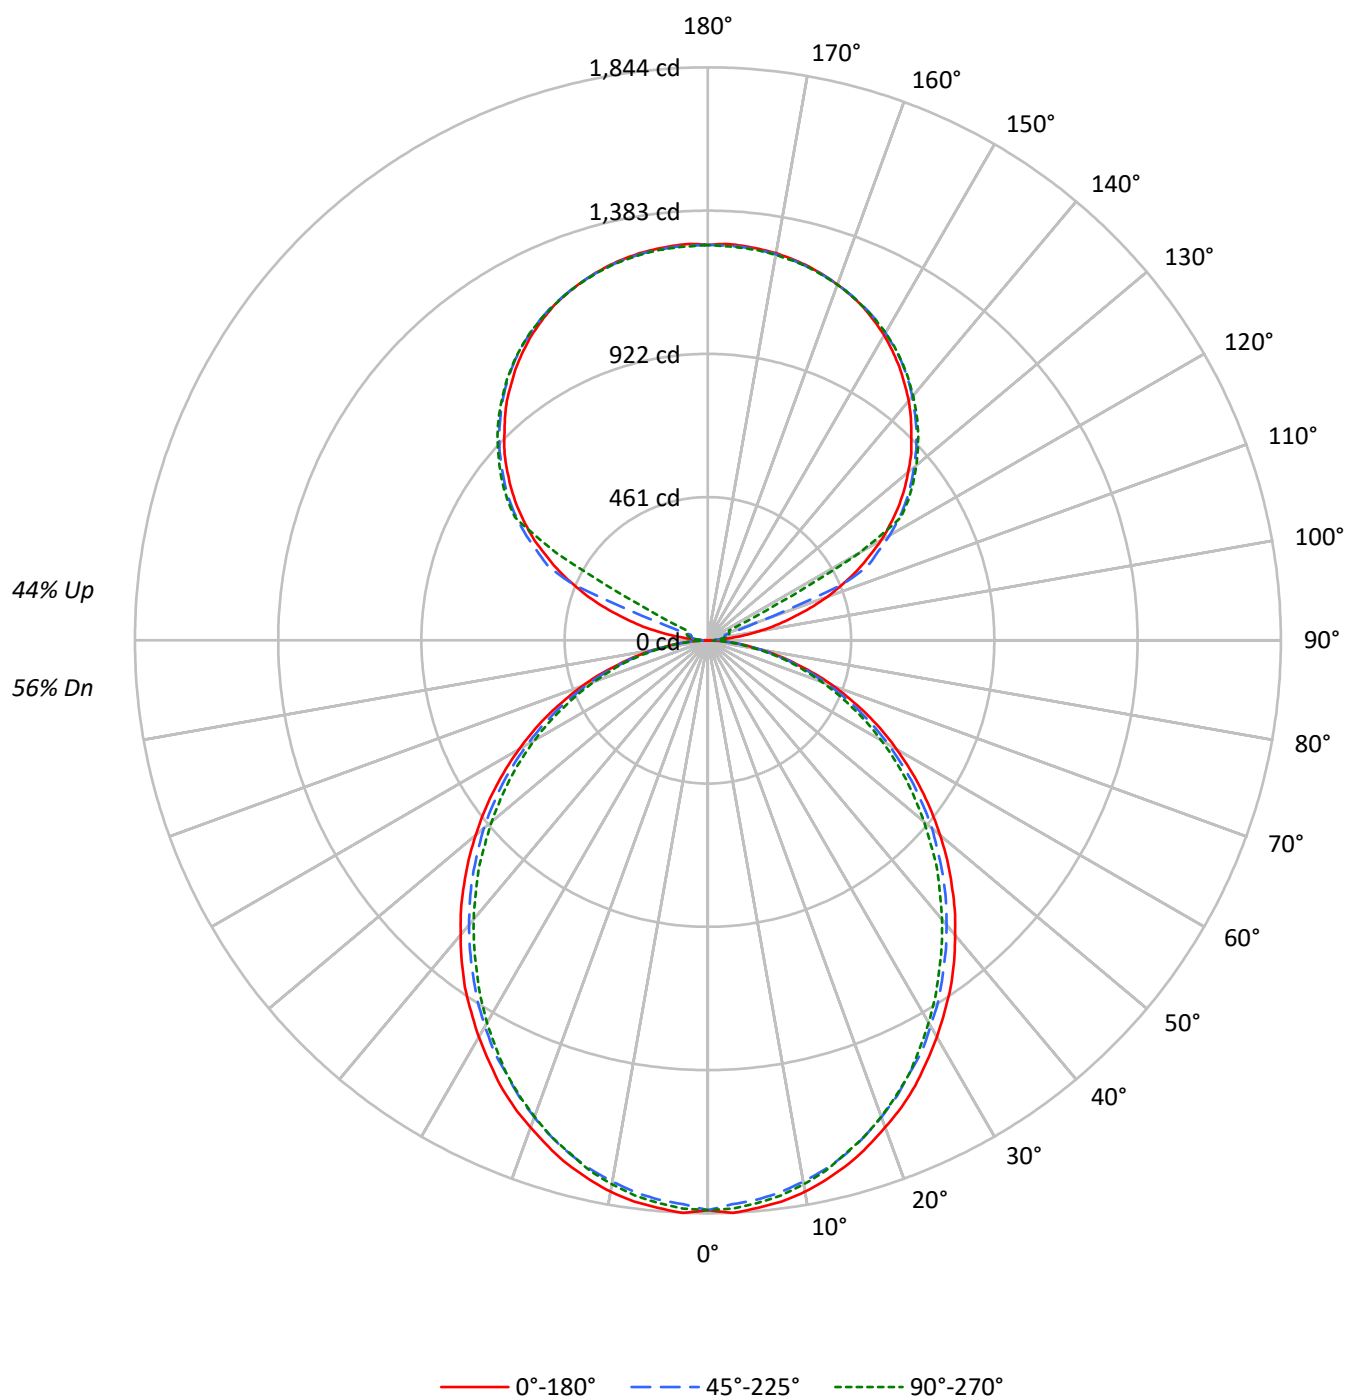

TEST NUMBER: P903521

CATALOG NUMBER: DFN2DIP-SQ2F0-050D040US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	101	101	101	101	86	86	86	73	73	73	61	61	61
1	99	95	91	87	92	88	85	82	76	73	71	65	63	61	54	53	52
2	90	83	76	71	84	77	72	67	66	62	59	57	54	51	48	46	44
3	82	73	65	59	76	68	61	56	59	54	50	50	46	43	42	39	37
4	75	64	56	50	70	60	53	48	52	47	42	45	40	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	36	40	36	32	34	31	28
6	64	52	43	37	59	48	41	36	42	36	32	36	32	28	31	27	25
7	59	47	39	33	55	44	36	31	38	32	28	33	28	25	28	25	22
8	55	42	34	29	51	40	33	28	35	29	25	30	26	22	26	22	20
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	18
10	48	35	28	23	44	33	27	22	29	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4032	4032	4032
5°	4032	3967	3997
10°	3992	3905	3937
15°	3926	3832	3847
20°	3840	3734	3755
25°	3754	3619	3649
30°	3648	3510	3517
35°	3547	3384	3377
40°	3423	3257	3243
45°	3300	3128	3106
50°	3165	2993	2947
55°	3023	2837	2801
60°	2862	2653	2633
65°	2685	2461	2434
70°	2461	2227	2219
75°	2153	1947	2013
80°	1778	1589	1635
85°	1201	1003	1026

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3300 cd/sqm

TEST NUMBER: P903521

CATALOG NUMBER: DFN2DIP-SQ2F0-050D040US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.6	2.1
10°-20°	485.6	5.8
20°-30°	713.7	8.5
30°-40°	828.9	9.9
40°-50°	827.8	9.9
50°-60°	721.8	8.6
60°-70°	533.6	6.4
70°-80°	301.9	3.6
80°-90°	81.9	1.0
90°-100°	41.9	0.5
100°-110°	156.4	1.9
110°-120°	414.8	4.9
120°-130°	688.0	8.2
130°-140°	730.8	8.7
140°-150°	679.2	8.1
150°-160°	546.1	6.5
160°-170°	351.9	4.2
170°-180°	121.1	1.4
0°-30°	1371.9	16.3
0°-40°	2200.7	26.2
0°-60°	3750.4	44.7
0°-90°	4667.8	55.6
90°-120°	613.2	7.3
90°-150°	2711.2	32.3
90°-180°	3730.0	44.4
0°-180°	8398.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1834	1834	1834	1834	1834	
5°	1834	1827	1807	1821	1818	174
15°	1746	1735	1712	1719	1710	492
25°	1580	1566	1536	1539	1536	727
35°	1363	1346	1317	1307	1298	851
45°	1109	1097	1070	1051	1044	856
55°	839	829	808	786	778	750
65°	566	555	538	522	513	560
75°	296	293	284	273	277	316
85°	72	70	69	63	62	81
90°	1	11	18	23	25	8
95°	60	29	36	40	40	71
105°	280	308	56	66	70	299
115°	529	545	568	142	76	521
125°	748	760	778	784	787	668
135°	926	941	949	958	957	715
145°	1074	1074	1089	1096	1091	672
155°	1183	1175	1186	1191	1184	545
165°	1247	1241	1244	1250	1244	352
175°	1275	1269	1270	1277	1268	121
180°	1272	1272	1272	1272	1272	

TEST NUMBER: P903521

CATALOG NUMBER: DFN2DIP-SQ2F0-050D040US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.7	1833.7	1833.7	1833.7	1833.7
2.5°	1844.4	1835.6	1816.2	1833.7	1830.4
5°	1833.7	1826.8	1807.3	1821.4	1818.1
7.5°	1821.4	1810.9	1791.5	1805.7	1802.1
10°	1802.1	1789.8	1768.7	1782.6	1777.4
12.5°	1775.6	1765.1	1744.0	1752.8	1749.2
15°	1745.6	1735.1	1712.1	1719.3	1710.4
17.5°	1708.5	1698.1	1675.1	1683.9	1675.1
20°	1668.0	1657.6	1632.9	1638.0	1631.2
22.5°	1627.6	1611.7	1588.7	1588.7	1585.1
25°	1579.9	1565.8	1535.9	1539.3	1535.9
27.5°	1526.9	1514.6	1491.8	1486.5	1477.7
30°	1474.1	1460.0	1433.6	1428.3	1421.3
32.5°	1417.7	1407.2	1378.9	1368.3	1361.2
35°	1363.0	1345.5	1317.2	1306.6	1297.8
37.5°	1301.3	1285.4	1257.2	1244.8	1236.0
40°	1237.9	1223.7	1195.4	1179.7	1172.6
42.5°	1176.2	1162.0	1133.9	1116.1	1105.6
45°	1109.2	1096.8	1070.3	1051.0	1043.9
47.5°	1043.9	1031.5	1003.3	983.8	973.4
50°	975.1	966.3	941.6	916.9	908.0
52.5°	908.0	895.7	872.9	853.5	841.1
55°	839.4	828.8	807.6	786.5	777.7
57.5°	770.5	761.8	738.8	717.7	710.5
60°	701.7	694.8	670.1	650.6	645.5
62.5°	634.8	622.5	604.8	587.2	580.1
65°	566.1	555.4	537.8	522.0	513.1
67.5°	495.6	486.6	470.9	458.5	451.4
70°	430.3	423.2	407.3	394.9	388.0
72.5°	363.4	356.2	347.4	335.1	329.8
75°	296.1	292.8	283.8	273.3	276.9
77.5°	236.3	229.1	225.6	220.4	215.2
80°	176.4	174.6	171.0	165.8	162.2
82.5°	119.9	119.9	118.2	111.1	111.1
85°	72.2	70.5	68.8	63.4	61.7
87.5°	31.8	28.3	24.7	19.4	17.6
90°	0.8	11.0	18.4	23.1	24.8
92.5°	23.1	19.3	22.1	23.9	24.8
95°	59.8	29.4	35.8	40.5	39.6
97.5°	107.7	32.2	46.9	49.8	50.6
100°	163.0	36.9	52.5	59.8	61.6
102.5°	223.7	222.0	54.3	64.4	67.2
105°	279.8	307.6	56.2	66.3	69.9
107.5°	345.3	368.3	58.1	68.1	71.8
110°	407.9	427.2	161.2	69.1	72.7

TEST NUMBER: P903521

CATALOG NUMBER: DFN2DIP-SQ2F0-050D040US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	466.8	483.3	467.7	70.9	73.7
115°	529.3	545.0	568.1	141.8	75.6
117.5°	583.7	602.1	617.8	486.1	244.9
120°	644.5	658.3	674.9	686.0	561.7
122.5°	696.0	710.8	729.2	734.7	735.7
125°	748.5	760.5	778.0	784.5	787.2
127.5°	796.4	809.3	823.1	832.4	833.2
130°	841.5	856.3	866.3	876.5	875.6
132.5°	887.5	899.6	909.6	917.9	917.1
135°	926.2	941.0	949.2	958.5	956.7
137.5°	966.7	977.7	987.0	996.2	993.4
140°	1006.3	1013.7	1023.8	1032.1	1027.5
142.5°	1039.5	1045.9	1057.9	1065.2	1060.6
145°	1074.5	1073.6	1089.1	1095.6	1091.0
147.5°	1104.8	1102.0	1117.7	1122.3	1118.7
150°	1134.3	1127.8	1142.6	1148.1	1143.5
152.5°	1159.1	1151.8	1165.5	1171.1	1164.7
155°	1183.1	1174.9	1185.9	1191.4	1184.0
157.5°	1202.4	1195.0	1203.4	1209.8	1202.4
160°	1219.0	1213.4	1219.0	1224.5	1218.0
162.5°	1233.7	1228.2	1232.8	1239.3	1231.0
165°	1246.6	1241.1	1243.9	1250.3	1243.9
167.5°	1256.8	1251.1	1254.1	1260.5	1252.2
170°	1265.1	1259.5	1261.3	1267.8	1259.5
172.5°	1270.5	1265.1	1267.0	1273.4	1265.1
175°	1275.1	1268.7	1270.5	1277.0	1267.8
177.5°	1277.0	1270.5	1271.5	1278.0	1269.7
180°	1272.4	1272.4	1272.4	1272.4	1272.4

TEST NUMBER: P903521

CATALOG NUMBER: DFN2DIP-SQ2F0-050D040US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.50	13.42	13.41	14.34	15.53	12.06	12.97	12.97	13.90	15.09
	3H	14.15	14.97	15.07	15.90	17.12	13.66	14.48	14.58	15.41	16.63
	4H	14.72	15.50	15.66	16.44	17.66	14.23	15.01	15.16	15.95	17.17
	6H	15.11	15.83	16.06	16.77	18.01	14.61	15.33	15.56	16.27	17.51
	8H	15.21	15.89	16.16	16.86	18.09	14.71	15.39	15.66	16.35	17.59
	12H	15.25	15.90	16.21	16.86	18.12	14.74	15.39	15.70	16.35	17.61
4H	2H	12.96	13.73	13.90	14.68	15.90	12.60	13.38	13.54	14.32	15.54
	3H	14.81	15.45	15.76	16.43	17.66	14.40	15.05	15.35	16.02	17.25
	4H	15.51	16.10	16.47	17.06	18.33	15.08	15.67	16.04	16.64	17.90
	6H	16.01	16.52	16.98	17.51	18.77	15.57	16.08	16.55	17.07	18.33
	8H	16.15	16.62	17.12	17.61	18.88	15.71	16.19	16.69	17.17	18.45
	12H	16.21	16.64	17.21	17.64	18.92	15.77	16.20	16.76	17.20	18.48
8H	4H	15.70	16.17	16.67	17.16	18.43	15.32	15.79	16.29	16.78	18.05
	6H	16.31	16.70	17.31	17.72	19.00	15.92	16.32	16.92	17.34	18.61
	8H	16.51	16.86	17.52	17.87	19.17	16.12	16.47	17.13	17.48	18.77
	12H	16.63	16.94	17.65	17.95	19.28	16.22	16.53	17.24	17.54	18.87
12H	4H	15.68	16.11	16.68	17.11	18.39	15.31	15.74	16.31	16.74	18.02
	6H	16.33	16.68	17.34	17.69	18.98	15.96	16.31	16.97	17.32	18.61
	8H	16.56	16.87	17.57	17.87	19.21	16.18	16.49	17.19	17.49	18.83