

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903551

Luminaire Tested: DFN2DIP-SQ2F0-060D050US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903551
REPORT IS A COMBINATION OF REPORTS P901322 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D050US830-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9472.6 lumens
Efficiency: N/A
Efficacy: 102.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 92.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903551

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US830-RLLONL

Luminous Intensity Polar Plot

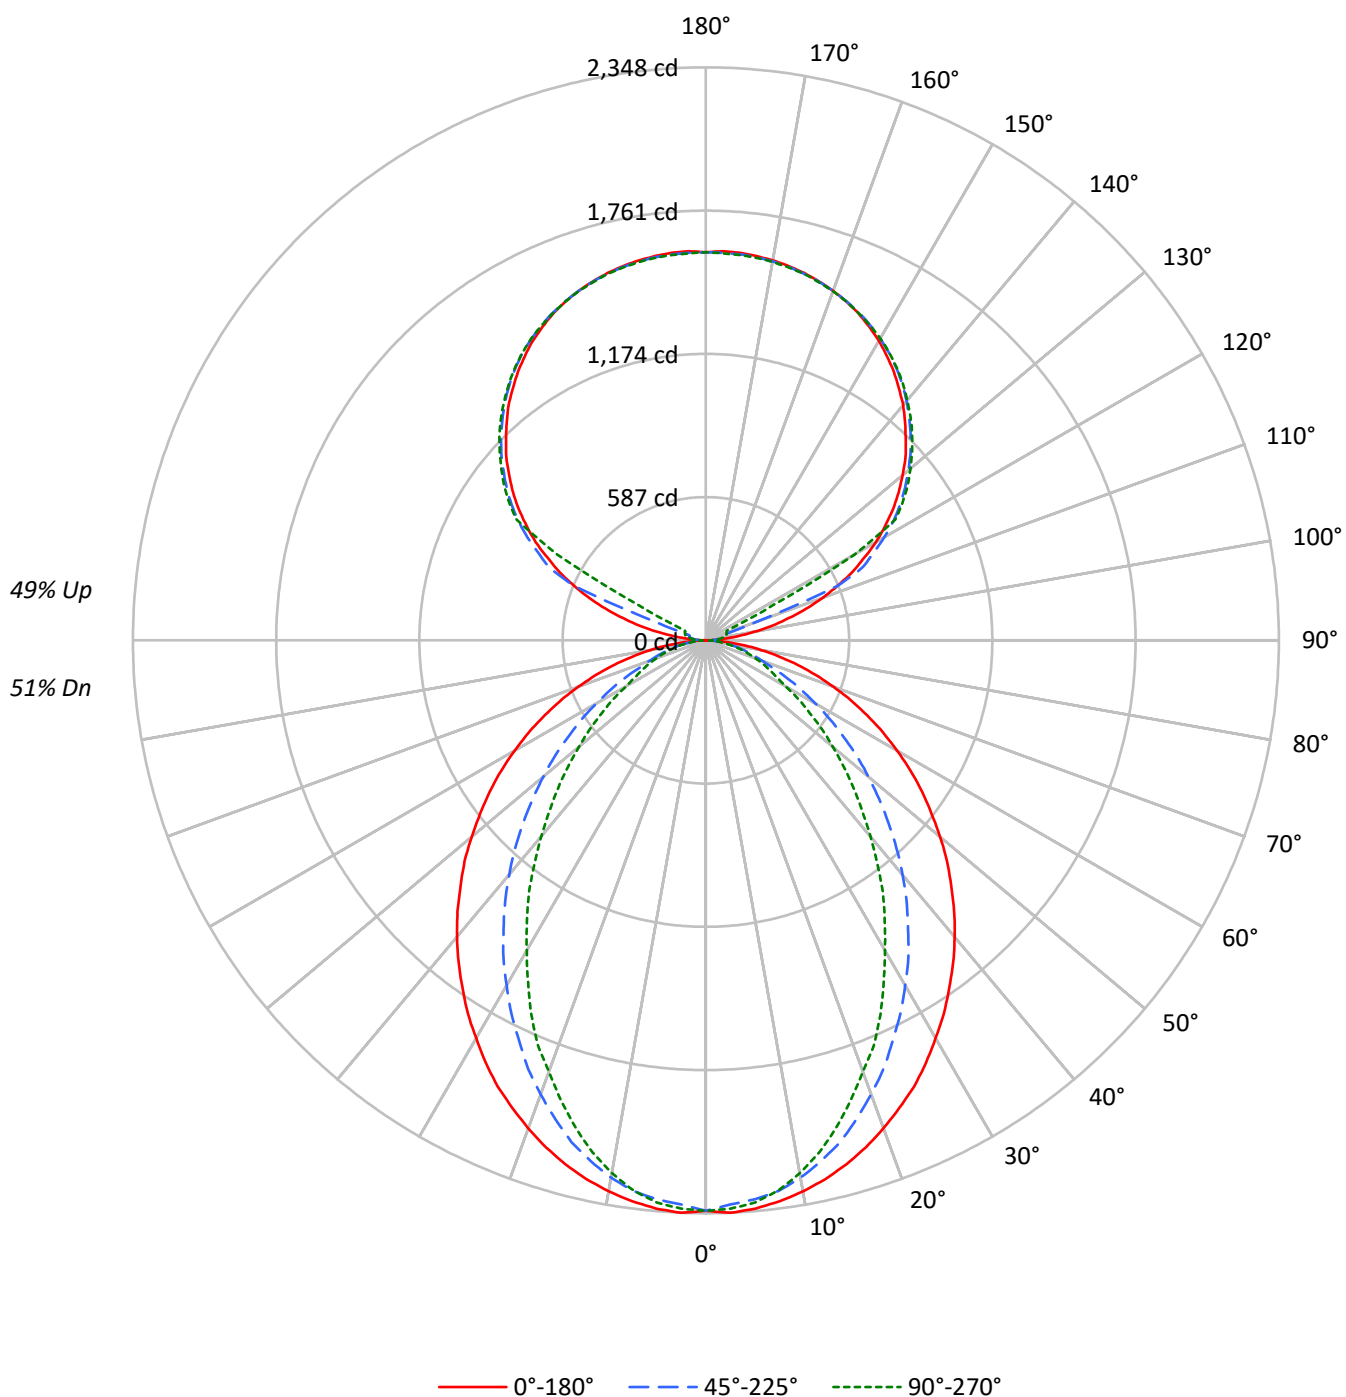

TEST NUMBER: P903551

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	98	94	91	87	91	87	84	81	74	72	70	62	61	59	51	50	49
2	90	83	77	72	83	77	72	67	66	62	59	55	52	50	45	44	42
3	82	73	66	61	76	68	62	57	58	54	50	49	46	43	41	38	36
4	76	65	58	52	70	61	54	49	52	47	43	44	40	37	37	34	32
5	70	58	50	45	64	54	47	42	47	41	37	40	36	33	33	30	28
6	64	53	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	60	48	40	34	55	45	38	33	39	33	29	33	29	26	28	25	22
8	55	43	36	31	51	41	34	29	35	30	26	30	26	23	26	23	20
9	52	40	32	27	48	37	31	26	32	27	23	28	24	21	24	21	18
10	48	36	29	25	45	34	28	24	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5139	5139	5139
5°	5139	5047	5083
10°	5079	4937	4911
15°	5000	4763	4648
20°	4899	4527	4329
25°	4795	4266	4021
30°	4658	3998	3632
35°	4524	3712	3291
40°	4387	3417	2901
45°	4229	3092	2549
50°	4065	2764	2204
55°	3892	2415	1874
60°	3692	2052	1536
65°	3462	1684	1374
70°	3181	1341	1234
75°	2829	1161	1108
80°	2323	942	938
85°	1512	586	669

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4229 cd/sqm

TEST NUMBER: P903551

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.1	2.3
10°-20°	601.3	6.3
20°-30°	844.3	8.9
30°-40°	920.3	9.7
40°-50°	845.9	8.9
50°-60°	664.3	7.0
60°-70°	432.4	4.6
70°-80°	222.6	2.3
80°-90°	59.6	0.6
90°-100°	52.5	0.6
100°-110°	195.5	2.1
110°-120°	518.5	5.5
120°-130°	860.0	9.1
130°-140°	913.5	9.6
140°-150°	849.0	9.0
150°-160°	682.6	7.2
160°-170°	439.8	4.6
170°-180°	151.4	1.6
0°-30°	1664.7	17.6
0°-40°	2585.0	27.3
0°-60°	4095.1	43.2
0°-90°	4809.7	50.8
90°-120°	766.5	8.1
90°-150°	3389.0	35.8
90°-180°	4663.0	49.2
0°-180°	9472.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2337	2337	2337	2337	2337	
5°	2337	2327	2299	2318	2312	222
15°	2223	2200	2128	2088	2067	626
25°	2018	1950	1811	1724	1692	928
35°	1739	1631	1445	1312	1265	1088
45°	1421	1280	1058	907	857	1098
55°	1081	916	687	561	520	966
65°	730	558	368	296	290	724
75°	389	241	169	154	152	412
85°	91	46	40	40	40	104
90°	1	14	23	29	31	9
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P903551

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2337.3	2337.3	2337.3	2337.3	2337.3
2.5°	2347.9	2337.3	2313.9	2335.2	2331.0
5°	2337.3	2326.8	2299.1	2318.3	2312.0
7.5°	2318.3	2305.6	2276.1	2284.3	2273.8
10°	2292.8	2278.0	2235.9	2229.4	2216.8
12.5°	2261.3	2242.1	2184.9	2172.4	2149.0
15°	2223.1	2199.7	2127.9	2087.7	2066.6
17.5°	2178.7	2144.8	2055.9	2009.4	1975.6
20°	2127.9	2085.5	1979.8	1927.0	1880.4
22.5°	2072.9	2024.2	1901.5	1829.7	1798.0
25°	2018.0	1950.2	1810.6	1724.0	1692.1
27.5°	1952.5	1880.4	1726.0	1626.5	1577.9
30°	1882.6	1802.0	1632.9	1525.1	1467.9
32.5°	1814.9	1717.5	1544.3	1417.2	1364.2
35°	1738.8	1630.9	1444.8	1311.5	1264.8
37.5°	1664.7	1548.2	1351.7	1205.6	1152.8
40°	1586.4	1459.6	1254.2	1104.1	1049.1
42.5°	1506.1	1370.7	1157.1	1000.4	947.7
45°	1421.4	1279.6	1057.7	907.3	856.6
47.5°	1341.1	1191.0	962.5	812.2	765.7
50°	1252.3	1102.1	869.4	723.3	679.1
52.5°	1165.4	1006.7	780.5	640.9	600.8
55°	1080.8	915.9	687.4	560.6	520.4
57.5°	994.2	824.9	605.0	486.5	452.6
60°	905.3	736.1	518.2	410.5	376.5
62.5°	818.7	649.5	444.1	342.7	325.8
65°	729.8	558.4	368.1	296.2	289.7
67.5°	645.2	473.7	296.2	260.1	253.8
70°	556.3	391.3	245.2	224.2	215.7
72.5°	471.7	315.1	205.1	188.3	184.0
75°	389.2	241.0	169.2	154.4	152.4
77.5°	306.8	171.3	133.3	124.8	120.6
80°	230.5	122.7	101.4	93.1	93.1
82.5°	160.7	82.6	69.7	65.5	65.5
85°	90.9	46.5	40.2	40.2	40.2
87.5°	33.9	16.9	16.9	14.8	14.8
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9

TEST NUMBER: P903551

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P903551

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.79	13.63	13.75	14.60	15.86	8.75	9.59	9.71	10.56	11.82
	3H	14.45	15.20	15.42	16.18	17.46	9.92	10.67	10.89	11.65	12.93
	4H	15.05	15.75	16.03	16.73	18.03	10.36	11.07	11.34	12.05	13.34
	6H	15.45	16.10	16.45	17.09	18.40	10.67	11.32	11.66	12.30	13.61
	8H	15.57	16.19	16.57	17.19	18.50	10.75	11.37	11.75	12.37	13.67
	12H	15.62	16.21	16.63	17.21	18.54	10.78	11.37	11.79	12.37	13.70
4H	2H	12.81	13.51	13.79	14.49	15.79	9.34	10.05	10.33	11.03	12.32
	3H	14.61	15.20	15.61	16.21	17.52	10.67	11.26	11.66	12.27	13.57
	4H	15.29	15.83	16.30	16.83	18.16	11.20	11.74	12.21	12.74	14.07
	6H	15.79	16.25	16.80	17.27	18.60	11.60	12.06	12.62	13.09	14.42
	8H	15.95	16.38	16.97	17.40	18.74	11.72	12.15	12.74	13.17	14.51
	12H	16.04	16.42	17.07	17.46	18.81	11.77	12.16	12.81	13.20	14.55
8H	4H	15.25	15.68	16.27	16.70	18.05	11.47	11.90	12.49	12.92	14.26
	6H	15.80	16.15	16.84	17.22	18.56	11.96	12.32	13.01	13.38	14.72
	8H	16.00	16.31	17.05	17.36	18.72	12.14	12.45	13.19	13.50	14.86
	12H	16.13	16.40	17.18	17.44	18.85	12.24	12.52	13.30	13.56	14.97
12H	4H	15.21	15.59	16.24	16.63	17.98	11.47	11.86	12.51	12.89	14.24
	6H	15.77	16.09	16.82	17.13	18.49	12.01	12.32	13.06	13.37	14.73
	8H	15.98	16.25	17.03	17.30	18.70	12.20	12.48	13.25	13.52	14.92