

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906202

Luminaire Tested: DFN2DIP-SQ2F0-030D040US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906202
REPORT IS A COMBINATION OF REPORTS P899784 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-030D040US835-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6090.0 lumens
Efficiency: N/A
Efficacy: 116.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 52.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906202

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US835-RLLFLL

Luminous Intensity Polar Plot

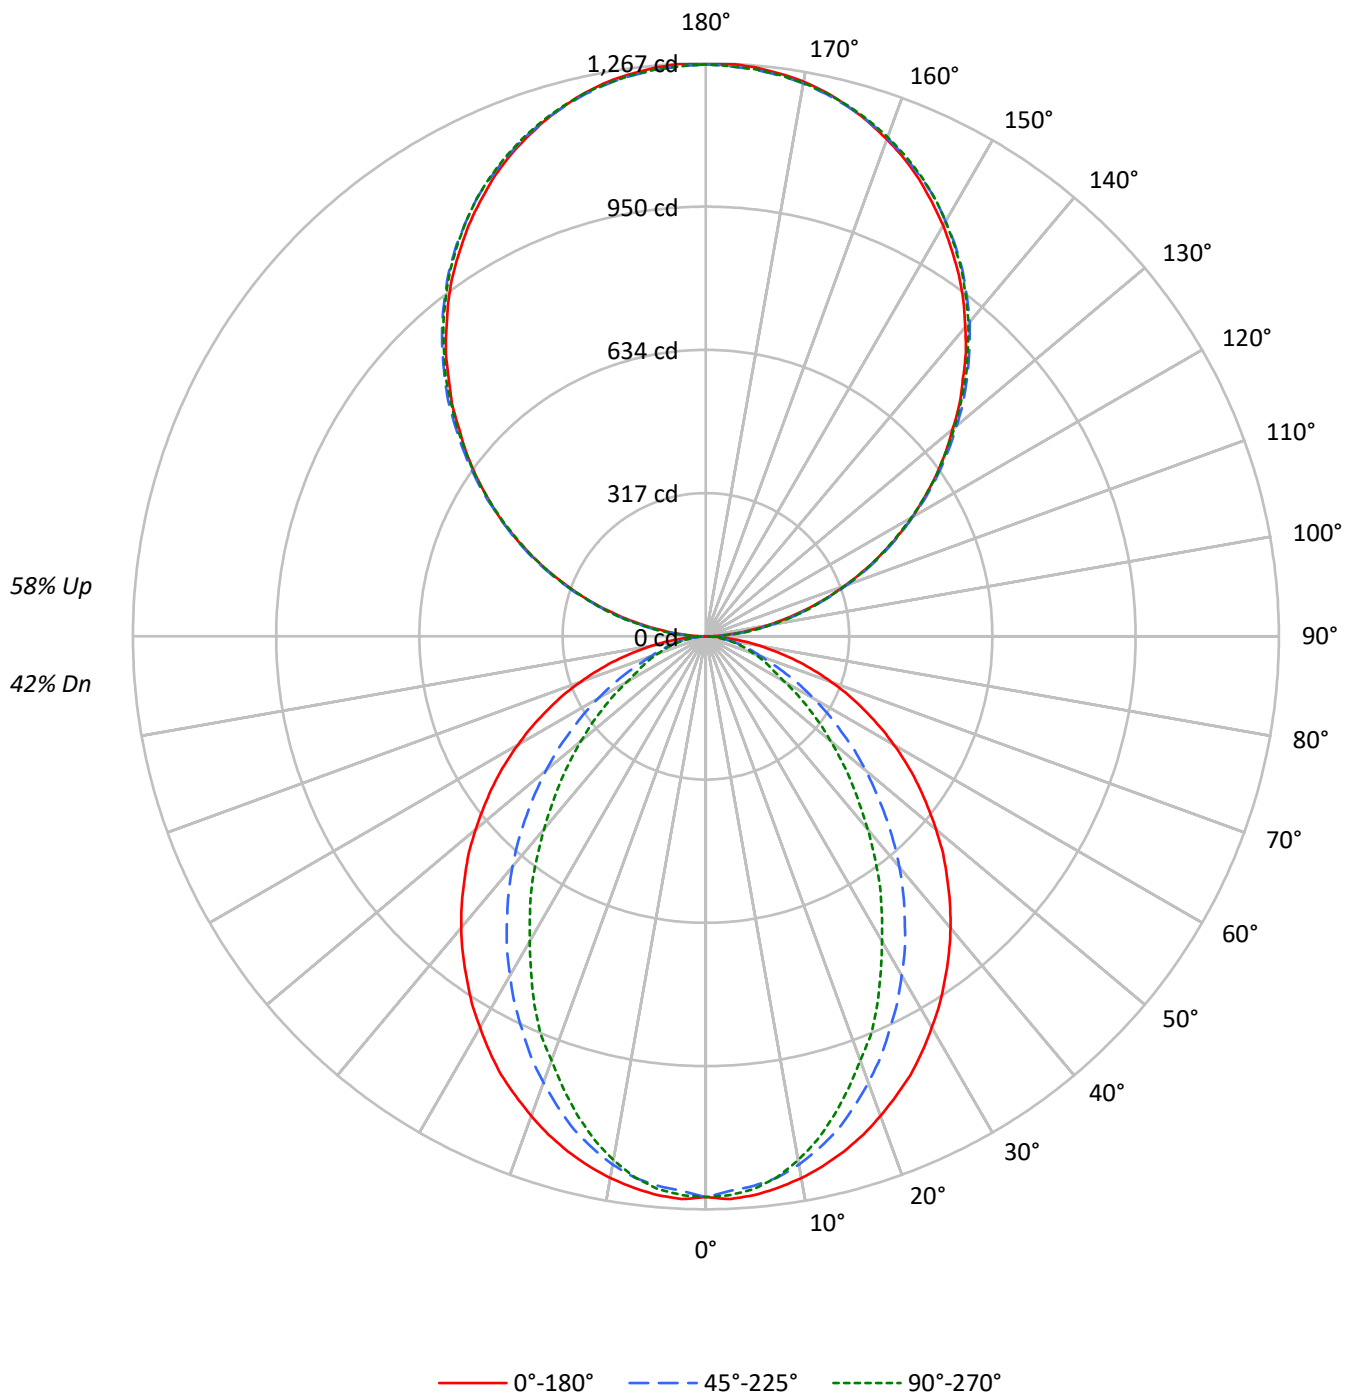

TEST NUMBER: P906202

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US835-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	47	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	40	34	30	33	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	28	33	28	24	27	23	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	20	18	16
10	47	35	28	24	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2726	2726	2726
5°	2726	2677	2696
10°	2694	2619	2605
15°	2653	2526	2466
20°	2599	2402	2296
25°	2544	2263	2133
30°	2471	2121	1927
35°	2400	1969	1746
40°	2327	1813	1539
45°	2244	1640	1352
50°	2156	1466	1169
55°	2065	1281	994
60°	1958	1088	815
65°	1836	893	729
70°	1688	711	654
75°	1500	616	587
80°	1233	500	498
85°	802	311	354

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2244 cd/sqm

TEST NUMBER: P906202

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US835-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.2	1.9
10°-20°	319.0	5.2
20°-30°	447.9	7.4
30°-40°	488.2	8.0
40°-50°	448.7	7.4
50°-60°	352.4	5.8
60°-70°	229.4	3.8
70°-80°	118.1	1.9
80°-90°	33.7	0.6
90°-100°	78.3	1.3
100°-110°	248.7	4.1
110°-120°	425.6	7.0
120°-130°	559.8	9.2
130°-140°	628.3	10.3
140°-150°	616.2	10.1
150°-160°	516.9	8.5
160°-170°	342.8	5.6
170°-180°	119.8	2.0
0°-30°	883.1	14.5
0°-40°	1371.3	22.5
0°-60°	2172.4	35.7
0°-90°	2553.6	41.9
90°-120°	752.7	12.4
90°-150°	2556.9	42.0
90°-180°	3536.0	58.1
0°-180°	6090.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1240	1240	1240	1240	1240	
5°	1240	1234	1220	1230	1226	118
15°	1179	1167	1129	1108	1096	332
25°	1070	1034	960	914	898	492
35°	922	865	766	696	671	577
45°	754	679	561	481	454	582
55°	573	486	365	297	276	512
65°	387	296	195	157	154	384
75°	206	128	90	82	81	218
85°	48	25	21	21	21	55
90°	1	14	37	35	36	6
95°	56	66	68	68	66	62
105°	230	233	235	237	237	242
115°	427	433	431	430	427	422
125°	621	631	628	624	623	555
135°	804	815	818	816	814	621
145°	976	983	989	990	986	610
155°	1116	1119	1122	1127	1124	513
165°	1214	1212	1212	1220	1215	342
175°	1263	1260	1257	1265	1259	120
180°	1265	1265	1265	1265	1265	

TEST NUMBER: P906202

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US835-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1239.9	1239.9	1239.9	1239.9	1239.9
2.5°	1245.5	1239.9	1227.5	1238.8	1236.6
5°	1239.9	1234.3	1219.7	1229.8	1226.4
7.5°	1229.8	1223.1	1207.4	1211.8	1206.2
10°	1216.3	1208.5	1186.1	1182.6	1176.0
12.5°	1199.5	1189.4	1159.1	1152.4	1140.0
15°	1179.3	1166.9	1128.8	1107.5	1096.3
17.5°	1155.7	1137.8	1090.6	1066.0	1048.0
20°	1128.8	1106.3	1050.2	1022.3	997.5
22.5°	1099.7	1073.8	1008.7	970.6	953.8
25°	1070.5	1034.5	960.5	914.5	897.6
27.5°	1035.7	997.5	915.6	862.9	837.0
30°	998.7	956.0	866.2	809.1	778.7
32.5°	962.7	911.1	819.2	751.8	723.7
35°	922.4	865.1	766.4	695.7	671.0
37.5°	883.1	821.3	717.0	639.5	611.6
40°	841.6	774.3	665.4	585.7	556.6
42.5°	798.9	727.2	613.8	530.7	502.7
45°	754.1	678.8	561.1	481.3	454.4
47.5°	711.4	631.8	510.6	430.8	406.2
50°	664.3	584.6	461.2	383.7	360.2
52.5°	618.2	534.1	414.1	340.0	318.7
55°	573.3	485.8	364.6	297.4	276.1
57.5°	527.4	437.6	321.0	258.1	240.1
60°	480.2	390.5	274.9	217.7	199.8
62.5°	434.3	344.5	235.6	181.8	172.9
65°	387.1	296.2	195.2	157.1	153.7
67.5°	342.3	251.3	157.1	138.0	134.6
70°	295.1	207.6	130.1	118.9	114.4
72.5°	250.2	167.1	108.8	99.9	97.6
75°	206.4	127.9	89.8	81.9	80.8
77.5°	162.7	90.8	70.7	66.2	63.9
80°	122.3	65.1	53.8	49.4	49.4
82.5°	85.2	43.8	37.0	34.8	34.8
85°	48.2	24.6	21.3	21.3	21.3
87.5°	18.0	8.9	8.9	7.9	7.9
90°	1.1	13.7	37.4	35.1	36.2
92.5°	23.6	32.0	33.2	34.3	34.3
95°	55.7	66.4	68.3	68.3	66.4
97.5°	92.7	102.6	106.8	106.8	106.8
100°	135.4	144.2	147.2	147.2	146.1
102.5°	180.4	186.9	191.1	192.2	191.1
105°	229.6	232.6	234.9	236.8	236.8
107.5°	278.4	283.0	283.0	283.7	278.4
110°	325.7	331.8	331.8	331.8	328.8

TEST NUMBER: P906202

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US835-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	376.8	383.3	382.1	379.1	376.8
115°	427.1	433.3	431.3	430.2	427.1
117.5°	477.1	485.5	480.2	477.1	474.1
120°	527.5	535.8	527.5	527.5	524.0
122.5°	573.2	583.9	578.6	575.5	573.2
125°	621.3	630.8	627.8	624.3	623.2
127.5°	668.2	680.0	675.8	671.2	668.2
130°	712.0	725.8	723.9	721.6	717.4
132.5°	761.2	771.9	772.7	767.3	764.3
135°	803.6	815.4	817.7	816.5	813.5
137.5°	850.9	860.4	862.3	861.5	857.0
140°	892.4	902.0	907.3	907.3	903.1
142.5°	935.2	944.7	947.7	948.9	944.7
145°	975.6	983.2	989.3	990.5	986.3
147.5°	1011.8	1021.3	1025.9	1027.8	1023.6
150°	1049.2	1055.7	1059.9	1063.3	1059.9
152.5°	1082.4	1088.8	1094.2	1098.4	1094.2
155°	1115.5	1118.6	1122.0	1127.4	1123.9
157.5°	1144.2	1146.4	1148.3	1156.0	1150.6
160°	1169.7	1172.0	1173.1	1179.6	1175.0
162.5°	1193.3	1193.3	1194.5	1201.7	1196.4
165°	1213.6	1212.4	1212.4	1220.0	1214.7
167.5°	1231.9	1228.4	1228.4	1236.1	1230.7
170°	1245.6	1242.5	1241.4	1249.0	1242.5
172.5°	1255.1	1252.1	1250.9	1258.6	1252.1
175°	1262.8	1259.7	1257.4	1265.0	1258.6
177.5°	1267.0	1263.9	1261.6	1268.1	1261.6
180°	1265.0	1265.0	1265.0	1265.0	1265.0

TEST NUMBER: P906202

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US835-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.71	10.48	10.74	11.51	12.90	5.67	6.44	6.70	7.47	8.86
	3H	11.37	12.05	12.40	13.09	14.50	6.84	7.52	7.88	8.57	9.97
	4H	11.96	12.61	13.01	13.65	15.06	7.27	7.92	8.32	8.97	10.38
	6H	12.36	12.96	13.42	14.01	15.43	7.57	8.17	8.64	9.22	10.64
	8H	12.48	13.05	13.54	14.11	15.53	7.65	8.22	8.72	9.29	10.71
	12H	12.53	13.07	13.60	14.13	15.57	7.69	8.23	8.76	9.29	10.73
4H	2H	9.72	10.37	10.78	11.41	12.82	6.25	6.90	7.31	7.94	9.36
	3H	11.52	12.06	12.58	13.13	14.56	7.57	8.11	8.64	9.19	10.61
	4H	12.19	12.69	13.26	13.75	15.20	8.10	8.60	9.17	9.66	11.11
	6H	12.69	13.11	13.77	14.20	15.64	8.50	8.92	9.58	10.01	11.45
	8H	12.85	13.25	13.93	14.32	15.78	8.62	9.01	9.70	10.09	11.55
	12H	12.93	13.29	14.03	14.38	15.84	8.67	9.03	9.77	10.12	11.58
8H	4H	12.15	12.55	13.23	13.63	15.08	8.37	8.76	9.45	9.84	11.30
	6H	12.69	13.02	13.80	14.14	15.59	8.86	9.19	9.96	10.31	11.76
	8H	12.90	13.18	14.01	14.29	15.76	9.04	9.32	10.14	10.42	11.90
	12H	13.02	13.27	14.13	14.37	15.88	9.14	9.39	10.25	10.49	12.00
12H	4H	12.10	12.46	13.20	13.55	15.01	8.37	8.72	9.46	9.82	11.28
	6H	12.67	12.95	13.78	14.06	15.53	8.90	9.19	10.01	10.29	11.76
	8H	12.87	13.12	13.98	14.22	15.73	9.09	9.35	10.21	10.44	11.96

END OF REPORT