

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906225

Luminaire Tested: DFN2DIP-SQ2F0-040D040US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906225
REPORT IS A COMBINATION OF REPORTS P901305 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D040US835-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7920.0 lumens
Efficiency: N/A
Efficacy: 125.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 63.2
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906225

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US835-FLLONL

Luminous Intensity Polar Plot

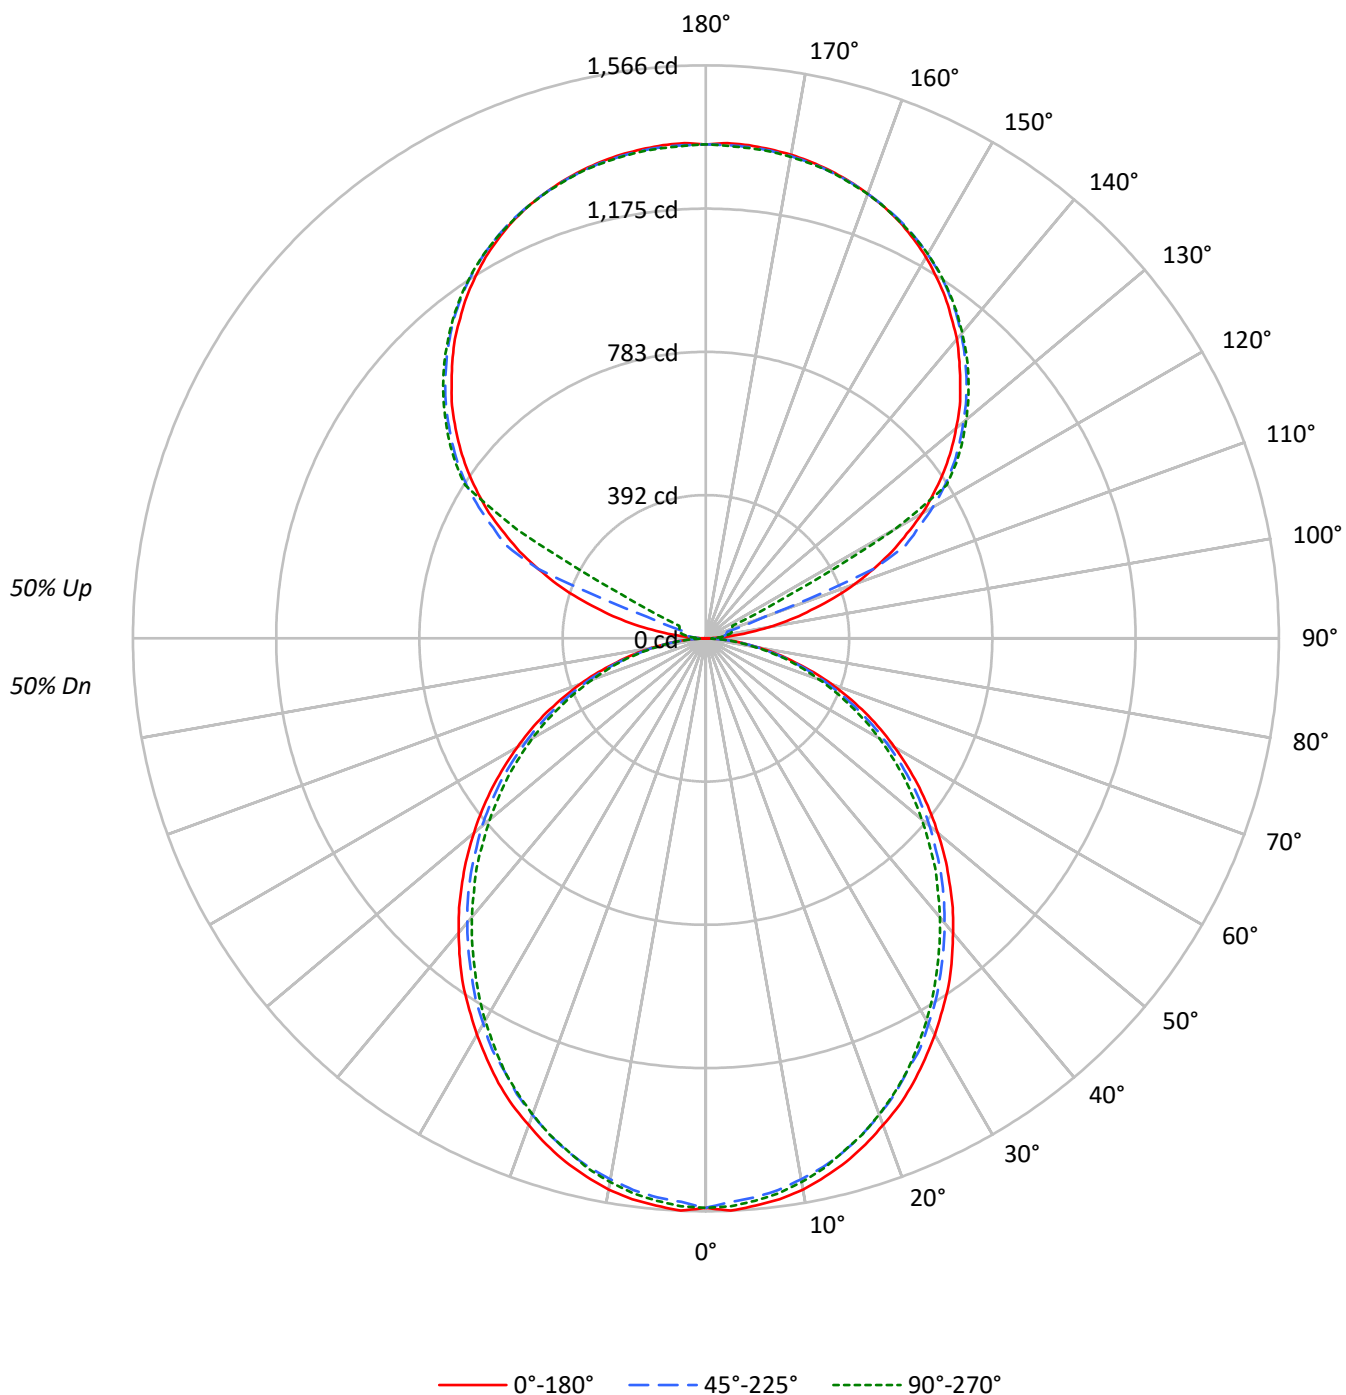

TEST NUMBER: P906225

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3422	3422	3422
5°	3422	3367	3393
10°	3388	3315	3342
15°	3332	3252	3265
20°	3259	3169	3187
25°	3186	3071	3098
30°	3096	2980	2985
35°	3010	2873	2866
40°	2906	2764	2753
45°	2801	2655	2636
50°	2686	2540	2502
55°	2566	2408	2377
60°	2429	2252	2234
65°	2279	2089	2066
70°	2089	1891	1883
75°	1828	1652	1708
80°	1509	1349	1388
85°	1020	851	872

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2801 cd/sqm

TEST NUMBER: P906225

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	146.5	1.8
10°-20°	412.2	5.2
20°-30°	605.7	7.6
30°-40°	703.5	8.9
40°-50°	702.6	8.9
50°-60°	612.7	7.7
60°-70°	452.9	5.7
70°-80°	256.2	3.2
80°-90°	70.0	0.9
90°-100°	44.5	0.6
100°-110°	165.9	2.1
110°-120°	440.1	5.6
120°-130°	729.9	9.2
130°-140°	775.4	9.8
140°-150°	720.6	9.1
150°-160°	579.4	7.3
160°-170°	373.3	4.7
170°-180°	128.5	1.6
0°-30°	1164.4	14.7
0°-40°	1867.9	23.6
0°-60°	3183.2	40.2
0°-90°	3962.4	50.0
90°-120°	650.5	8.2
90°-150°	2876.4	36.3
90°-180°	3958.0	50.0
0°-180°	7920.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1556	1556	1556	1556	1556	
5°	1556	1550	1534	1546	1543	148
15°	1482	1473	1453	1459	1452	417
25°	1341	1329	1304	1306	1304	617
35°	1157	1142	1118	1109	1102	722
45°	941	931	908	892	886	727
55°	712	703	686	668	660	637
65°	480	471	456	443	436	475
75°	251	248	241	232	235	268
85°	61	60	58	54	52	68
90°	1	12	20	24	26	7
95°	63	31	38	43	42	75
105°	297	326	60	70	74	317
115°	562	578	603	150	80	553
125°	794	807	825	832	835	708
135°	983	998	1007	1017	1015	759
145°	1140	1139	1156	1162	1158	713
155°	1255	1246	1258	1264	1256	578
165°	1323	1317	1320	1326	1320	374
175°	1353	1346	1348	1355	1345	129
180°	1350	1350	1350	1350	1350	

TEST NUMBER: P906225

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1556.4	1556.4	1556.4	1556.4	1556.4
2.5°	1565.5	1558.0	1541.5	1556.4	1553.6
5°	1556.4	1550.5	1534.0	1545.9	1543.1
7.5°	1545.9	1537.0	1520.5	1532.6	1529.6
10°	1529.6	1519.1	1501.2	1513.1	1508.6
12.5°	1507.0	1498.1	1480.2	1487.7	1484.6
15°	1481.6	1472.7	1453.2	1459.2	1451.8
17.5°	1450.2	1441.3	1421.8	1429.2	1421.8
20°	1415.7	1406.8	1385.9	1390.3	1384.5
22.5°	1381.4	1367.9	1348.4	1348.4	1345.4
25°	1340.9	1329.0	1303.6	1306.5	1303.6
27.5°	1296.0	1285.5	1266.2	1261.7	1254.3
30°	1251.2	1239.2	1216.8	1212.3	1206.3
32.5°	1203.3	1194.4	1170.4	1161.4	1155.3
35°	1156.9	1142.0	1118.0	1109.0	1101.5
37.5°	1104.5	1091.0	1067.0	1056.6	1049.1
40°	1050.7	1038.6	1014.6	1001.3	995.3
42.5°	998.3	986.2	962.4	947.3	938.4
45°	941.4	931.0	908.4	892.1	886.0
47.5°	886.0	875.5	851.6	835.1	826.2
50°	827.6	820.1	799.2	778.2	770.7
52.5°	770.7	760.3	740.9	724.4	713.9
55°	712.5	703.4	685.5	667.5	660.1
57.5°	654.0	646.6	627.0	609.1	603.1
60°	595.6	589.7	568.8	552.3	547.8
62.5°	538.8	528.3	513.4	498.4	492.4
65°	480.5	471.4	456.5	443.0	435.6
67.5°	420.6	413.0	399.7	389.2	383.2
70°	365.2	359.2	345.7	335.2	329.3
72.5°	308.4	302.3	294.9	284.4	279.9
75°	251.4	248.5	240.9	232.0	235.0
77.5°	200.5	194.5	191.5	187.0	182.6
80°	149.7	148.1	145.1	140.7	137.7
82.5°	101.8	101.8	100.4	94.3	94.3
85°	61.3	59.9	58.4	53.8	52.4
87.5°	27.0	24.0	21.0	16.5	14.9
90°	0.9	11.7	19.5	24.5	26.3
92.5°	24.5	20.5	23.4	25.4	26.3
95°	63.4	31.2	38.0	43.0	42.0
97.5°	114.3	34.2	49.8	52.8	53.7
100°	172.9	39.1	55.7	63.4	65.4
102.5°	237.3	235.5	57.6	68.3	71.3
105°	296.9	326.3	59.6	70.3	74.2
107.5°	366.3	390.7	61.6	72.3	76.2
110°	432.8	453.2	171.0	73.3	77.1

TEST NUMBER: P906225

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	495.3	512.8	496.2	75.2	78.2
115°	561.6	578.2	602.7	150.4	80.2
117.5°	619.3	638.8	655.5	515.7	259.8
120°	683.8	698.4	716.0	727.8	595.9
122.5°	738.4	754.1	773.7	779.5	780.5
125°	794.1	806.9	825.4	832.3	835.2
127.5°	844.9	858.6	873.3	883.1	884.0
130°	892.8	908.5	919.1	929.9	929.0
132.5°	941.6	954.4	965.1	973.9	973.0
135°	982.7	998.4	1007.1	1016.9	1015.0
137.5°	1025.6	1037.3	1047.2	1056.9	1054.0
140°	1067.6	1075.5	1086.2	1095.0	1090.1
142.5°	1102.9	1109.7	1122.4	1130.1	1125.3
145°	1140.0	1139.0	1155.5	1162.4	1157.5
147.5°	1172.1	1169.2	1185.8	1190.7	1186.9
150°	1203.4	1196.6	1212.3	1218.1	1213.2
152.5°	1229.8	1222.0	1236.6	1242.5	1235.7
155°	1255.2	1246.5	1258.2	1264.0	1256.2
157.5°	1275.7	1267.9	1276.8	1283.6	1275.7
160°	1293.3	1287.4	1293.3	1299.1	1292.3
162.5°	1308.9	1303.1	1308.0	1314.8	1306.0
165°	1322.6	1316.8	1319.7	1326.5	1319.7
167.5°	1333.4	1327.4	1330.5	1337.3	1328.5
170°	1342.2	1336.3	1338.2	1345.1	1336.3
172.5°	1348.0	1342.2	1344.2	1351.0	1342.2
175°	1352.8	1346.0	1348.0	1354.8	1345.1
177.5°	1354.8	1348.0	1349.0	1355.9	1347.1
180°	1350.0	1350.0	1350.0	1350.0	1350.0

TEST NUMBER: P906225

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.43	12.30	12.39	13.27	14.54	10.99	11.85	11.95	12.82	14.09
	3H	13.08	13.85	14.04	14.83	16.12	12.59	13.36	13.55	14.34	15.63
	4H	13.65	14.38	14.63	15.37	16.67	13.16	13.89	14.14	14.87	16.17
	6H	14.04	14.71	15.03	15.70	17.01	13.54	14.21	14.53	15.20	16.51
	8H	14.13	14.77	15.13	15.78	17.09	13.63	14.27	14.63	15.28	16.59
	12H	14.17	14.78	15.18	15.79	17.12	13.67	14.28	14.67	15.28	16.61
4H	2H	11.89	12.62	12.87	13.60	14.90	11.53	12.26	12.52	13.25	14.55
	3H	13.73	14.34	14.72	15.35	16.67	13.32	13.93	14.32	14.94	16.26
	4H	14.43	14.99	15.43	15.99	17.33	14.00	14.56	15.01	15.57	16.91
	6H	14.92	15.40	15.94	16.43	17.77	14.49	14.97	15.51	16.00	17.34
	8H	15.06	15.51	16.08	16.54	17.89	14.63	15.08	15.64	16.10	17.45
	12H	15.13	15.53	16.16	16.57	17.93	14.68	15.08	15.72	16.12	17.48
8H	4H	14.61	15.06	15.63	16.08	17.44	14.23	14.68	15.25	15.71	17.06
	6H	15.22	15.59	16.26	16.66	18.00	14.83	15.21	15.88	16.27	17.62
	8H	15.43	15.75	16.48	16.80	18.17	15.03	15.36	16.08	16.41	17.78
	12H	15.54	15.83	16.60	16.88	18.29	15.13	15.42	16.19	16.47	17.88
12H	4H	14.59	15.00	15.63	16.04	17.40	14.22	14.63	15.26	15.67	17.03
	6H	15.24	15.57	16.29	16.62	17.99	14.87	15.20	15.92	16.25	17.62
	8H	15.47	15.76	16.52	16.80	18.21	15.09	15.38	16.14	16.42	17.83